




PROBLEM SUMMARY


Sample Rating Trend

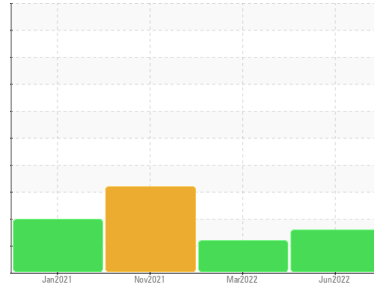

Machine Id
KAESER 7328522
 Component
Compressor
 Fluid
NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

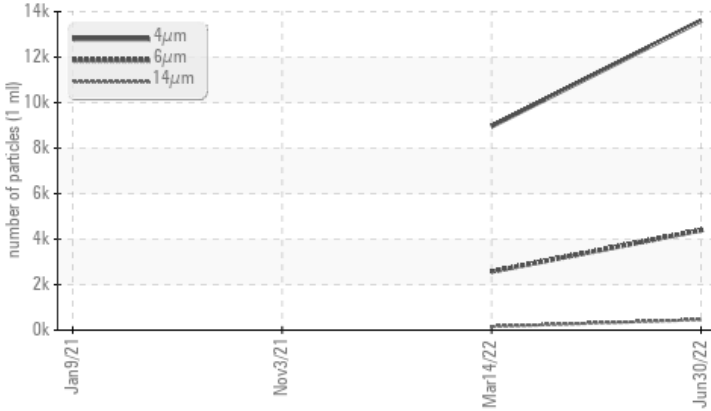

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 4393	▲ 2573	---
Particles >14µm	ASTM D7647	>80	▲ 464	▲ 159	---
Particles >21µm	ASTM D7647	>20	▲ 95	▲ 32	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/16	▲ 19/14	---

Customer Id: AMAKER
 Sample No.: KCP40600
 Lab Number: 05584186
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

14 Mar 2022 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



03 Nov 2021 Diag: Jonathan Hester

WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Appearance is unacceptable. There is a light concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil. The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

view report



09 Jan 2021 Diag: Jonathan Hester

WATER




Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id
KAESER 7328522
Component
Compressor
Fluid
NOT GIVEN (--- GAL)

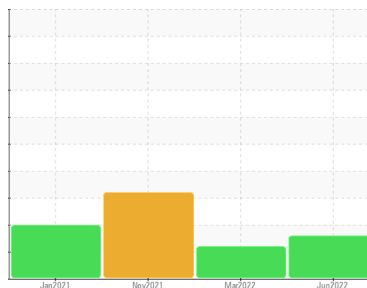

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP40600	KCP41039	KCP3927
Sample Date	Client Info			30 Jun 2022	14 Mar 2022	03 Nov 2021
Machine Age	hrs	Client Info		8868	8157	7647
Oil Age	hrs	Client Info		700	500	2500
Oil Changed	Client Info			Not Chngd	Not Chngd	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	3
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	1	1
Lead	ppm	ASTM D5185m	>10	<1	0	<1
Copper	ppm	ASTM D5185m	>50	5	2	10
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	1	25
Barium	ppm	ASTM D5185m		45	46	2
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m		79	80	64
Calcium	ppm	ASTM D5185m		2	<1	2
Phosphorus	ppm	ASTM D5185m		0	6	4
Zinc	ppm	ASTM D5185m		4	0	15
Sulfur	ppm	ASTM D5185m		21224	16270	32999


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	3
Sodium	ppm	ASTM D5185m		7	6	14
Potassium	ppm	ASTM D5185m	>20	8	7	22
Water	%	ASTM D6304	>0.05	0.031	0.025	▲ 0.337
ppm Water	ppm	ASTM D6304	>500	317.4	253.7	▲ 3370

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		13602	8959	---
Particles >6µm		ASTM D7647	>1300	▲ 4393	▲ 2573	---
Particles >14µm		ASTM D7647	>80	▲ 464	▲ 159	---
Particles >21µm		ASTM D7647	>20	▲ 95	▲ 32	---
Particles >38µm		ASTM D7647	>4	0	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/19/16	▲ 19/14	---


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.34	0.36	0.441

OIL ANALYSIS REPORT


▲ Particle Trend

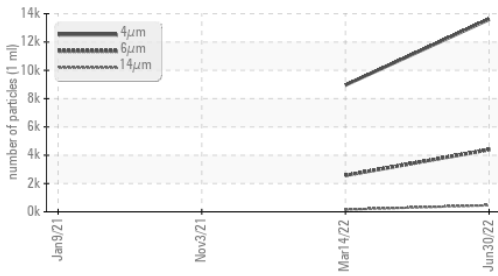


Water (KF)

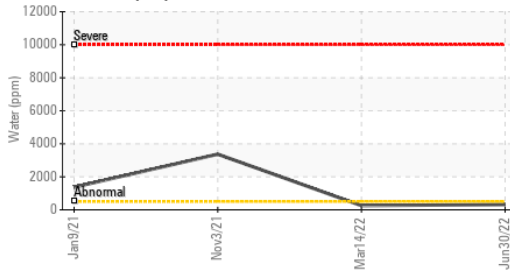


Acid Number

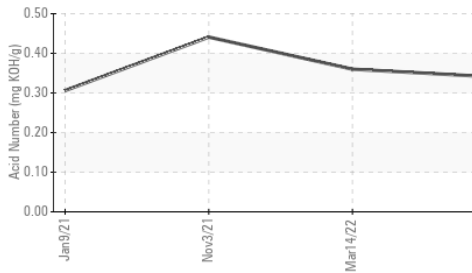

Water (KF)

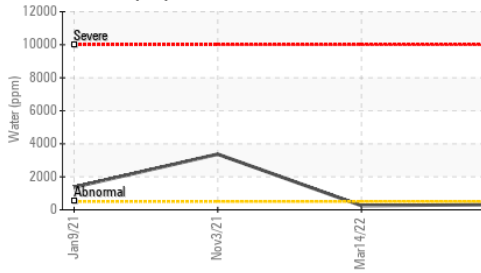

Viscosity @ 40°C

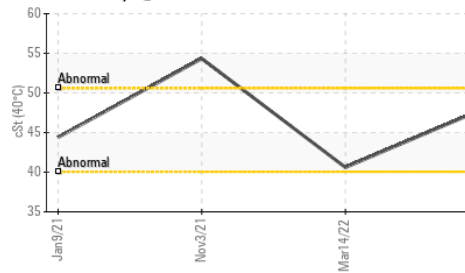


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	▲ HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	48.3	40.6	▲ 54.34

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

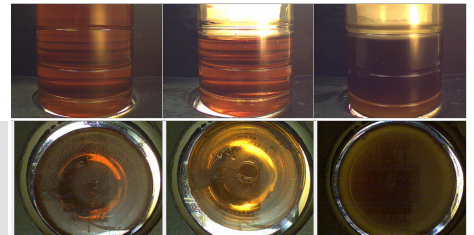


Bottom

GRAPHS


Ferrous Alloys

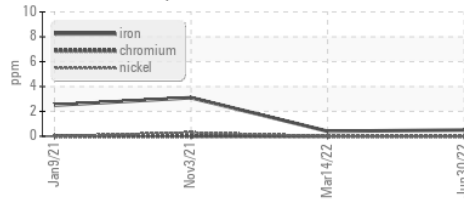


Non-ferrous Metals

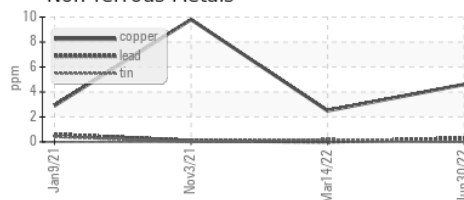


Viscosity @ 40°C

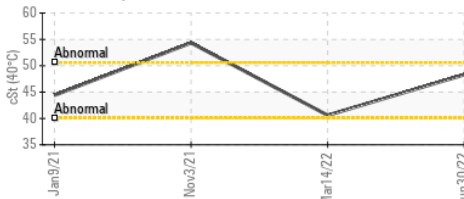

▲ Particle Count

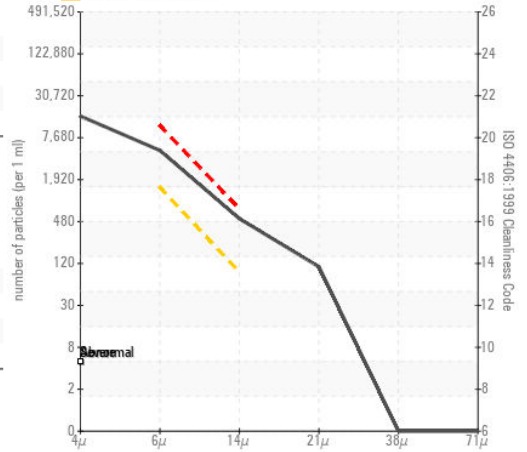

Acid Number

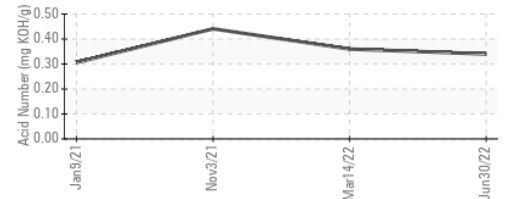

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP40600 **Received** : 05 Jul 2022
Lab Number : 05584186 **Diagnosed** : 07 Jul 2022
Unique Number : 10038612 **Diagnostician** : Don Baldrige

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

AMAZON GSO1
 1656 OLD GREENSBORO RD
 KERNERSVILLE, NC
 US 27284
 Contact: B. LANCRON
 blancron@amazon.com

T:
F: