




PROBLEM SUMMARY


Sample Rating Trend

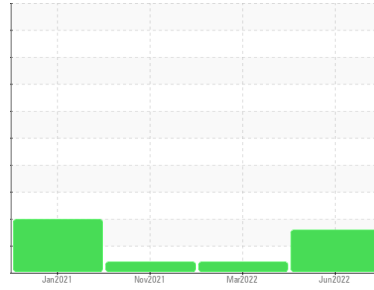

Machine Id
KAESER 7392924
 Component
Compressor
 Fluid
NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

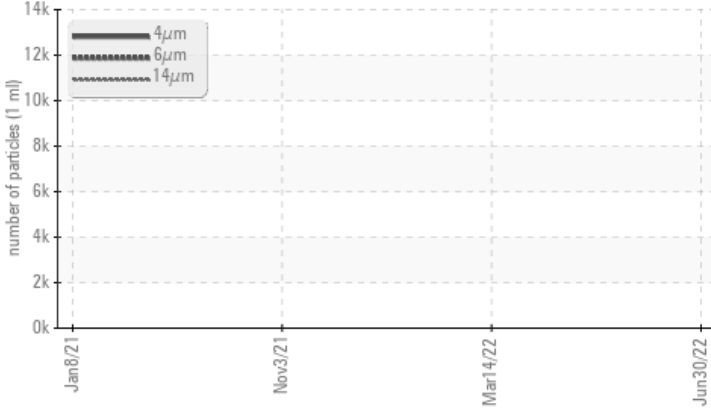

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 3540	---	---
Particles >14µm	ASTM D7647	>80	▲ 299	---	---
Particles >21µm	ASTM D7647	>20	▲ 71	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/15	---	---

Customer Id: AMAKER
 Sample No.: KCP40620
 Lab Number: 05584188
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

14 Mar 2022 Diag: Jonathan Hester

VIS DEBRIS



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



03 Nov 2021 Diag: Doug Bogart

VIS DEBRIS



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 Jan 2021 Diag: Jonathan Hester

WATER




Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

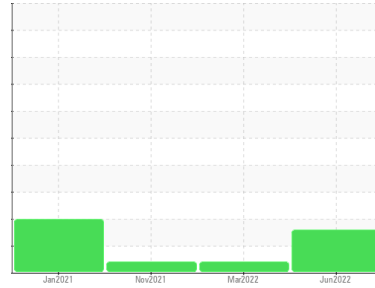

ISO



Machine Id
KAESER 7392924

Component
Compressor
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCP40620	KCP41023	KCP39278
Sample Date	Client Info		30 Jun 2022	14 Mar 2022	03 Nov 2021
Machine Age	hrs	Client Info	7142	5813	3895
Oil Age	hrs	Client Info	1300	2000	1200
Oil Changed	Client Info		Not Chngd	Not Chngd	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	<1	<1	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	3	2	3
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<1	1	0
Barium	ppm	ASTM D5185m	51	64	50
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m	78	89	80
Calcium	ppm	ASTM D5185m	2	3	2
Phosphorus	ppm	ASTM D5185m	0	1	<1
Zinc	ppm	ASTM D5185m	5	4	8
Sulfur	ppm	ASTM D5185m	23567	17367	18235

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	2
Sodium	ppm	ASTM D5185m	18	18	30
Potassium	ppm	ASTM D5185m >20	7	5	8
Water	%	ASTM D6304 >0.05	0.034	0.028	0.027
ppm Water	ppm	ASTM D6304 >500	349.6	287.1	271.9

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		12982	---	---
Particles >6µm	ASTM D7647 >1300		▲ 3540	---	---
Particles >14µm	ASTM D7647 >80		▲ 299	---	---
Particles >21µm	ASTM D7647 >20		▲ 71	---	---
Particles >38µm	ASTM D7647 >4		1	---	---
Particles >71µm	ASTM D7647 >3		0	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 21/19/15	---	---

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.35	0.36	0.313

OIL ANALYSIS REPORT


▲ Particle Trend

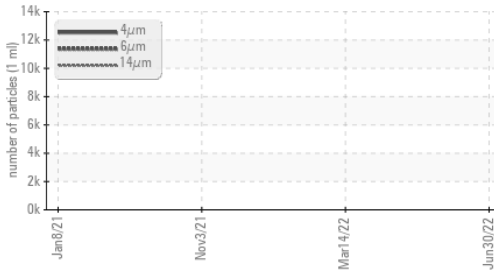


Water (KF)

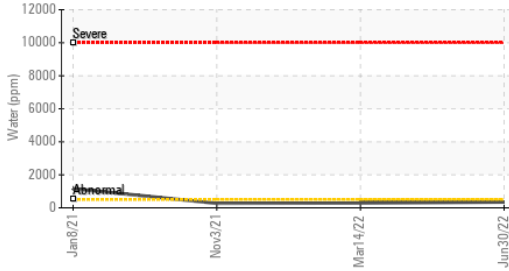


Acid Number

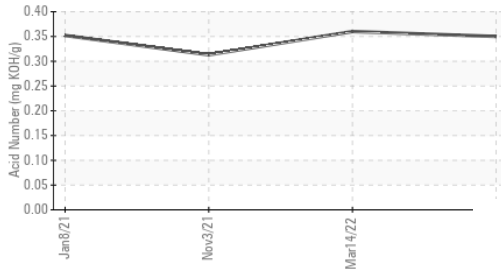

Water (KF)

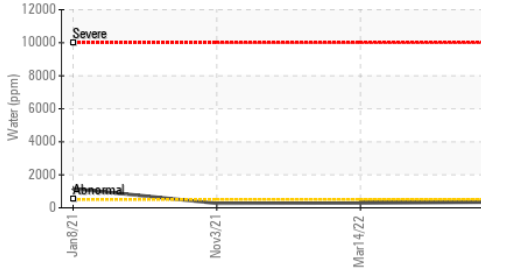


Viscosity @ 40°C

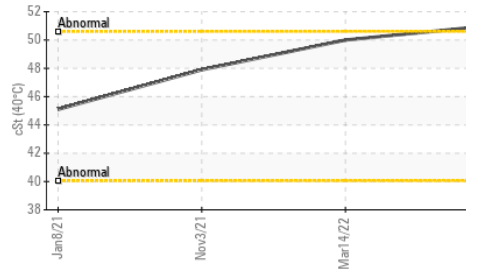

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	▲ MODER
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	51.0	50.0	47.9

SAMPLE IMAGES

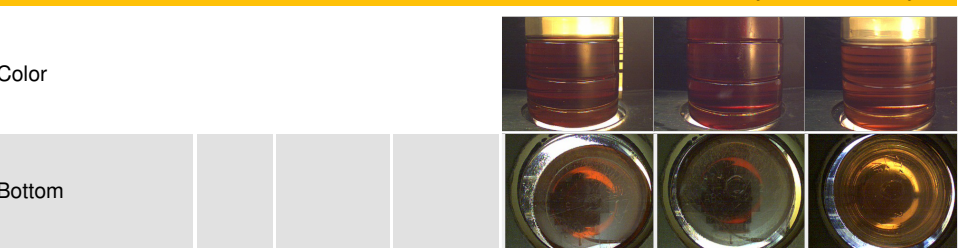


GRAPHS


Ferrous Alloys

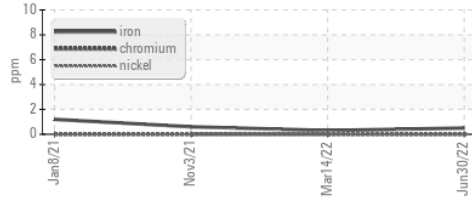


Non-ferrous Metals

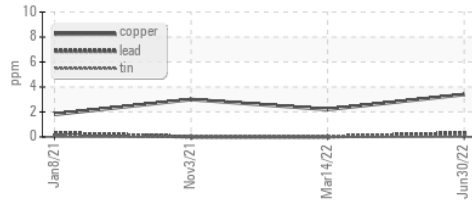


Viscosity @ 40°C

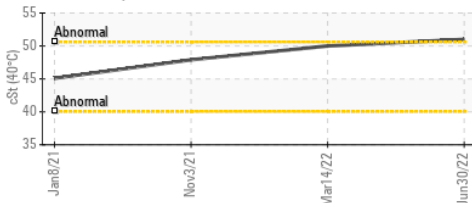

▲ Particle Count

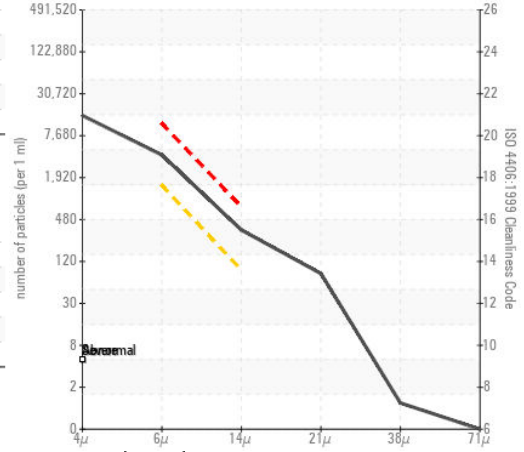

Acid Number

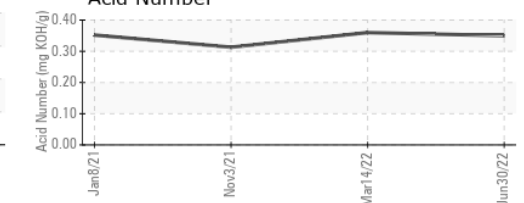

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP40620 **Received** : 05 Jul 2022
Lab Number : 05584188 **Diagnosed** : 07 Jul 2022
Unique Number : 10038614 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

AMAZON GSO1
 1656 OLD GREENSBORO RD
 KERNERSVILLE, NC
 US 27284
 Contact: B. LANCRON
 blancron@amazon.com

T:
F: