




PROBLEM SUMMARY


Sample Rating Trend

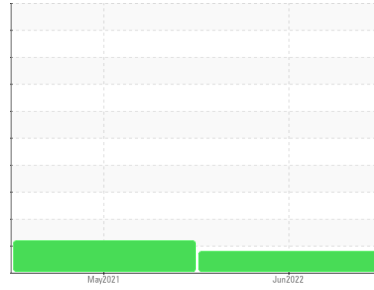

Machine Id
KAESER 4239665
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

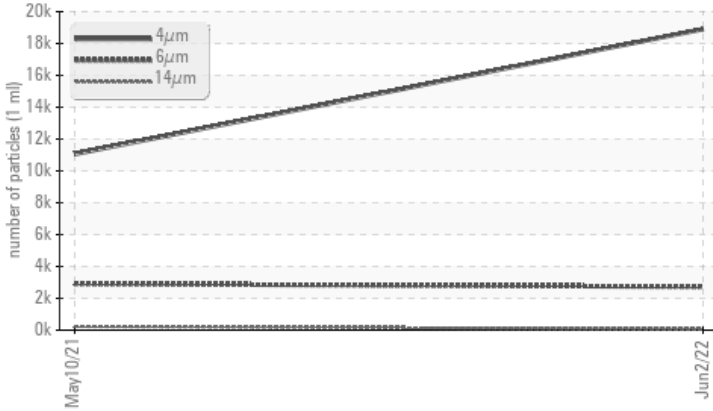

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 2728	▲ 2908	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/13	▲ 19/15	---

Customer Id: HOOANN
 Sample No.: KCP40631
 Lab Number: 05584191
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

10 May 2021 Diag: Angela Borella

ISO




Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

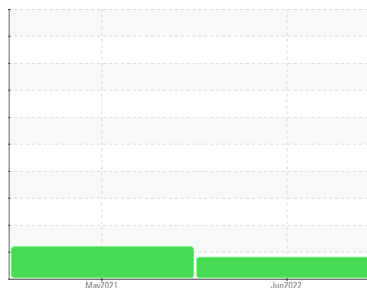

ISO



Machine Id
KAESER 4239665

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP40631	KCP32230	---
Sample Date	Client Info			02 Jun 2022	10 May 2021	---
Machine Age	hrs	Client Info		53530	44381	---
Oil Age	hrs	Client Info		2517	3276	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	<1	---
Aluminum	ppm	ASTM D5185m	>10	4	0	---
Lead	ppm	ASTM D5185m	>10	<1	0	---
Copper	ppm	ASTM D5185m	>50	2	2	---
Tin	ppm	ASTM D5185m	>10	<1	<1	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		<1	<1	---
Calcium	ppm	ASTM D5185m		0	0	---
Phosphorus	ppm	ASTM D5185m	500	39	21	---
Zinc	ppm	ASTM D5185m		6	0	---
Sulfur	ppm	ASTM D5185m		1516	1861	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	---
Sodium	ppm	ASTM D5185m		0	0	---
Potassium	ppm	ASTM D5185m	>20	1	0	---
Water	%	ASTM D6304	>0.05	0.008	0.007	---
ppm Water	ppm	ASTM D6304	>500	84.7	75.9	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		18901	11056	---
Particles >6µm		ASTM D7647	>1300	▲ 2728	▲ 2908	---
Particles >14µm		ASTM D7647	>80	62	▲ 233	---
Particles >21µm		ASTM D7647	>20	17	▲ 63	---
Particles >38µm		ASTM D7647	>4	2	2	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/19/13	▲ 19/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.38	0.300	---

OIL ANALYSIS REPORT

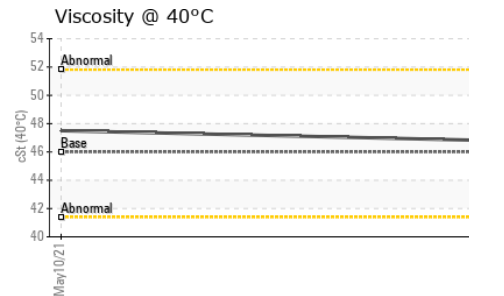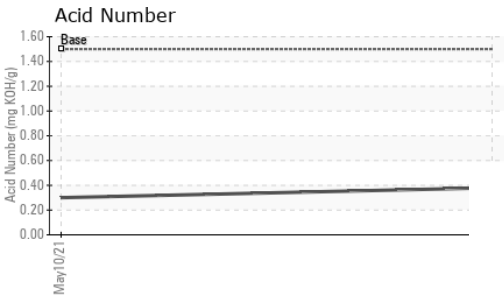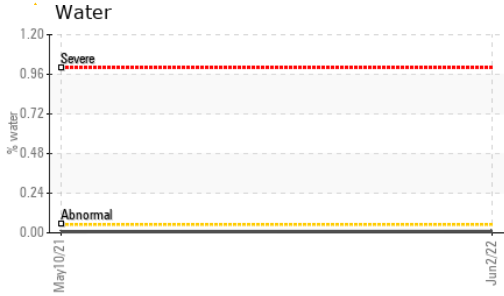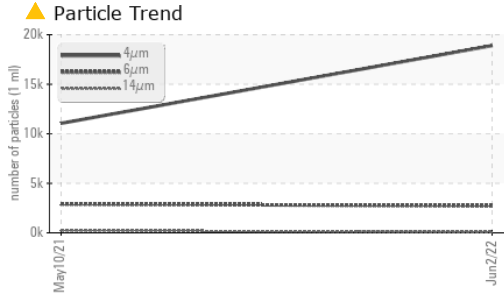






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.8	47.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

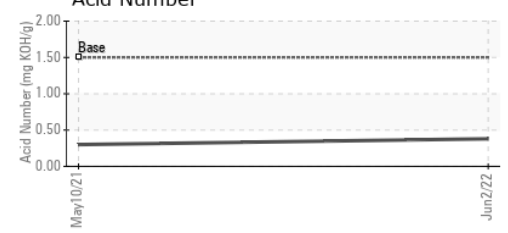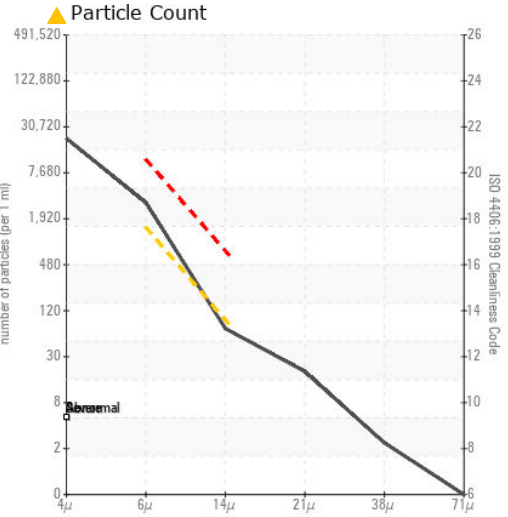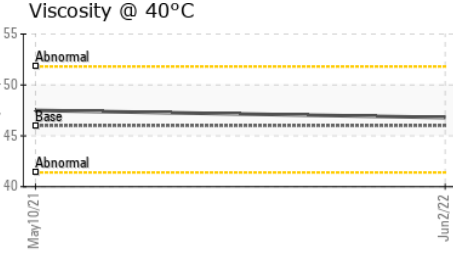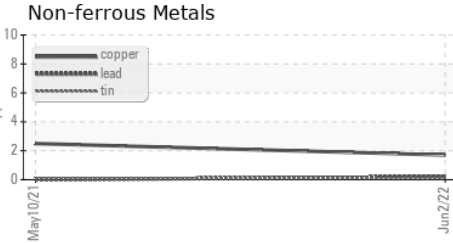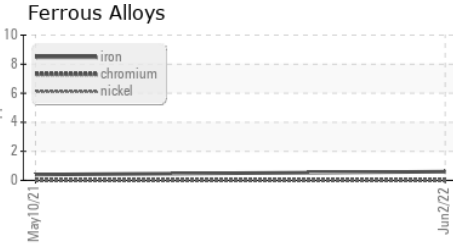

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP40631 **Received** : 05 Jul 2022
Lab Number : 05584191 **Diagnosed** : 07 Jul 2022
Unique Number : 10038617 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

HOOD PACKAGING CORP
 1400 SENTINEL DR
 ANNISTON, AL
 US 36207
 Contact: J HAYWOOD
 JHAYWOOD@HOODPKG.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: