

# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

## **KAESER 7378626**

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2021	Jun2022		
SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP51140	KCP28251	
Sample Date		Client Info		20 Jun 2022	20 Apr 2021	
Machine Age	hrs	Client Info		5020	1663	
Oil Age	hrs	Client Info		3400	1663	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	<1	<1	
Copper	ppm	ASTM D5185m	>50	<1	<1	
Tin	ppm	ASTM D5185m	>10	<1	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	
Barium	ppm	ASTM D5185m	90	10	62	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	76	86	
Calcium	ppm	ASTM D5185m	2	2	3	
Phosphorus	ppm	ASTM D5185m		3	4	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		19190	17020	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		13	13	
Potassium	ppm	ASTM D5185m	>20	6	15	
Water	%	ASTM D6304	>0.05	0.041	0.030	
ppm Water	ppm	ASTM D6304	>500	410.9	303.8	
FLUID CLEANLINE	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		690	3214	
Particles >6µm		ASTM D7647	>1300	119	798	
Particles >14μm		ASTM D7647	>80	20	<u>116</u>	
Particles >21μm		ASTM D7647	>20	6	29	
Particles >38µm		ASTM D7647	>4	0	2	
Particles >71μm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/14/11	17/14	
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2



## **OIL ANALYSIS REPORT**

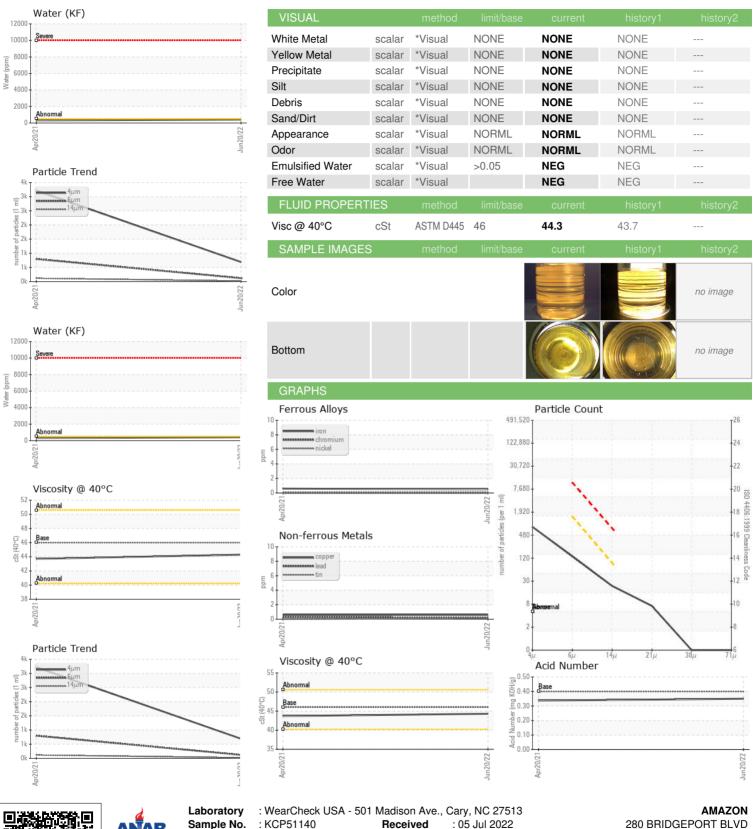





Certificate 12367

Sample No.

Lab Number

: KCP51140 : 05584210 Unique Number : 10038636

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

Received : 05 Jul 2022 **Tested** Diagnosed

: 07 Jul 2022

: 07 Jul 2022 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

NEWNAN, GA US 30263 Contact: A. RIOMATH

ariomath@mazon.com T:

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Report Id: AMANEWGA [WUSCAR] 05584210 (Generated: 04/09/2024 09:17:49) Rev: 1

F: