


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



7435221 (S/N 1122)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun2022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	Client Info	mmusacc		KC96410	motory
Sample Number Sample Date		Client Info		KC85515 28 Jun 2022	06 Dec 2021	
Machine Age	bro	Client Info		4641	3128	
	hrs hrs	Client Info		-	1869	
Oil Age	IIIS	Client Info		1520 Changed		
Oil Changed Sample Status		Client inio		Changed NORMAL	Not Changd NORMAL	
•		un nation of	lineit/le e e e			
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	8	4	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		2	0	
Barium	ppm	ASTM D5185m	90	<1	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	11	37	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		6	5	
Zinc	ppm	ASTM D5185m		48	30	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1 15	
Sodium	ppm	ASTM D5185m	- 20	3		
Potassium	ppm	ASTM D5185m		5	6	
Water ppm Water	%	ASTM D6304 ASTM D6304	>0.05 >500	0.015 158.9	0.008 84.5	
• •	ppm					
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	1000	999	2490	
Particles >6µm		ASTM D7647	>1300	246	518	
Particles >14µm		ASTM D7647	>80	18	19	
Particles >21µm		ASTM D7647	>20	5	4	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>17/13	15/11	16/11	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A a lal Niconala au (ANI)	ma 1/011/-	ACTM DOGAE	0.4	0.26	0.220	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.330

0.36



OIL ANALYSIS REPORT

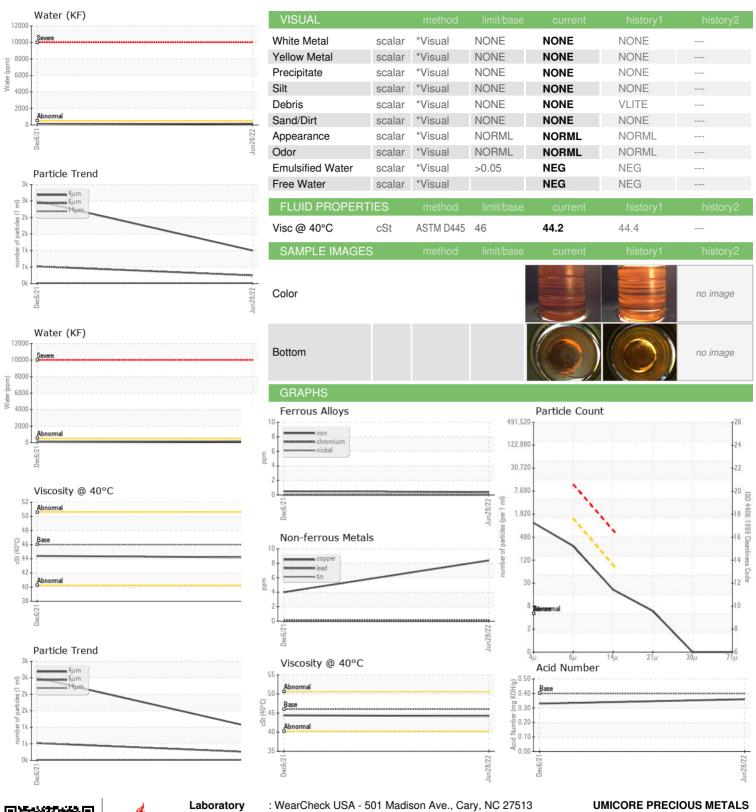





Certificate L2367

Sample No. Lab Number **Unique Number**

: KC85515 : 05585112 : 10039538 Test Package : IND 2

: 06 Jul 2022 Received Diagnosed : 07 Jul 2022 Diagnostician : Doug Bogart

1305 MAIN PARKWAY CATOOSA, OK US 74015

Contact: DAVID JOHNSON david.johnson@am.umicore.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: