

OIL ANALYSIS REPORT

Sample Rating Trend

Juff021 Junf022

NORMAL



Machine Id **6848247 (S/N 1006)**

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jul2021	Jun2022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
		Client Info		KC103257	KC98407	
Sample Number Sample Date		Client Info		22 Jun 2022	06 Jul 2021	
Machine Age	hrs	Client Info		2387	1525	
Oil Age	hrs	Client Info		872	1525	
Oil Changed	1115	Client Info		Changed	Changed	
Sample Status		Ciletit IIIIO		NORMAL	NORMAL	
WEAR METALS		method	limit/base			
				current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	<1	2	
Tin	ppm	ASTM D5185m	>10	0	<1	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		2	<1	
Barium	ppm	ASTM D5185m	90	14	<1	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	69	53	
Calcium	ppm	ASTM D5185m	2	<1	0	
Phosphorus	ppm	ASTM D5185m		1	5	
Zinc	ppm	ASTM D5185m		3	0	
CONTAMINANTS		method	limit/base	current	history1	history2
						1113101 y 2
Silicon	ppm	ASTM D5185m	>25	0	0	
Sodium	ppm	ASTM D5185m		13	11	
Potassium	ppm	ASTM D5185m		3	10	
Water	%	ASTM D6304	>0.05	0.031	0.034	
ppm Water	ppm	ASTM D6304	>500	316.7	344.0	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		513	5458	
Particles >6µm		ASTM D7647	>1300	103	1093	
Particles >14μm		ASTM D7647	>80	5	39	
Particles >21µm		ASTM D7647	>20	1	4	
Particles >38μm		ASTM D7647	>4	0	0	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/14/10	17/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A siel Nivershau (ANI)	I/OII/-	ACTM DOOM	0.4	0.26	0.000	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.380

0.36



OIL ANALYSIS REPORT

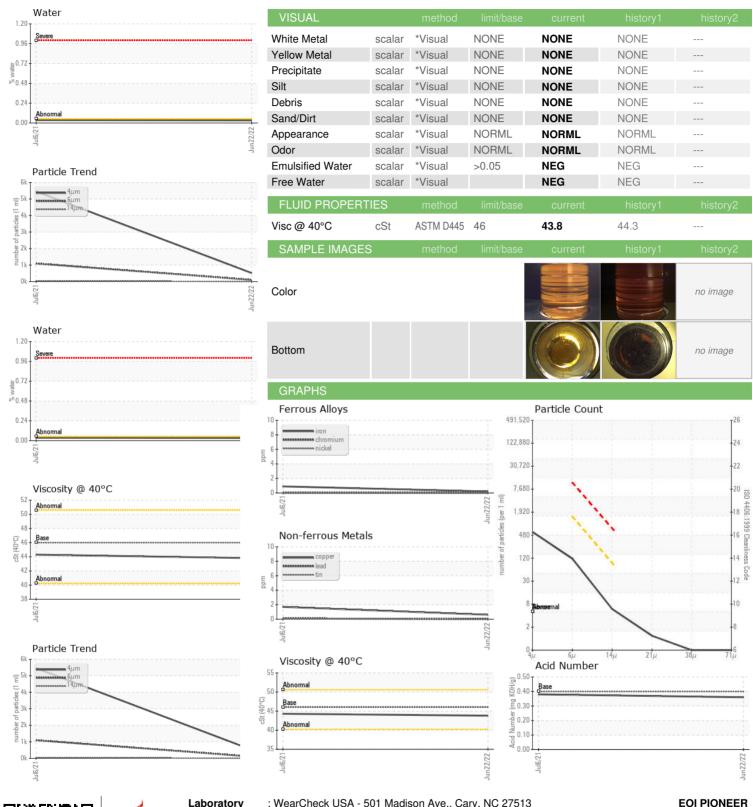





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** Test Package

: KC103257 +05585977: 10045424 : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 07 Jul 2022 Diagnosed : 08 Jul 2022

: Angela Borella Diagnostician

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

EOI PIONEER 110 RESEARCH PKWY DUNDEE, MI

US 48131

Contact: Service Manager

T: F: