

PROBLEM SUMMARY

Sa

Sample Rating Trend


ISO

 $^{\text{Machine Id}}_{6865965} \text{ (S/N 1023)}$

Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

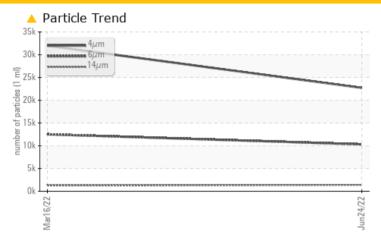

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status			ABNORMAL	ABNORMAL						
Particles >6µm	ASTM D7647	>1300	<u> </u>	<u>12513</u>						
Particles >14μm	ASTM D7647	>80	1389	<u>1260</u>						
Particles >21µm	ASTM D7647	>20	412	<u>▲</u> 372						
Particles >38μm	ASTM D7647	>4	<u> </u>	<u>^</u> 20						
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u>22/21/18</u>	<u>^</u> 21/17						

Customer Id: GRAGREKCP Sample No.: KCP02112 Lab Number: 05586808 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

16 Mar 2022 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

T Sample



ISO

Machine Id

6865965 (S/N 1023)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Mar2022	Jun 2 022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP02112	KCP44665	
Sample Date		Client Info		24 Jun 2022	16 Mar 2022	
Machine Age	hrs	Client Info		10734	9555	
Oil Age	hrs	Client Info		3285	2106	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	1	5	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		3	2	
Barium	ppm	ASTM D5185m	90	92	82	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	87	91	
Calcium	ppm	ASTM D5185m	2	3	2	
Phosphorus	ppm	ASTM D5185m		<1	2	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		19647	16034	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		11	10	
Potassium	ppm	ASTM D5185m	>20	0	0	
Water	%	ASTM D6304	>0.05	0.033	0.029	
ppm Water	ppm	ASTM D6304	>500	339.8	293.1	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		22714	31964	
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u>12513</u>	
Particles >14μm		ASTM D7647	>80	1389	<u> </u>	
Particles >21µm		ASTM D7647	>20	<u>412</u>	▲ 372	
Particles >38μm		ASTM D7647	>4	<u> </u>	2 0	
Particles >71μm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/18</u>	<u>^</u> 21/17	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A : INI (AND	1/011/	4 OT1 4 D00 45	0.4	0.20	0.00	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.38

0.32



OIL ANALYSIS REPORT

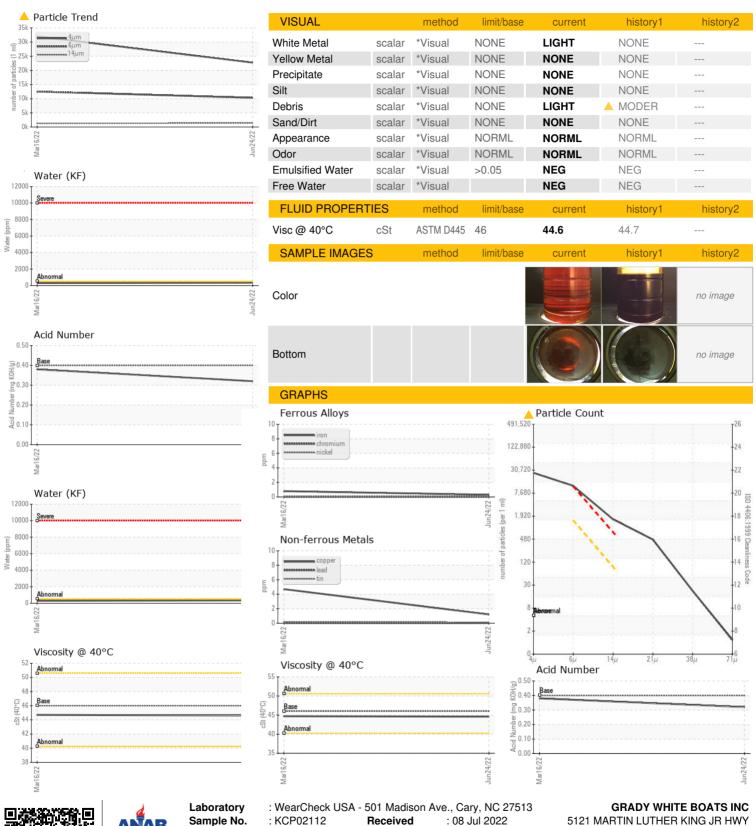





Certificate L2367

Sample No. Lab Number **Unique Number**

: KCP02112 : 05586808

: 10046255

Received Diagnosed

: 11 Jul 2022 Diagnostician : Doug Bogart

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

5121 MARTIN LUTHER KING JR HWY

GREENVILLE, NC US 27834

Contact: J. TYSON

jtyson@gradywhite.com

T: F:

Contact/Location: J. TYSON - GRAGREKCP