




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

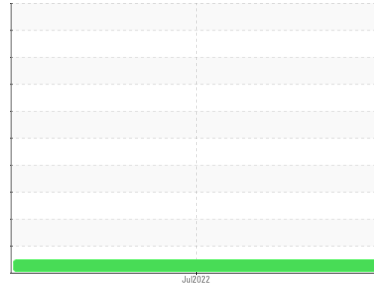

Area
[73048525]
 Machine Id
KAESER CSV 100 1913534 (S/N 1097)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCP40579	---	---
Sample Date	Client Info	01 Jul 2022	---	---
Machine Age	hrs Client Info	31778	---	---
Oil Age	hrs Client Info	2500	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		NORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	2	---	---
Chromium ppm ASTM D5185m	>10	0	---	---
Nickel ppm ASTM D5185m	>3	0	---	---
Titanium ppm ASTM D5185m	>3	0	---	---
Silver ppm ASTM D5185m	>2	0	---	---
Aluminum ppm ASTM D5185m	>10	1	---	---
Lead ppm ASTM D5185m	>10	<1	---	---
Copper ppm ASTM D5185m	>50	2	---	---
Tin ppm ASTM D5185m	>10	<1	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	---	---
Barium ppm ASTM D5185m	90	99	---	---
Molybdenum ppm ASTM D5185m		0	---	---
Manganese ppm ASTM D5185m		0	---	---
Magnesium ppm ASTM D5185m	90	100	---	---
Calcium ppm ASTM D5185m	2	4	---	---
Phosphorus ppm ASTM D5185m		16	---	---
Zinc ppm ASTM D5185m		6	---	---
Sulfur ppm ASTM D5185m		22806	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	1	---	---
Sodium ppm ASTM D5185m		13	---	---
Potassium ppm ASTM D5185m	>20	3	---	---
Water % ASTM D6304	>0.05	0.033	---	---
ppm Water ppm ASTM D6304	>500	330.6	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		1428	---	---
Particles >6µm ASTM D7647	>1300	278	---	---
Particles >14µm ASTM D7647	>80	9	---	---
Particles >21µm ASTM D7647	>20	4	---	---
Particles >38µm ASTM D7647	>4	0	---	---
Particles >71µm ASTM D7647	>3	0	---	---
Oil Cleanliness ISO 4406 (c)	>--/17/13	18/15/10	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	0.4	0.39	---	---

OIL ANALYSIS REPORT

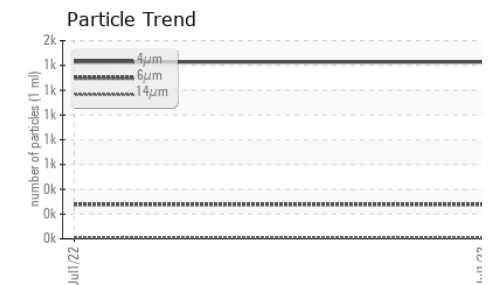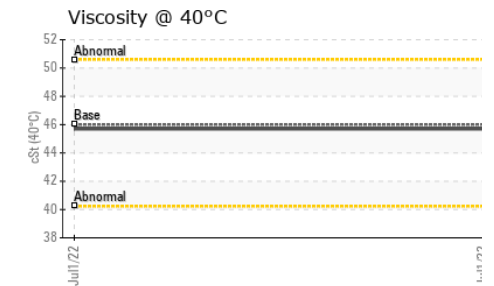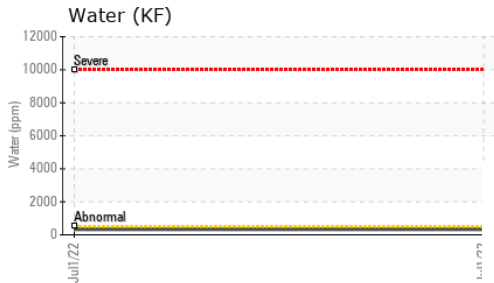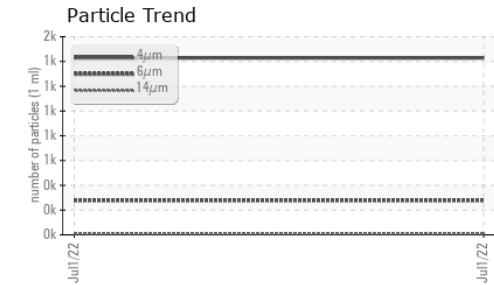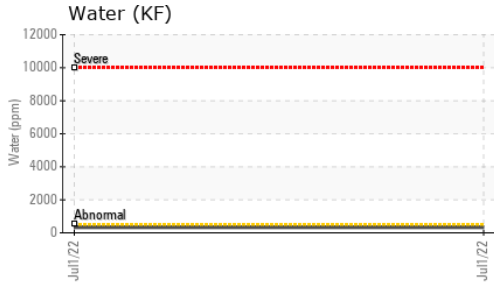





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

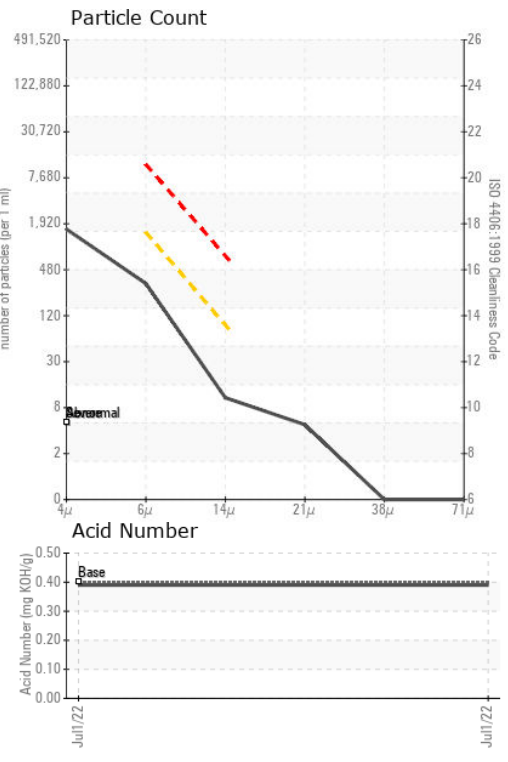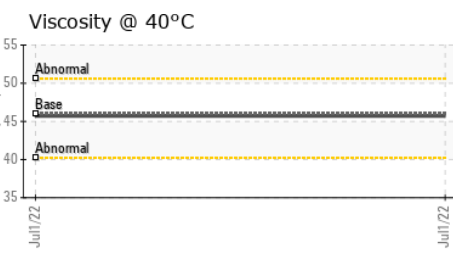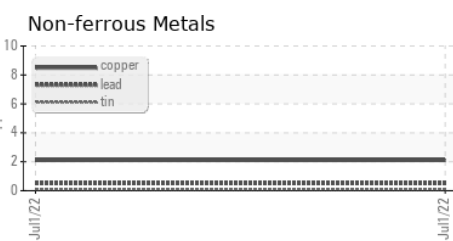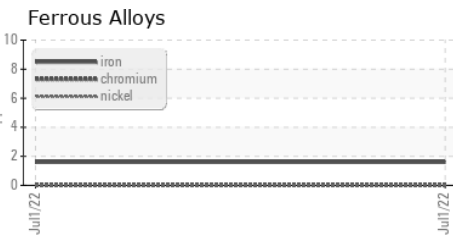

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP40579 **Received** : 11 Jul 2022
Lab Number : **05588212** **Tested** : 12 Jul 2022
Unique Number : 10047659 **Diagnosed** : 13 Jul 2022 - Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CALIFORNIA DOOR CORPORATION
 1800 ABBOTT ST
 SALINAS, CA
 US 93901
 Contact: M. SOUZA
 msouza@caldoor.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)