


PROBLEM SUMMARY

Sample Rating Trend



ISO

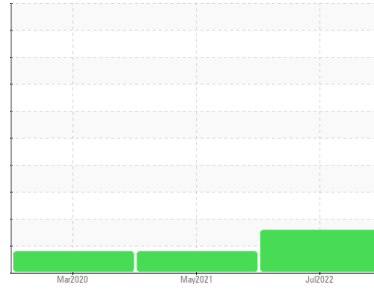


Machine Id
5987578 (S/N 1354)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

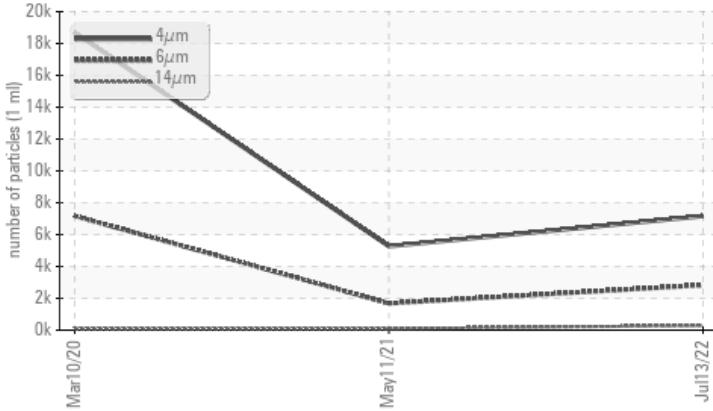

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 2830	▲ 1680	▲ 7168
Particles >14µm	ASTM D7647	>80	▲ 289	▲ 96	▲ 81
Particles >21µm	ASTM D7647	>20	▲ 53	15	9
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/15	▲ 18/14	▲ 20/14

Customer Id: MISFUL
Sample No.: KCP51542
Lab Number: 05594286
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

11 May 2021 Diag: Jonathan Hester

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



10 Mar 2020 Diag: Doug Bogart

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



OIL ANALYSIS REPORT

Sample Rating Trend

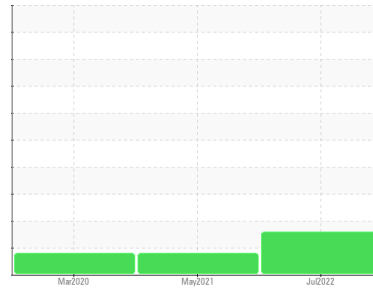

ISO



Machine Id
5987578 (S/N 1354)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCP51542	KCP33383	KCP25448
Sample Date	Client Info		13 Jul 2022	11 May 2021	10 Mar 2020
Machine Age	hrs	Client Info	5739	5141	3306
Oil Age	hrs	Client Info	600	1900	3306
Oil Changed	Client Info		Changed	Not Changd	Changed
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	<1	0	0
Lead	ppm	ASTM D5185m >10	<1	<1	<1
Copper	ppm	ASTM D5185m >50	9	2	17
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m 90	0	23	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 90	18	10	16
Calcium	ppm	ASTM D5185m 2	0	0	<1
Phosphorus	ppm	ASTM D5185m	3	0	2
Zinc	ppm	ASTM D5185m	17	0	21
Sulfur	ppm	ASTM D5185m	18008	18063	14658

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	0	<1
Sodium	ppm	ASTM D5185m	6	16	5
Potassium	ppm	ASTM D5185m >20	2	2	<1
Water	%	ASTM D6304 >0.05	0.020	0.028	0.011
ppm Water	ppm	ASTM D6304 >500	206.6	284.2	114.1






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		7163	5269	18697
Particles >6µm	ASTM D7647 >1300		▲ 2830	▲ 1680	▲ 7168
Particles >14µm	ASTM D7647 >80		▲ 289	▲ 96	▲ 81
Particles >21µm	ASTM D7647 >20		▲ 53	15	9
Particles >38µm	ASTM D7647 >4		3	0	3
Particles >71µm	ASTM D7647 >3		0	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 20/19/15	▲ 18/14	▲ 20/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.35	0.398	0.360


OIL ANALYSIS REPORT

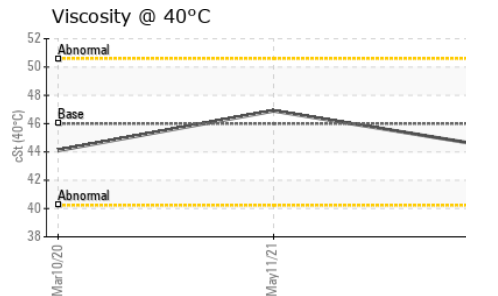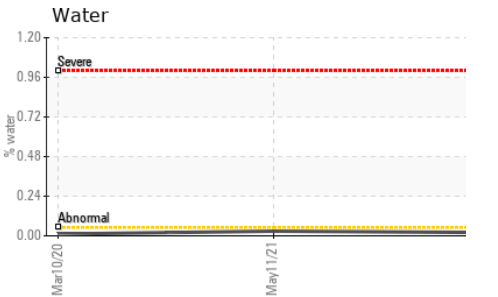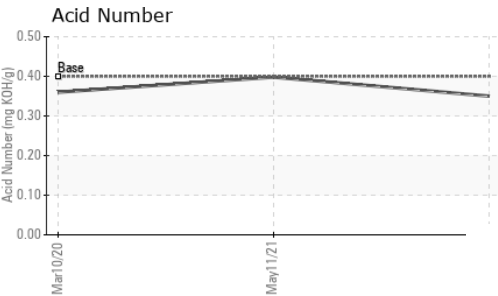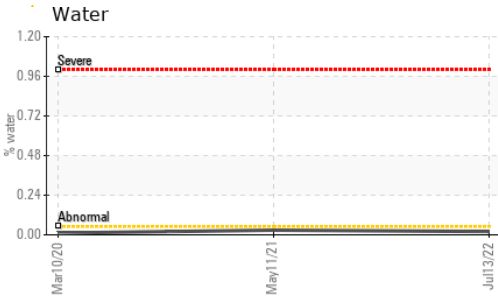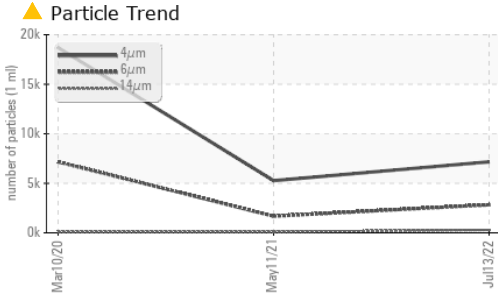






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.4	46.9	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

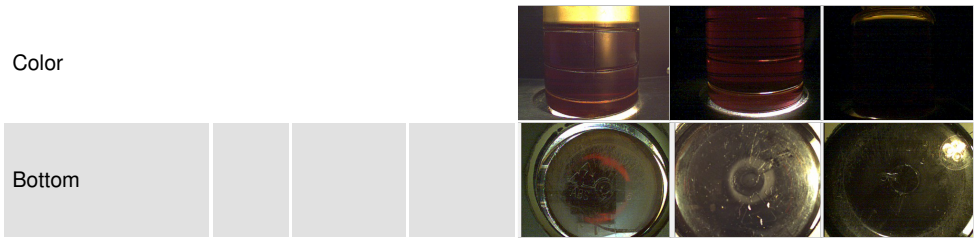

GRAPHS

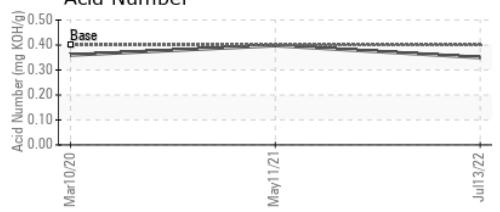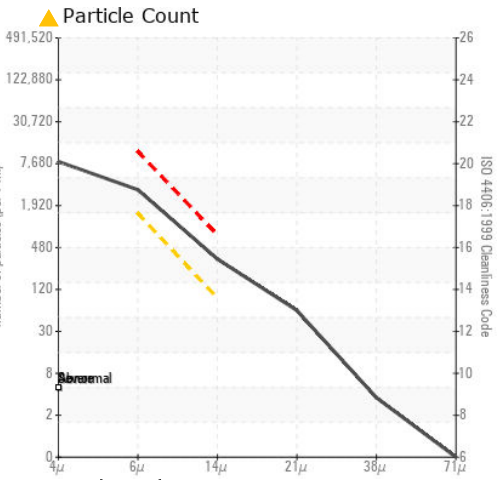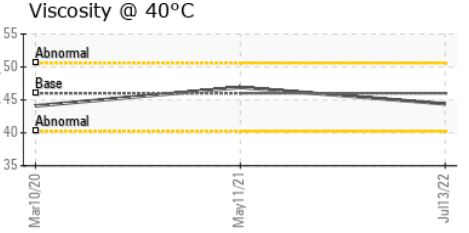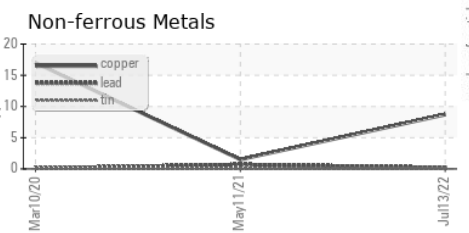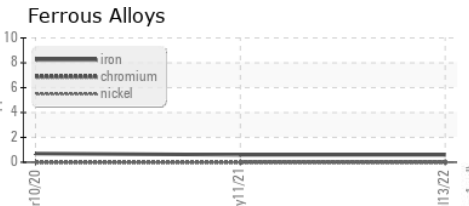

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP51542 **Received** : 18 Jul 2022
Lab Number : 05594286 **Diagnosed** : 19 Jul 2022
Unique Number : 10058766 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MISSOURI FABRICATORS
 3200 CO RD 257
 FULTON, MO
 US 65251
 Contact: GERALD S
 geraldso@ccimofab.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)