




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**ROTO XTEND**  
 Machine Id  
**ATLAS COPCO AIP626698 - MARK WEST C-2911 (S/N API626698)**  
 Component  
**Compressor**

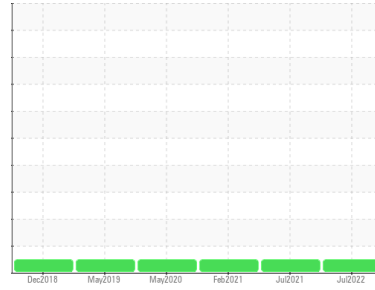

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH05599590</b>	UCH05307393	UCH05195437
Sample Date	Client Info		<b>15 Jul 2022</b>	14 Jul 2021	26 Feb 2021
Machine Age	hrs	Client Info	<b>26267</b>	21198	17900
Oil Age	hrs	Client Info	<b>7867</b>	2798	6846
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Not Changd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>1</b>	1	4
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185m >25	<b>4</b>	0	0
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	1
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	13
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185m	<b>0</b>	0	1
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>3</b>	3	6
Phosphorus	ppm	ASTM D5185m	<b>14</b>	17	19
Zinc	ppm	ASTM D5185m	<b>95</b>	62	104
Sulfur	ppm	ASTM D5185m	<b>22</b>	19	53

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>11</b>	7	16
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	2

## FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.14	<b>0.80</b>	0.634	0.912

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>VLITE</b>	NONE	LIGHT
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG




# OIL ANALYSIS REPORT



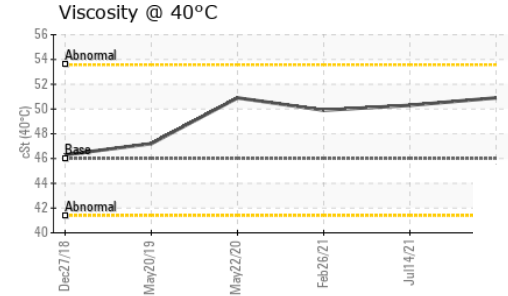
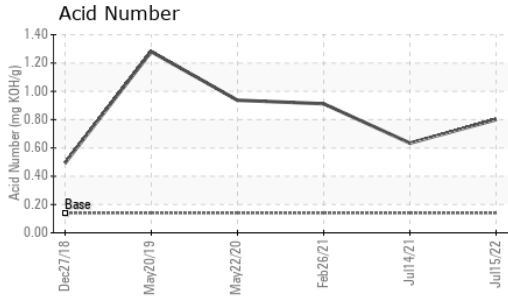


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	<b>50.9</b>	50.3	49.9

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

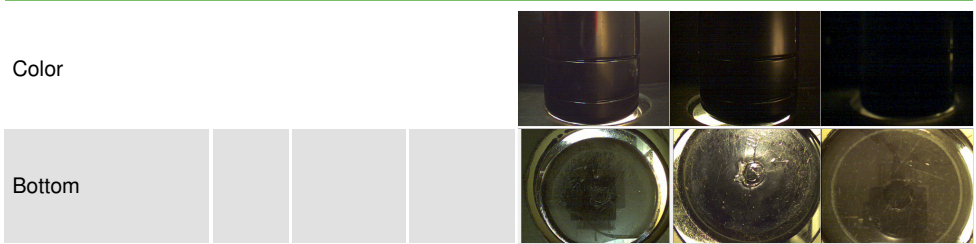

## GRAPHS

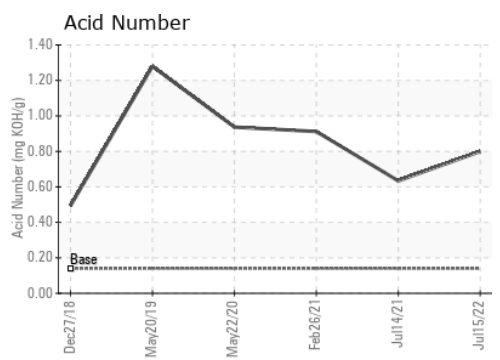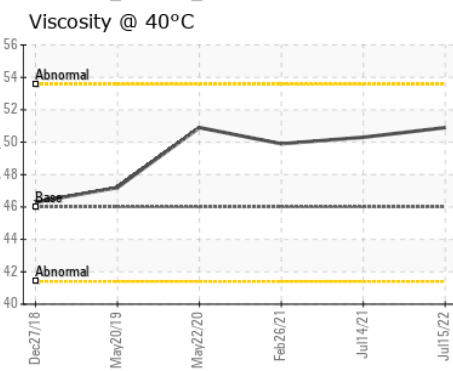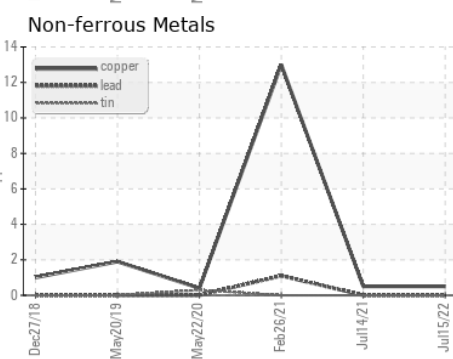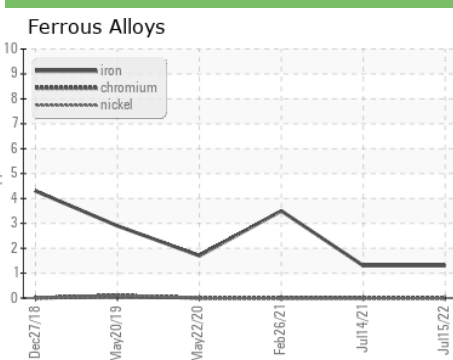

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05599590 **Received** : 25 Jul 2022  
**Lab Number** : 05599590 **Diagnosed** : 26 Jul 2022  
**Unique Number** : 10064070 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**TOTAL EQUIPMENT COMPANY**  
 200 SMILEY DR  
 SAINT ALBANS, WV  
 US 25177  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: