

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

5459155 (S/N 1206) Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP49514	KCP36451	
Sample Date		Client Info		24 Jul 2022	24 Sep 2021	
Machine Age	hrs	Client Info		49670	42546	
Oil Age	hrs	Client Info		7000	15075	
Oil Changed		Client Info		Changed	N/A	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	<1	<1	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	10	15	
Tin	ppm	ASTM D5185m	>10	0	0	
Antimony	ppm	ASTM D5185m	210		0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium				0	0	
Gauiniuni	ppm	ASTM D5185m		U	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	0	0	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		7	<1	
Zinc	ppm	ASTM D5185m		0	4	
Sulfur	ppm	ASTM D5185m		20063	14884	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	2	3	
	ppm		>23		0	
Sodium	ppm	ASTM D5185m	× 20	<1		
Potassium	ppm	ASTM D5185m	>20	0	0	
Water	%	ASTM D6304	>0.05	0.009	0.013	
ppm Water	ppm	ASTM D6304	>500	97.2	130.2	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10584		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	3		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 21/19/16		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	ma KOH/a	ASTM D8045	0.4	0.45	0.391	
2-10-17) Rov: 1	Contact/Location: IAMES 2 - CALSANC					

Report Id: CALSANCAL [WUSCAR] 05600155 (Generated: 01/19/2024 08:19:47) Rev: 1

0.391 Contact/Location: JAMES ? - CALSANCAL

Page 1 of 2



Water

Water (

4000

200

52

50

4

4

4(

3

Ĥ

(D. 46


cSt (


Abnorma n Pn 74

Viscosity @ 40°C

Built for a lifetime

OIL ANALYSIS REPORT

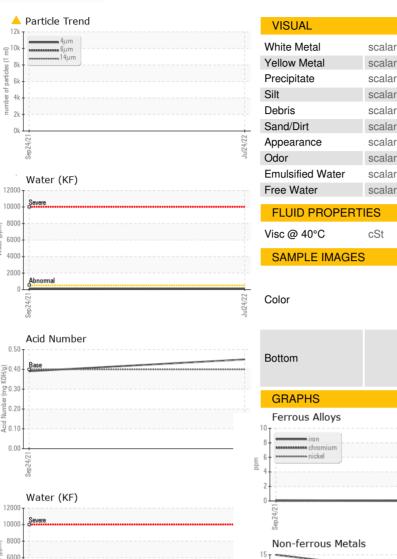

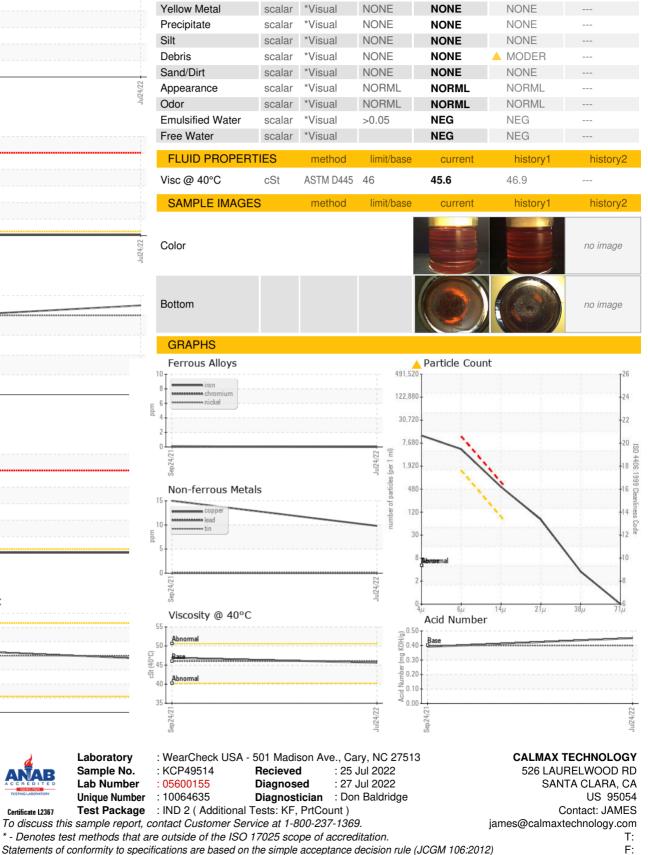

limit/base

NONE

current

NONE

method

*Visual

history1

NONE

history2

Certificate L2367