


**OIL ANALYSIS REPORT** 

6138071 (S/N 1034)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

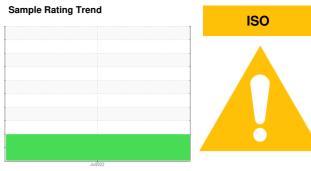

# **DIAGNOSIS**

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jul2022		
SAMPLE INFORT	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP51668		
Sample Date		Client Info		18 Jul 2022		
Machine Age	hrs	Client Info		12775		
Oil Age	hrs	Client Info		9000		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	14		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
	ррпп		1114-0	-		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	0		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	3		
Zinc	ppm	ASTM D5185m	0	74		
Sulfur	ppm	ASTM D5185m	23500	19974		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.007		
opm Water	ppm	ASTM D6304	>500	75.2		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		13828		
Particles >6µm		ASTM D7647	>1300	<b>4813</b>		
Particles >14μm		ASTM D7647	>80	<b>643</b>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	<u>^</u> 24		
Particles >71μm		ASTM D7647	>3	2		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/17		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	та КОЦ/а	ACTM DOME	1.0	0.42		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.42



# **OIL ANALYSIS REPORT**

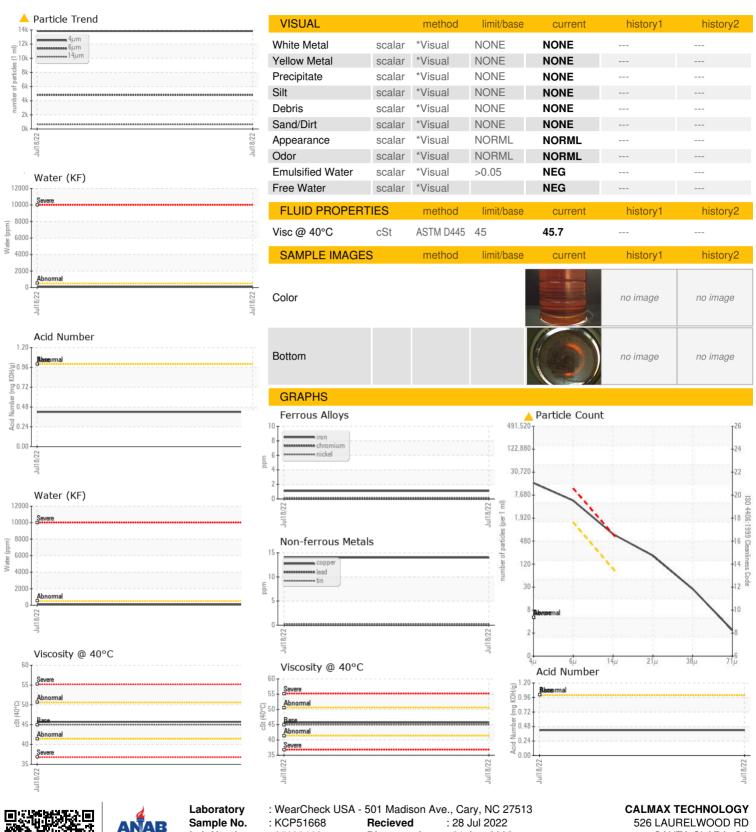





Lab Number **Unique Number** 

: 05603463

: 10072944

Diagnosed

: 01 Aug 2022

Diagnostician : Angela Borella

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

SANTA CLARA, CA

US 95054 Contact: JAMES

james@calmaxtechnology.com

T:

F:

Contact/Location: JAMES ? - CALSANCAL