




# OIL ANALYSIS REPORT

Sample Rating Trend

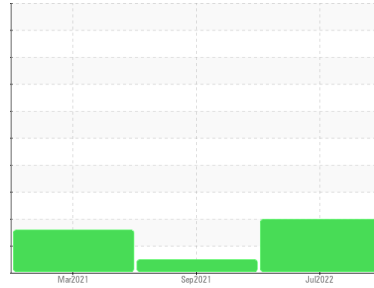

ISO



Area  
**[73059605]**  
 Machine Id  
**1438848 (S/N 6100709)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCP40649</b>	KCP36609	KCP11020
Sample Date	Client Info		<b>26 Jul 2022</b>	17 Sep 2021	30 Mar 2021
Machine Age	hrs	Client Info	<b>54579</b>	51342	49515
Oil Age	hrs	Client Info	<b>3000</b>	2000	3973
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>ABNORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	2
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>2</b>	2	5
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	<1	<1
Barium	ppm	ASTM D5185m 90	<b>11</b>	16	<1
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 100	<b>41</b>	39	<1
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m 0	<b>3</b>	5	24
Zinc	ppm	ASTM D5185m 0	<b>9</b>	0	0
Sulfur	ppm	ASTM D5185m 23500	<b>20138</b>	16928	15554

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	3
Sodium	ppm	ASTM D5185m	<b>6</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	0
Water	%	ASTM D6304 >0.05	<b>0.020</b>	0.015	0.006
ppm Water	ppm	ASTM D6304 >500	<b>202.7</b>	155.5	61.9






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>19009</b>	10252	17341
Particles >6µm	ASTM D7647	>1300	<b>▲ 4226</b>	1039	▲ 4585
Particles >14µm	ASTM D7647	>80	<b>▲ 375</b>	21	▲ 456
Particles >21µm	ASTM D7647	>20	<b>▲ 89</b>	3	▲ 116
Particles >38µm	ASTM D7647	>4	<b>▲ 9</b>	0	3
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 21/19/16</b>	17/12	▲ 19/16

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.42</b>	0.394	0.422

# OIL ANALYSIS REPORT

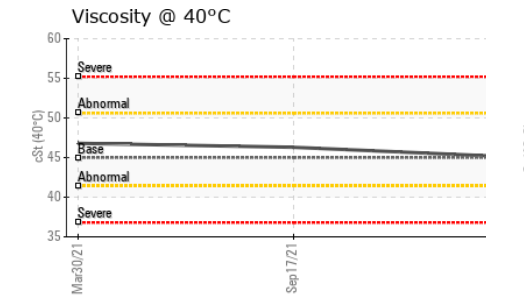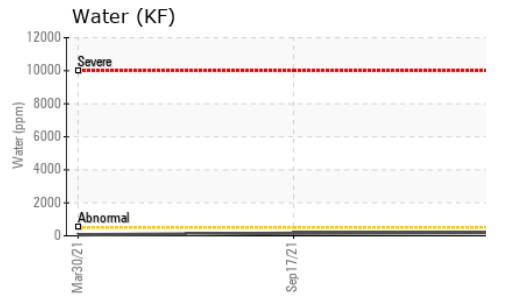
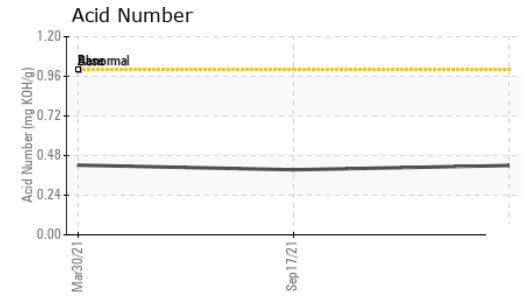
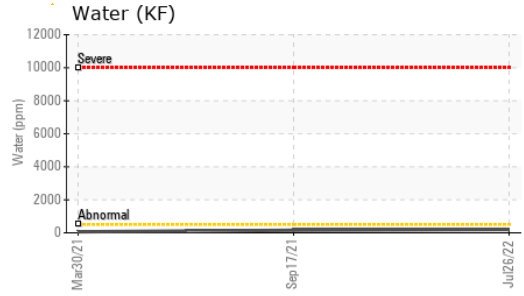
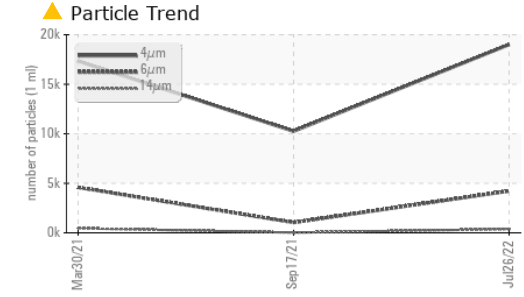


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	45.1	46.3	46.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

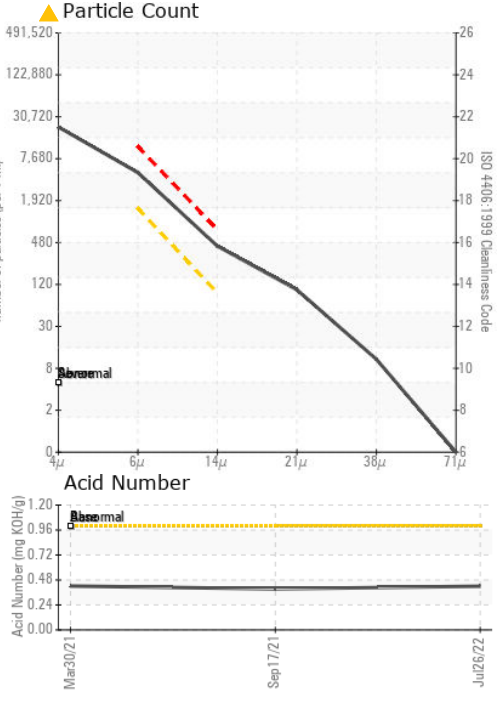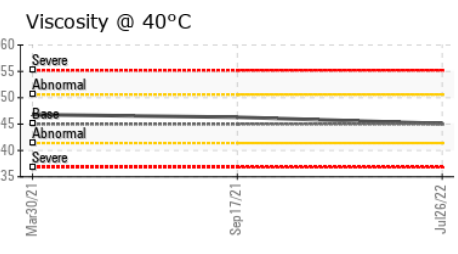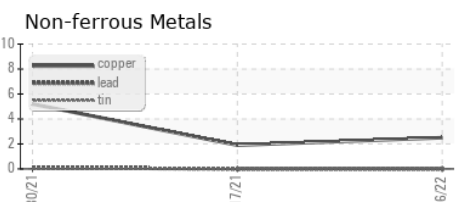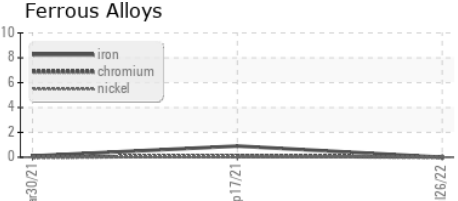

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP40649 **Received** : 29 Jul 2022  
**Lab Number** : 05604489 **Diagnosed** : 01 Aug 2022  
**Unique Number** : 10073970 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**STREAMLINE CIRCUITS**  
 1410 MARTIN AVE  
 SANTA CLARA, CA  
 US 95050  
 Contact: SEAN NEVOLI  
 SEANNEVOLI@SUMMIT-PCB.COM  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)