KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

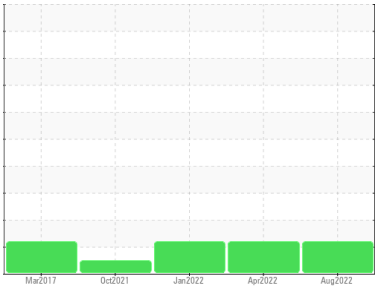

ISO

Machine Id
KAESER SFC 18ST 5859574 (S/N 1015)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of particulates present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KC104533**	KC96217	KC95271
Sample Date		Client Info		**05 Aug 2022**	25 Apr 2022	25 Jan 2022
Machine Age	hrs	Client Info		**18963**	18871	17216
Oil Age	hrs	Client Info		**92**	1824	169
Oil Changed		Client Info		**Not Changd**	Changed	Not Changd
Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	0	<1
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m	>3	**<1**	0	0
Titanium	ppm	ASTM D5185m	>3	**0**	0	0
Silver	ppm	ASTM D5185m	>2	**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	**<1**	0	<1
Lead	ppm	ASTM D5185m	>10	**0**	0	0
Copper	ppm	ASTM D5185m	>50	**<1**	1	<1
Tin	ppm	ASTM D5185m	>10	**<1**	0	<1
Antimony	ppm	ASTM D5185m		**---**	---	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**<1**	0	0
Barium	ppm	ASTM D5185m	90	**19**	0	69
Molybdenum	ppm	ASTM D5185m	0	**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	0	0
Magnesium	ppm	ASTM D5185m	100	**74**	0	80
Calcium	ppm	ASTM D5185m	0	**0**	0	2
Phosphorus	ppm	ASTM D5185m	0	**0**	0	2
Zinc	ppm	ASTM D5185m	0	**2**	0	5

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**3**	2	2
Sodium	ppm	ASTM D5185m		**9**	0	12
Potassium	ppm	ASTM D5185m	>20	**0**	0	0
Water	%	ASTM D6304	>0.05	**0.032**	0.004	0.015
ppm Water	ppm	ASTM D6304	>500	**325.4**	45.5	156.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**9473**	39000	31545
Particles >6µm		ASTM D7647	>1300	▲ **2846**	▲ 12214	▲ 9344
Particles >14µm		ASTM D7647	>80	▲ **129**	▲ 413	▲ 672
Particles >21µm		ASTM D7647	>20	**17**	▲ 31	▲ 99
Particles >38µm		ASTM D7647	>4	**1**	0	2
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>17/13	▲ **19/14**	▲ 21/16	▲ 20/17

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	**0.39**	0.61	0.32

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Particle Trend

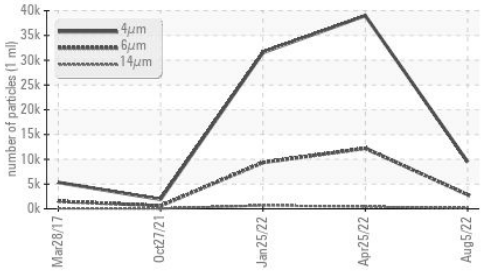

Water (KF)

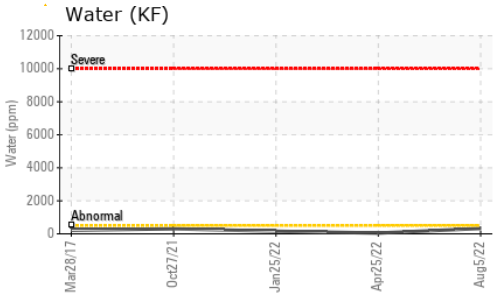

Acid Number

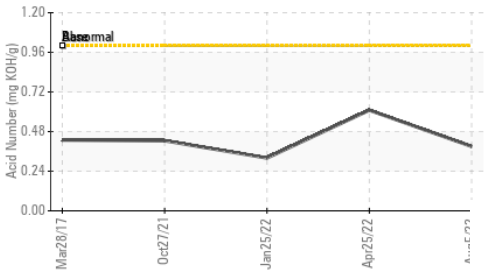

Water (KF)

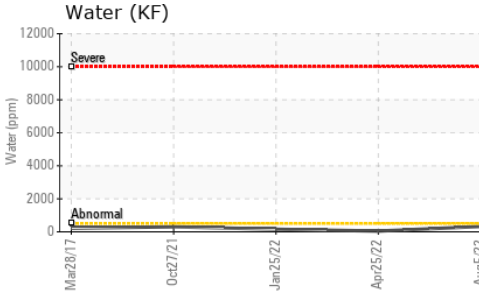

Viscosity @ 40°C

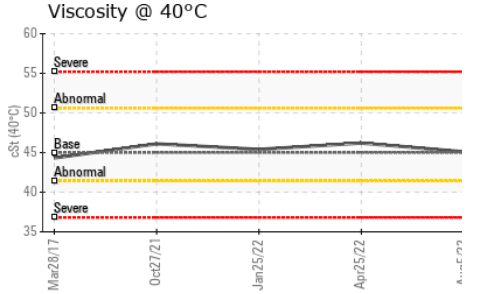

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	**45.1**	46.2	45.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			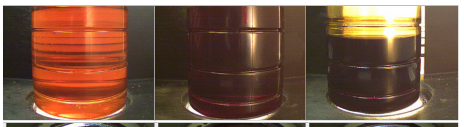		
Bottom			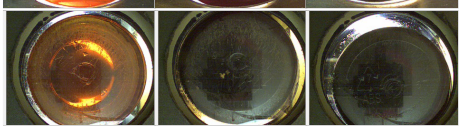		

GRAPHS

Ferrous Alloys

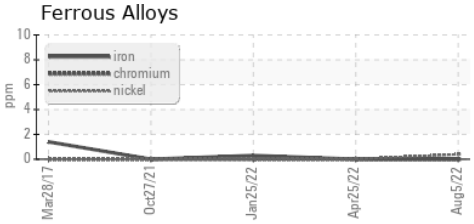

Non-ferrous Metals

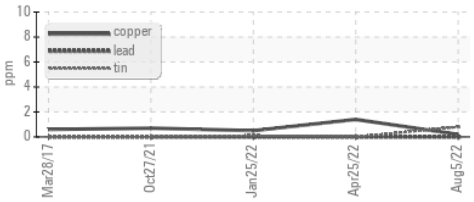

Viscosity @ 40°C

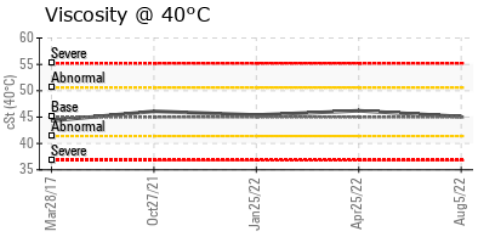

Particle Count

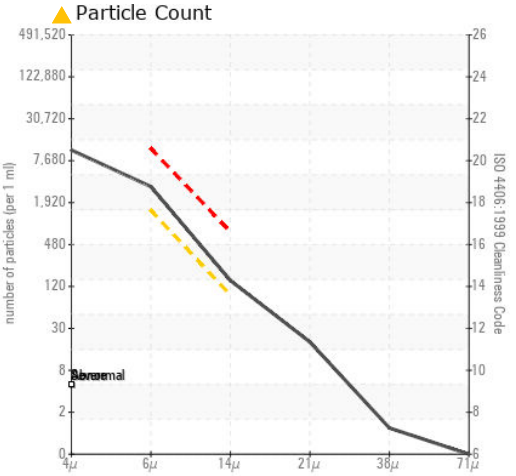

Acid Number

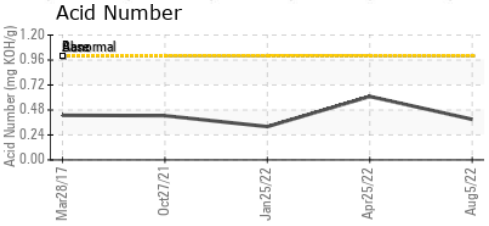

ANAB ACCREDITED ISO/IEC 17025 TESTING LABORATORY
Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC104533
Lab Number : 05616454
Unique Number : 10090948
Test Package : IND 2

Received : 12 Aug 2022
Tested : 15 Aug 2022
Diagnosed : 15 Aug 2022 - Doug Bogart

ALRO STEEL
4787 STATE RD
CUYAHOGA FALLS, OH
US 44223
Contact:
T:
F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)