




PROBLEM SUMMARY

Sample Rating Trend

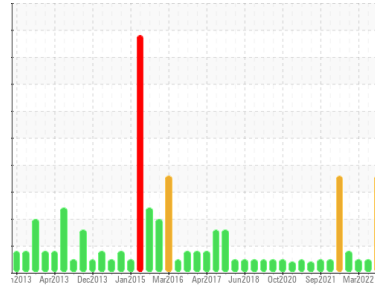


WATER




Area
BLEACH O2
 Machine Id
METSO BX060 POST 02 PRESS NW (S/N 0661-03-02-040-040)
 Component
Bearing
 Fluid
NOT GIVEN (4 GAL)

COMPONENT CONDITION SUMMARY

▲ Ferrous Alloys

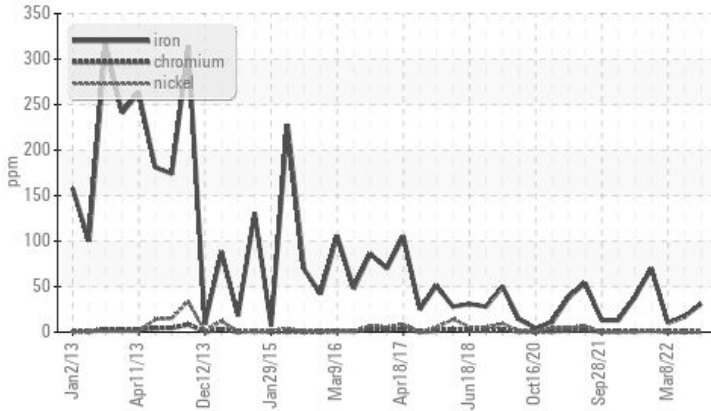

▲ Water

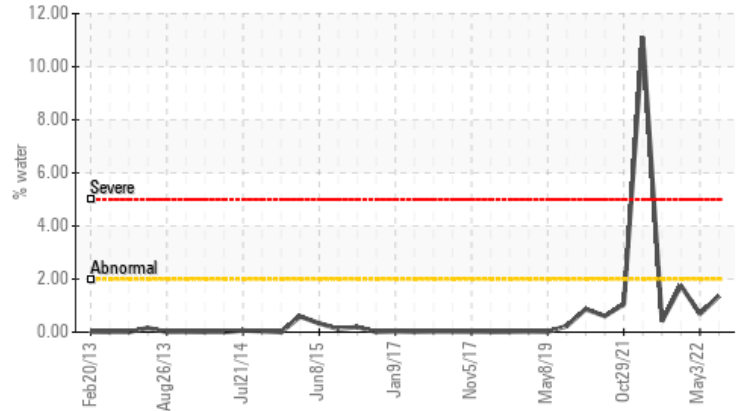

RECOMMENDATION

We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	NORMAL
Iron	ppm	ASTM D5185m	>20	▲ 31	17	10
Water	%	ASTM D6304	>2	▲ 1.36	0.683	1.75
ppm Water	ppm	ASTM D6304		▲ 13600	6830	17500
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT	VLITE
Appearance	scalar	*Visual	NORML	▲ HAZY	HAZY	HAZY
Emulsified Water	scalar	*Visual	>2	▲ 0.2%	0.2%	0.2%

Customer Id: INTRIERP
 Sample No.: WC0676807
 Lab Number: 05617798
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	MISSED	Aug 31 2022	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.
Filter Fluid	MISSED	Aug 31 2022	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.

HISTORICAL DIAGNOSIS

03 May 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 Mar 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



21 Feb 2022 Diag: Jonathan Hester

WEAR



No corrective action is recommended at this time. Resample at the next service interval to monitor. The iron level is abnormal. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

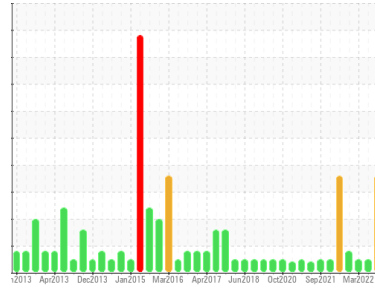

WATER



Area
BLEACH O2
 Machine Id
METSO BX060 POST 02 PRESS NW (S/N 0661-03-02-040-040)
 Component
Bearing
 Fluid
NOT GIVEN (4 GAL)

DIAGNOSIS

Recommendation

We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample at the next service interval to monitor.

Wear

An increase in the iron level is noted. All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0676807	WC0676818	WC0676810
Sample Date	Client Info	29 Jul 2022	03 May 2022	08 Mar 2022
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	▲ 31	17	10
Chromium	ppm	ASTM D5185m >20	<1	<1	<1
Nickel	ppm	ASTM D5185m >20	2	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	1	0	0
Aluminum	ppm	ASTM D5185m >20	1	<1	0
Lead	ppm	ASTM D5185m >20	0	0	0
Copper	ppm	ASTM D5185m >20	<1	<1	<1
Tin	ppm	ASTM D5185m >20	1	<1	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	2	<1	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	0	0	0
Calcium	ppm	ASTM D5185m	5	8	6
Phosphorus	ppm	ASTM D5185m	42	34	51
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	13531	9445	11881

CONTAMINANTS





method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	5	4	4
Sodium	ppm	ASTM D5185m	8	3	2
Potassium	ppm	ASTM D5185m >20	<1	1	<1
Water	%	ASTM D6304 >2	▲ 1.36	0.683	1.75
ppm Water	ppm	ASTM D6304	▲ 13600	6830	17500

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.25	0.30	0.32




OIL ANALYSIS REPORT

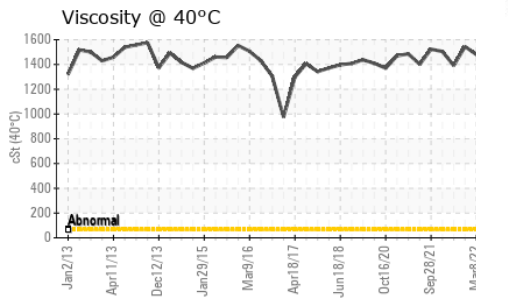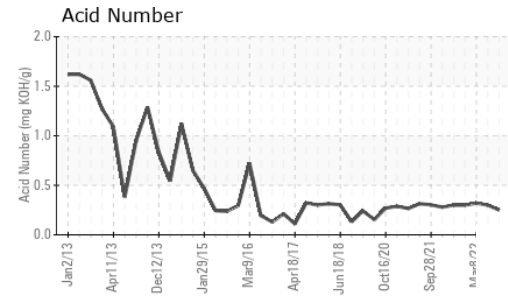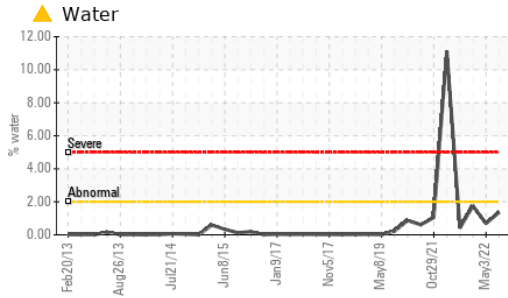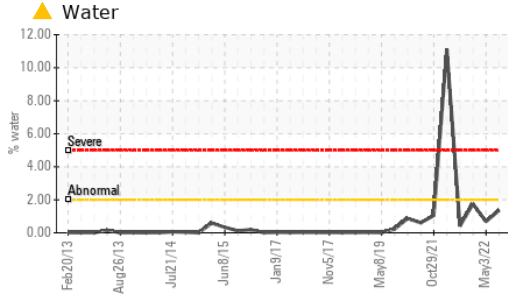





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	▲ HAZY	HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	▲ 0.2%	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	1520	1514	1480

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

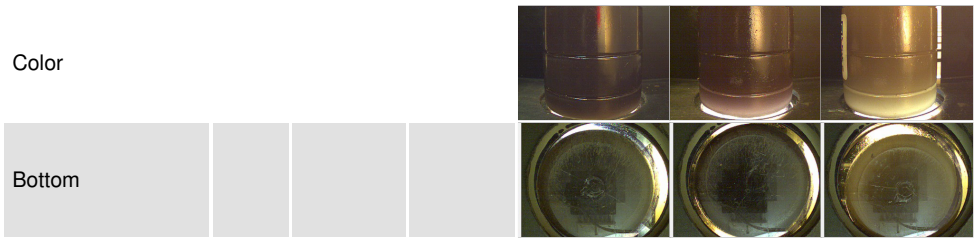

GRAPHS

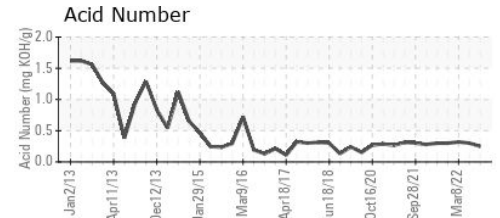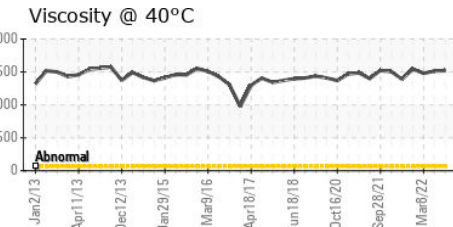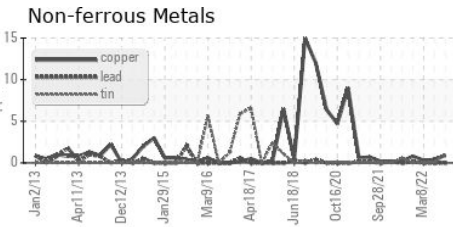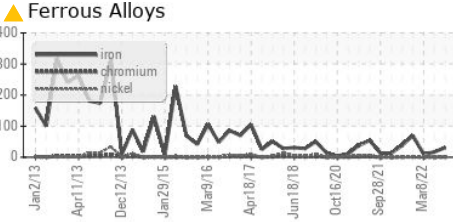

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0676807 Received : 15 Aug 2022
 Lab Number : 05617798 Diagnosed : 16 Aug 2022
 Unique Number : 10097305 Diagnostician : Doug Bogart
 Test Package : IND 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

INTERNATIONAL PAPER

865 JOHN L REGEL RD
 RIEGELWOOD, NC
 US 28456
 Contact: Zach Lizana
 zachary.lizana@ipaper.com
 T: (910)362-4775
 F: