




PROBLEM SUMMARY

Sample Rating Trend

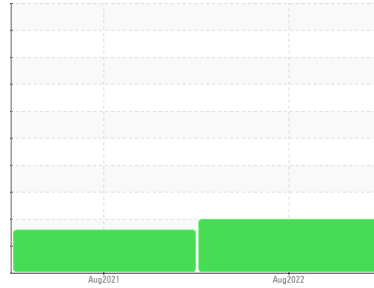

ISO




Machine Id
KAESER 1596183

Component
Compressor
Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

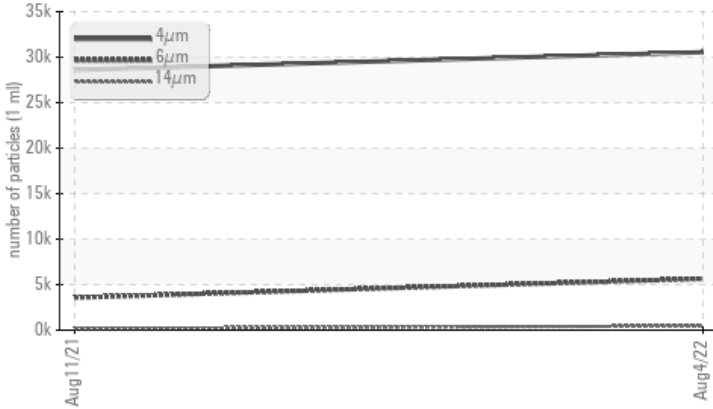

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 5645	▲ 3573	---
Particles >14µm	ASTM D7647	>80	▲ 456	▲ 185	---
Particles >21µm	ASTM D7647	>20	▲ 103	27	---
Particles >38µm	ASTM D7647	>4	▲ 7	2	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/16	▲ 19/15	---

Customer Id: WINGLE
Sample No.: KCP49484
Lab Number: 05619508
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

11 Aug 2021 Diag: Angela Borella

WEAR



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. The aluminum level is abnormal. All other component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

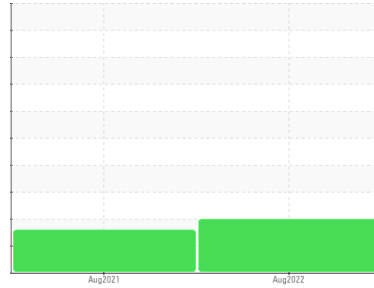

ISO



Machine Id
KAESER 1596183
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP49484	KCP21471	---
Sample Date	Client Info			04 Aug 2022	11 Aug 2021	---
Machine Age	hrs	Client Info		6130	6069	---
Oil Age	hrs	Client Info		61	200	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	3	---
Chromium	ppm	ASTM D5185m	>10	0	<1	---
Nickel	ppm	ASTM D5185m	>3	0	<1	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	<1	0	---
Aluminum	ppm	ASTM D5185m	>10	6	▲ 22	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	<1	0	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1	<1	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m		4	1	---
Calcium	ppm	ASTM D5185m		3	0	---
Phosphorus	ppm	ASTM D5185m	500	487	475	---
Zinc	ppm	ASTM D5185m		22	47	---
Sulfur	ppm	ASTM D5185m		1721	1642	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	---
Sodium	ppm	ASTM D5185m		2	6	---
Potassium	ppm	ASTM D5185m	>20	0	1	---
Water	%	ASTM D6304	>0.05	0.013	0.025	---
ppm Water	ppm	ASTM D6304	>500	135.2	250.5	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		30544	28597	---
Particles >6µm		ASTM D7647	>1300	▲ 5645	▲ 3573	---
Particles >14µm		ASTM D7647	>80	▲ 456	▲ 185	---
Particles >21µm		ASTM D7647	>20	▲ 103	27	---
Particles >38µm		ASTM D7647	>4	▲ 7	2	---
Particles >71µm		ASTM D7647	>3	1	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 22/20/16	▲ 19/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	1.184	1.277	---


OIL ANALYSIS REPORT

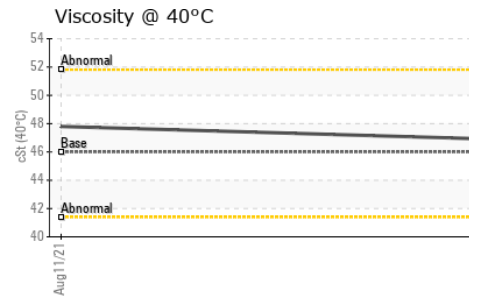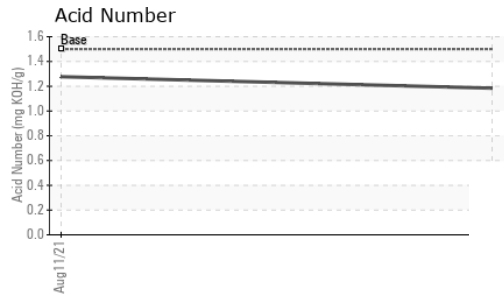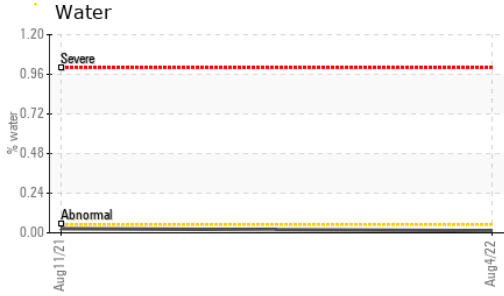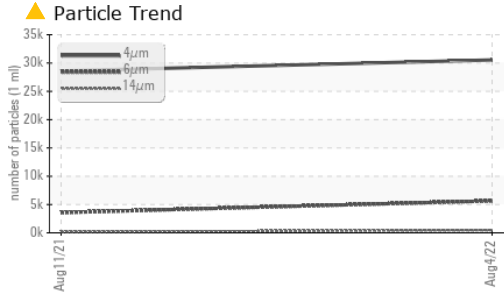





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.9	47.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

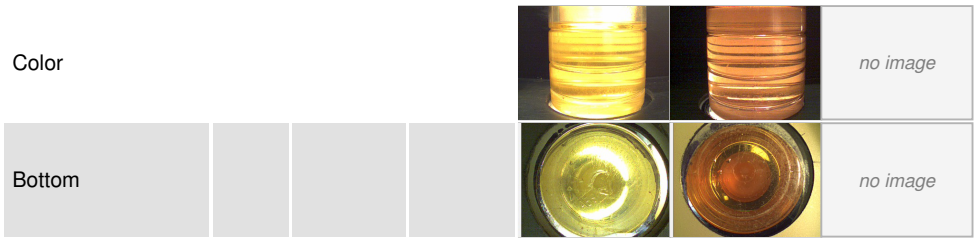

GRAPHS

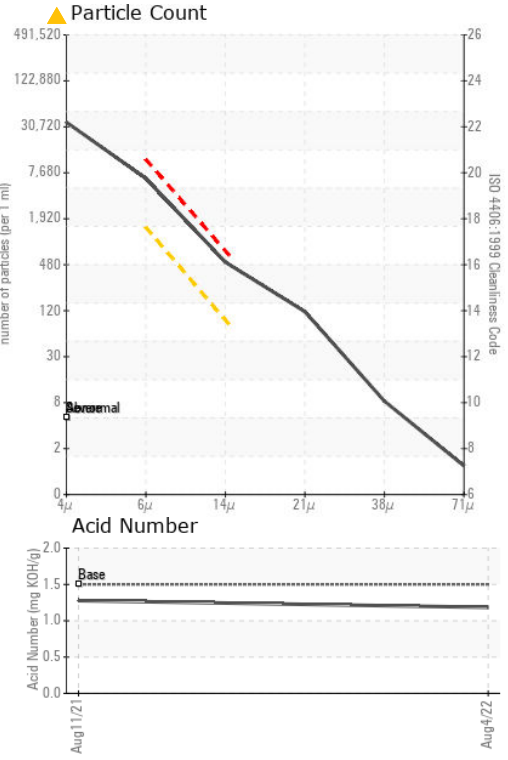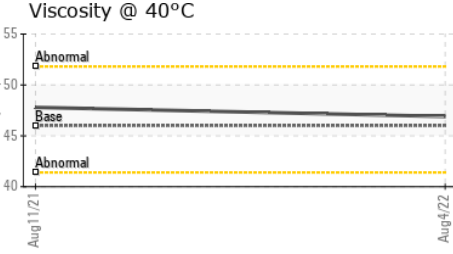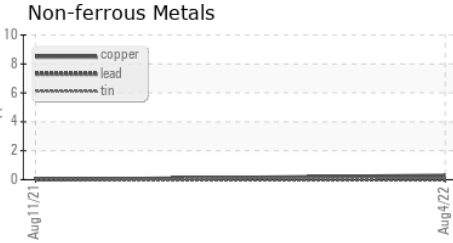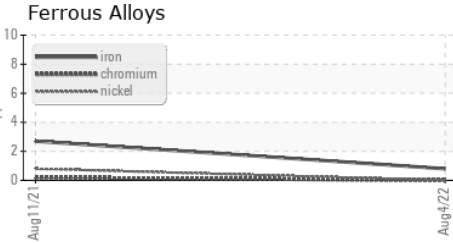

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP49484 **Received** : 17 Aug 2022
Lab Number : 05619508 **Diagnosed** : 18 Aug 2022
Unique Number : 10099015 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

THE WINE GROUP LLC dba BENZIGER FAMILY
 1883 LONDON RANCH RD
 GLEN ELLEN, CA
 US 95442
 Contact: J. KULINA
 jkulina@benziger.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)