


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

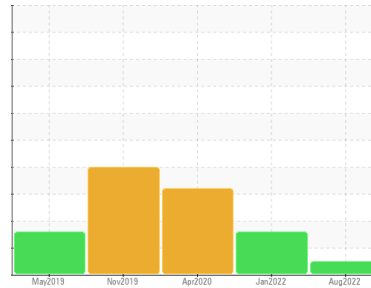

Machine Id
KAESER AS 25 4384225 (S/N 1027)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCP49330	KCP48543	KCP20659
Sample Date	Client Info		15 Aug 2022	11 Jan 2022	21 Apr 2020
Machine Age	hrs	Client Info	26543	25063	20727
Oil Age	hrs	Client Info	1480	2951	0
Oil Changed	Client Info		Changed	Changed	Not Changed
Sample Status			NORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	<1	<1	<1
Copper	ppm	ASTM D5185m >50	6	8	3
Tin	ppm	ASTM D5185m >10	0	<1	0
Antimony	ppm	ASTM D5185m	---	0	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	1	0	<1
Barium	ppm	ASTM D5185m 90	0	0	25
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 100	23	14	59
Calcium	ppm	ASTM D5185m 0	0	0	3
Phosphorus	ppm	ASTM D5185m 0	2	4	5
Zinc	ppm	ASTM D5185m 0	70	59	27
Sulfur	ppm	ASTM D5185m 23500	19060	17982	18032

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	0	<1
Sodium	ppm	ASTM D5185m	6	3	14
Potassium	ppm	ASTM D5185m >20	<1	0	0
Water	%	ASTM D6304 >0.05	0.013	0.005	▲ 0.223
ppm Water	ppm	ASTM D6304 >500	137.0	50.2	▲ 2230






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		2247	10039	1333
Particles >6µm	ASTM D7647 >1300		538	▲ 3131	726
Particles >14µm	ASTM D7647 >80		60	▲ 267	▲ 123
Particles >21µm	ASTM D7647 >20		19	▲ 62	▲ 41
Particles >38µm	ASTM D7647 >4		1	▲ 6	6
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		18/16/13	▲ 19/15	▲ 17/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.39	0.35	0.372


OIL ANALYSIS REPORT

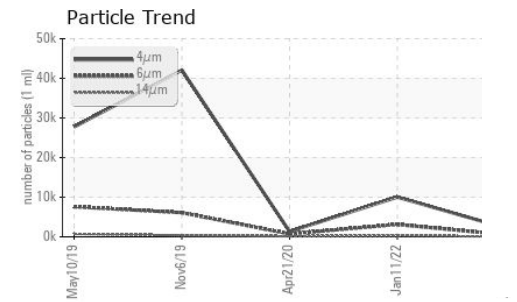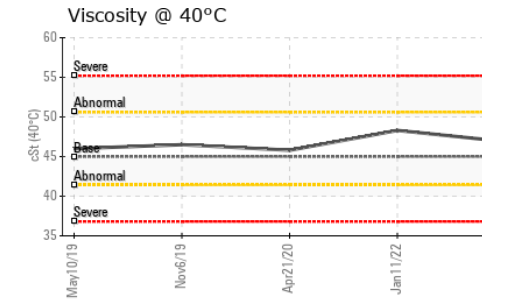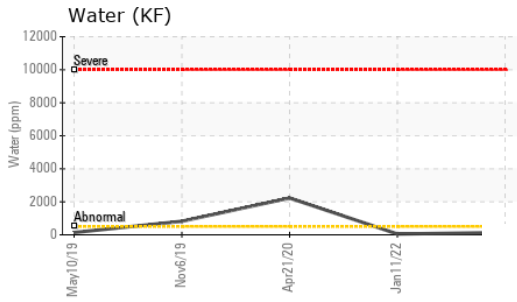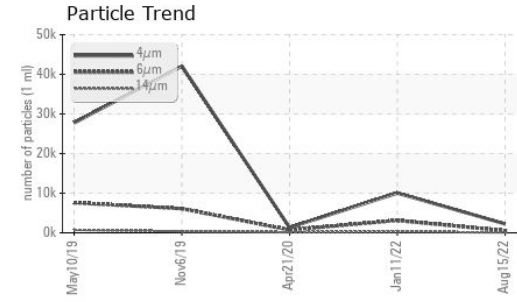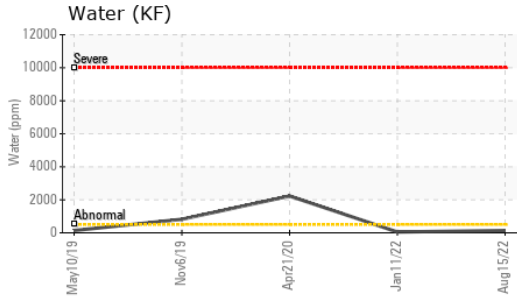






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	▲ HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.9	48.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

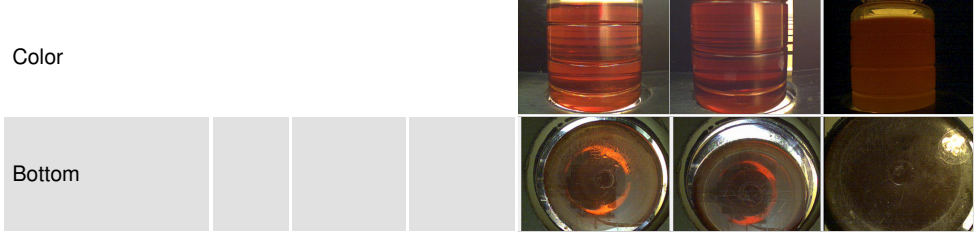

GRAPHS

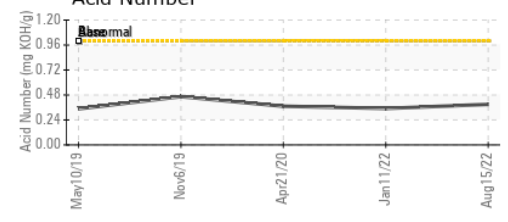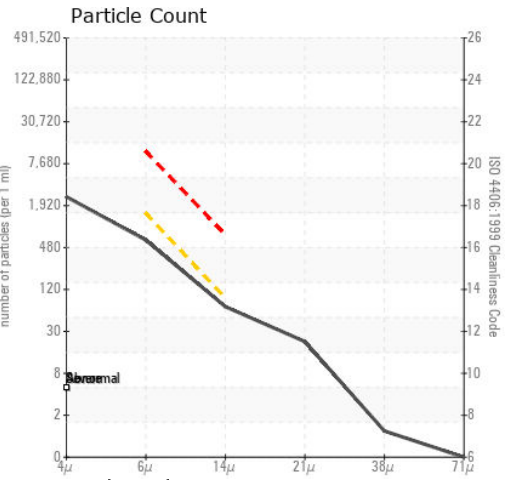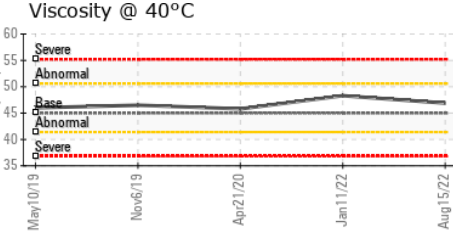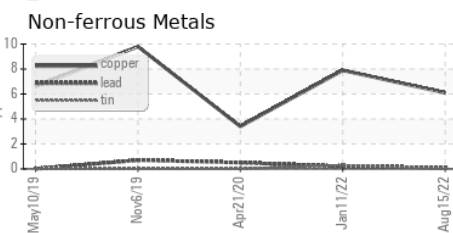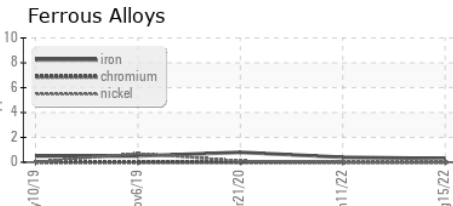

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP49330 **Received** : 18 Aug 2022
Lab Number : 05621333 **Diagnosed** : 22 Aug 2022
Unique Number : 10100840 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CONTECH CONSTRUCTION PRODUCTS INC
 6115 CHAPEL HILL RD.
 RALEIGH, NC
 US 27607
 Contact: D. CLEMENTS
 dclements@contechcs.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)