




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

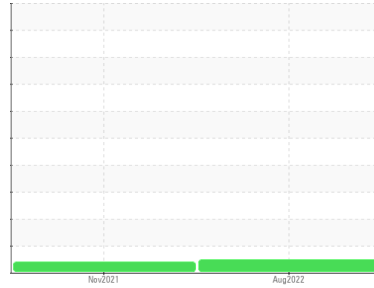

Machine Id
7830726 (S/N 1205)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC97054	KC95130	---
Sample Date	Client Info			18 Aug 2022	30 Nov 2021	---
Machine Age	hrs	Client Info		5740	2889	---
Oil Age	hrs	Client Info		2851	2889	---
Oil Changed	Client Info			Not Changed	Changed	---
Sample Status				NORMAL	ATTENTION	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	0	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	<1	0	---
Aluminum	ppm	ASTM D5185m	>10	4	4	---
Lead	ppm	ASTM D5185m	>10	<1	0	---
Copper	ppm	ASTM D5185m	>50	10	8	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m	90	13	9	---
Calcium	ppm	ASTM D5185m	2	0	0	---
Phosphorus	ppm	ASTM D5185m		1	11	---
Zinc	ppm	ASTM D5185m		30	40	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	1	---
Sodium	ppm	ASTM D5185m		2	0	---
Potassium	ppm	ASTM D5185m	>20	3	<1	---
Water	%	ASTM D6304	>0.05	0.013	0.009	---
ppm Water	ppm	ASTM D6304	>500	137.2	92.0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		827	4740	---
Particles >6µm		ASTM D7647	>1300	178	▲ 1883	---
Particles >14µm		ASTM D7647	>80	15	53	---
Particles >21µm		ASTM D7647	>20	3	8	---
Particles >38µm		ASTM D7647	>4	0	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	17/15/11	▲ 18/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.461	---

OIL ANALYSIS REPORT

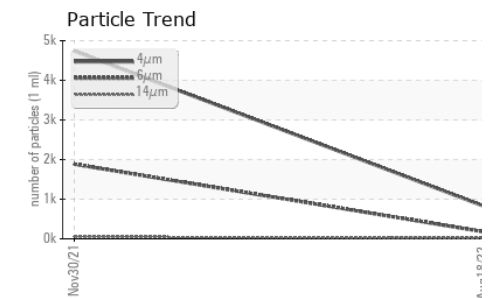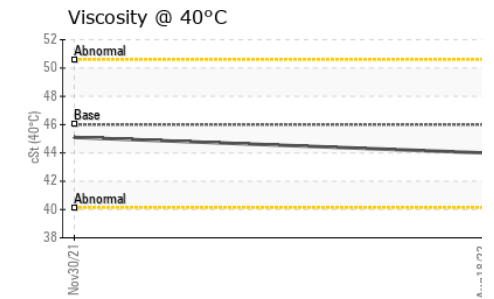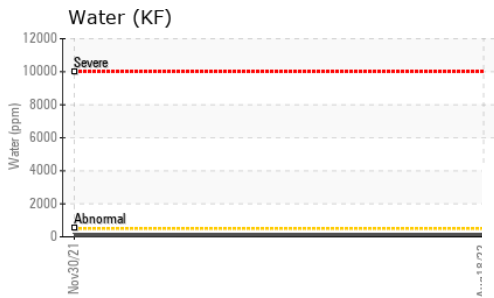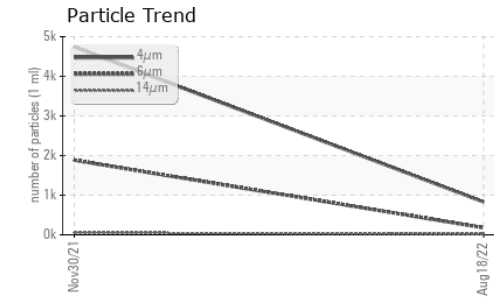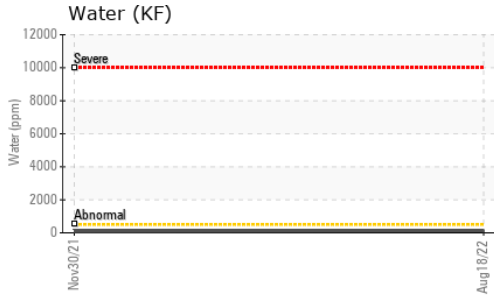





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	NONE	LIGHT	---
Yellow Metal	scalar	*Visual NONE	NONE	NONE	---
Precipitate	scalar	*Visual NONE	NONE	NONE	---
Silt	scalar	*Visual NONE	NONE	NONE	---
Debris	scalar	*Visual NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual NONE	NONE	NONE	---
Appearance	scalar	*Visual NORML	NORML	NORML	---
Odor	scalar	*Visual NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual >0.05	NEG	NEG	---
Free Water	scalar	*Visual	NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.0	45.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

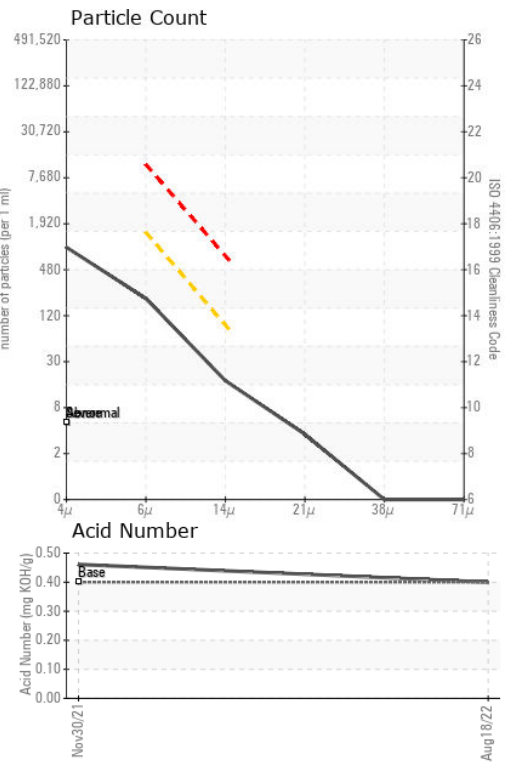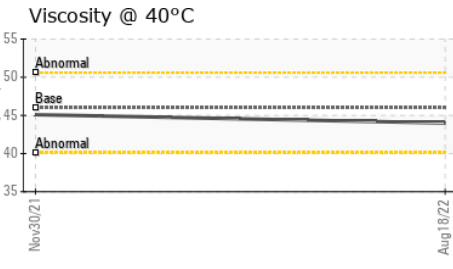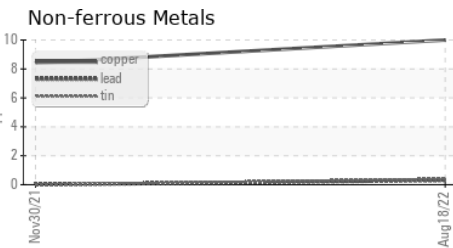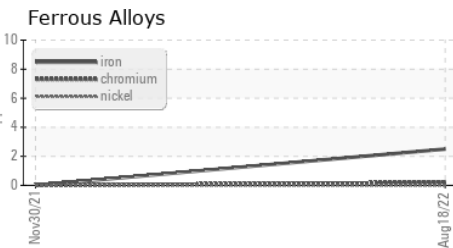

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC97054
Lab Number : **05627476**
Unique Number : 10111997
Test Package : IND 2
Received : 25 Aug 2022
Tested : 26 Aug 2022
Diagnosed : 28 Aug 2022 - Don Baldrige

PRERITE
 33800 LAKELAND
 EAST LAKE, OH
 US 44095
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: