

OIL ANALYSIS REPORT

7280065 (S/N 1022)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Sample Rating Trend **NORMAL**

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug2022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC95206		
Sample Date		Client Info		22 Aug 2022		
Machine Age	hrs	Client Info		3686		
Oil Age	hrs	Client Info		2113		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	9		
Tin	ppm	ASTM D5185m	>10	1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	25		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		11		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		10		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.018		
ppm Water	ppm	ASTM D6304	>500	186.2		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		1482		
Particles >6µm		ASTM D7647	>1300	300		
Particles >14μm		ASTM D7647	>80	18		
Particles >21µm		ASTM D7647	>20	5		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/15/11		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
	1/011/					


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.27



OIL ANALYSIS REPORT

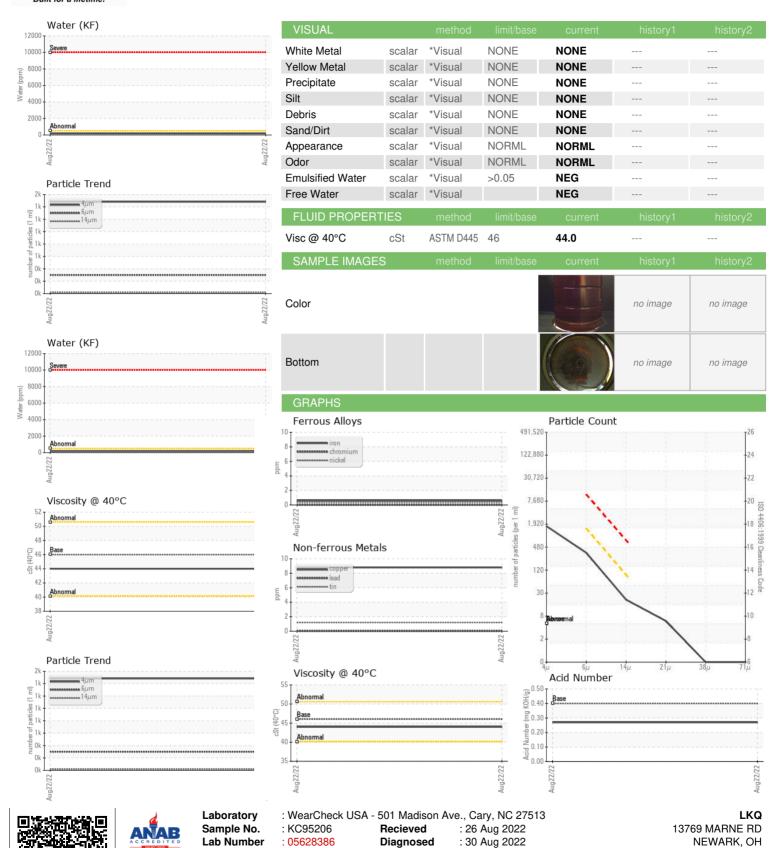

Certificate L2367

Unique Number

Test Package

: 10112907

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2

: Angela Borella

Diagnostician

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 43055

T: F:

Contact: Service Manager