




FUEL REPORT

Sample Rating Trend

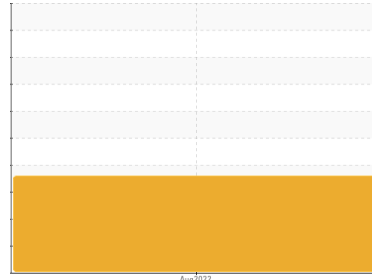

CONTAMINANT



Machine Id
RIG FUEL

Component
Diesel Fuel

Fluid
{not provided} (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check for the source of the gasoline. Recommend drain fuel if not already done and flush before refilling with fuel.

Corrosion

{not applicable}

Contaminants

Sample consists almost entirely of gasoline.

Fuel Condition

Gasoline is present in the fuel and is lowering the viscosity. The fuel is no longer serviceable due to the presence of contaminants.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0514287	---	---
Sample Date	Client Info			26 Aug 2022	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				SEVERE	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		▲ 0.63	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Water	%	ASTM D6304	<0.05	0.006	---	---
ppm Water	ppm	ASTM D6304	<500	66.3	---	---
% Gasoline	%	*In-House	<0.50	◆ 56.7	---	---
% Biodiesel	%	*In-House	<20.0	0.0	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					no image	no image
Bottom					no image	no image




FUEL REPORT

▲ Viscosity @ 40°C




GRAPHS

Pensky-Martens Flash Point (°C)

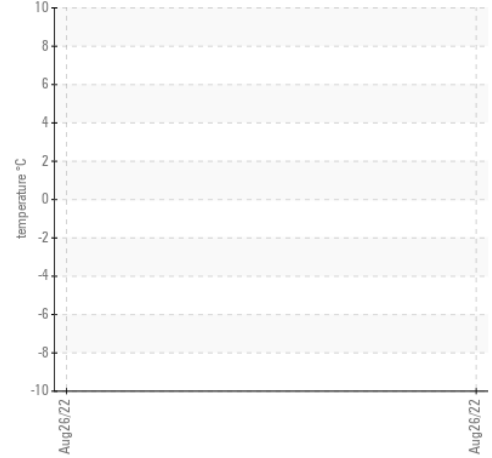

Water (KF)

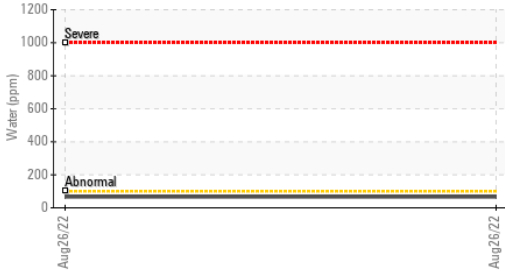

Acid Number



Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0514287 **Received** : 29 Aug 2022
Lab Number : **05629757** **Diagnosed** : 31 Aug 2022
Unique Number : 10114278 **Diagnostician** : Doug Bogart
Test Package : DF-5 (Additional Tests: SCREEN)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

KELLER-NA - KERNERSVILLE
 1024 EAST MOUNTAIN ST
 KERNERSVILLE, NC
 US 27284

Contact: BRENT SHIRLEY
 BShirley@keller-na.com

T: (336)992-2300

F: (336)668-3259