

OIL ANALYSIS REPORT

Sample Rating Trend



KAESER SK 15T 8191901 (S/N 1412)

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP39773		
Sample Date		Client Info		17 Aug 2022		
Machine Age	hrs	Client Info		6822		
Oil Age	hrs	Client Info		6822		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium		ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
	ppm			0		
Titanium	ppm	ASTM D5185m		-		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m		13		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	18		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	5		
Zinc	ppm	ASTM D5185m	0	33		
Sulfur	ppm	ASTM D5185m	23500	16124		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.009		
ppm Water	ppm	ASTM D6304	>500	98.1		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4896		
Particles >6µm		ASTM D7647	>1300	1113		
Particles >14µm		ASTM D7647	>80	53		
Particles >21µm		ASTM D7647	>20	8		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA		method	limit/base	current	history1	history2
				0.35		
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.55		



ç 50 [₹]3 45 Bas

4(

5

Ê 4

-S 31

52

0


回题


Abnorma

Particle Trend

Se 35 Aug17/22

OIL ANALYSIS REPORT

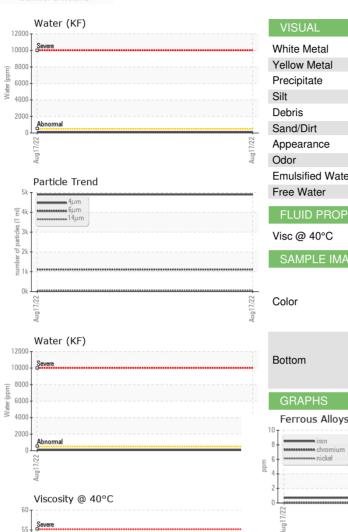

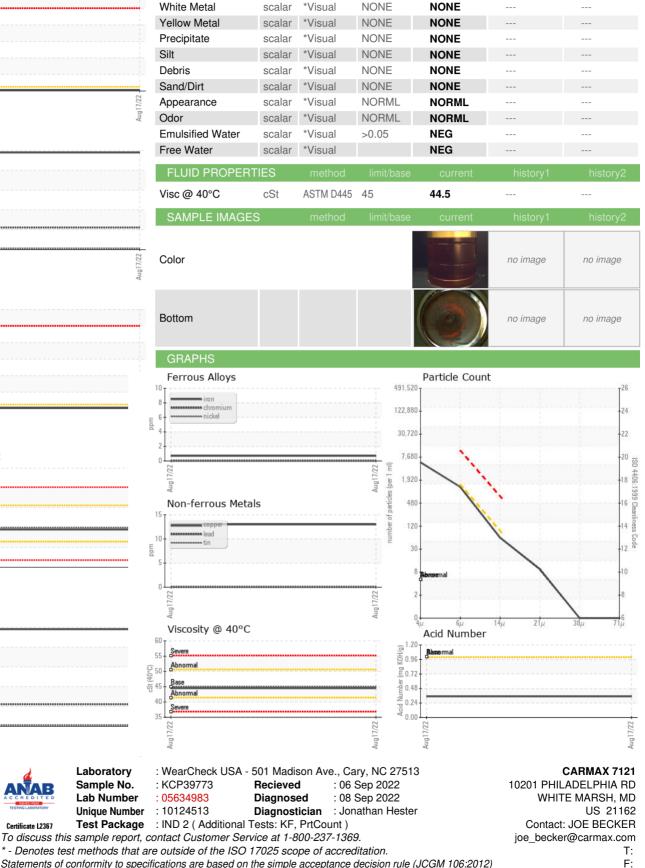

Contact/Location: JOE BECKER - CARWHIKC

Certificate L2367