



# PROBLEM SUMMARY

Sample Rating Trend



ISO




Machine Id  
**KAESER SX 6 2567279 (S/N 2905)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

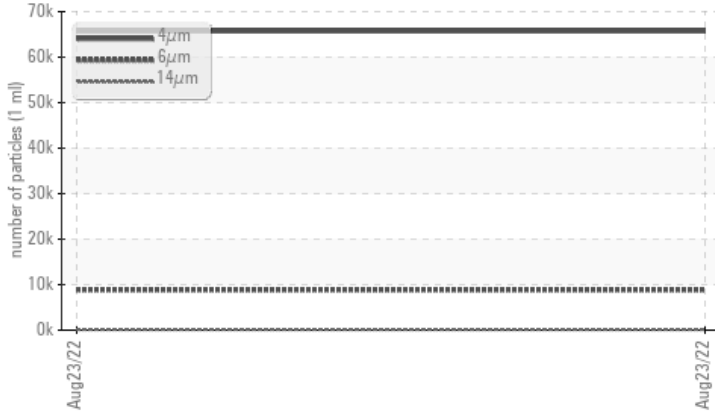

## RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	---	---
Particles >6µm	ASTM D7647	>1300	▲ <b>8854</b>	---	---
Particles >14µm	ASTM D7647	>80	▲ <b>135</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>23/20/14</b>	---	---

Customer Id: HILHILCA  
 Sample No.: KCP48263  
 Lab Number: 05635021  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id  
**KAESER SX 6 2567279 (S/N 2905)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCP48263</b>	---	---
Sample Date	Client Info	<b>23 Aug 2022</b>	---	---
Machine Age	hrs Client Info	<b>15083</b>	---	---
Oil Age	hrs Client Info	<b>427</b>	---	---
Oil Changed	Client Info	<b>Changed</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	<b>&lt;1</b>	---	---
Chromium ppm ASTM D5185m	>10	<b>0</b>	---	---
Nickel ppm ASTM D5185m	>3	<b>0</b>	---	---
Titanium ppm ASTM D5185m	>3	<b>0</b>	---	---
Silver ppm ASTM D5185m	>2	<b>0</b>	---	---
Aluminum ppm ASTM D5185m	>10	<b>&lt;1</b>	---	---
Lead ppm ASTM D5185m	>10	<b>&lt;1</b>	---	---
Copper ppm ASTM D5185m	>50	<b>7</b>	---	---
Tin ppm ASTM D5185m	>10	<b>0</b>	---	---
Vanadium ppm ASTM D5185m		<b>0</b>	---	---
Cadmium ppm ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m	0	<b>0</b>	---	---
Barium ppm ASTM D5185m	90	<b>44</b>	---	---
Molybdenum ppm ASTM D5185m	0	<b>0</b>	---	---
Manganese ppm ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium ppm ASTM D5185m	100	<b>72</b>	---	---
Calcium ppm ASTM D5185m	0	<b>2</b>	---	---
Phosphorus ppm ASTM D5185m	0	<b>3</b>	---	---
Zinc ppm ASTM D5185m	0	<b>14</b>	---	---
Sulfur ppm ASTM D5185m	23500	<b>19465</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	<b>18</b>	---	---
Sodium ppm ASTM D5185m		<b>7</b>	---	---
Potassium ppm ASTM D5185m	>20	<b>0</b>	---	---
Water % ASTM D6304	>0.05	<b>0.019</b>	---	---
ppm Water ppm ASTM D6304	>500	<b>190.9</b>	---	---






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		<b>65706</b>	---	---
Particles >6µm ASTM D7647	>1300	<b>▲ 8854</b>	---	---
Particles >14µm ASTM D7647	>80	<b>▲ 135</b>	---	---
Particles >21µm ASTM D7647	>20	<b>19</b>	---	---
Particles >38µm ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness ISO 4406 (c)	>--/17/13	<b>▲ 23/20/14</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	1.0	<b>0.38</b>	---	---


# OIL ANALYSIS REPORT

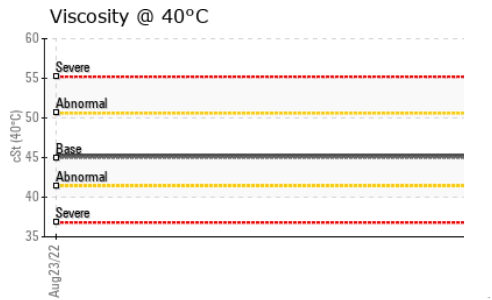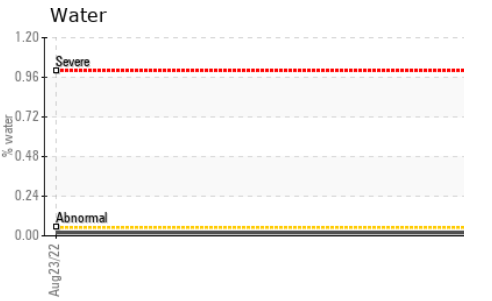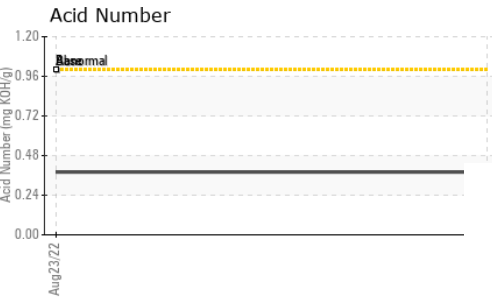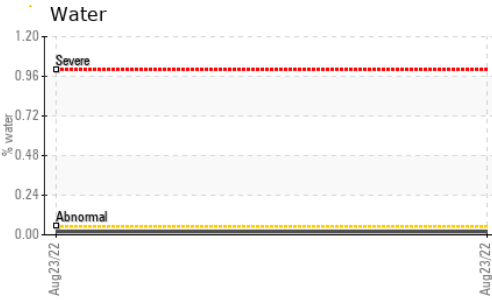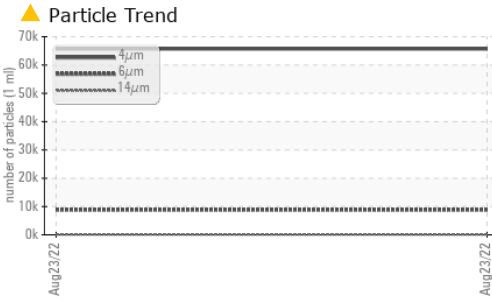





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.2	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

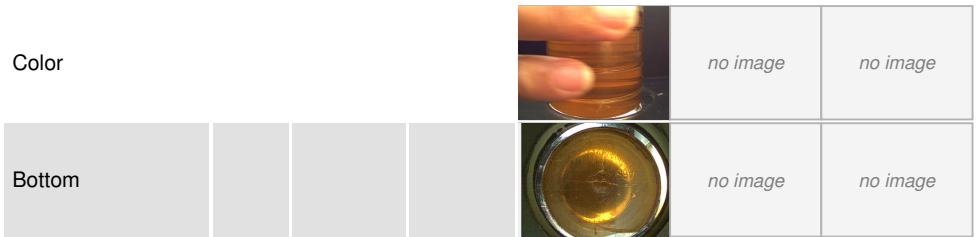

## GRAPHS

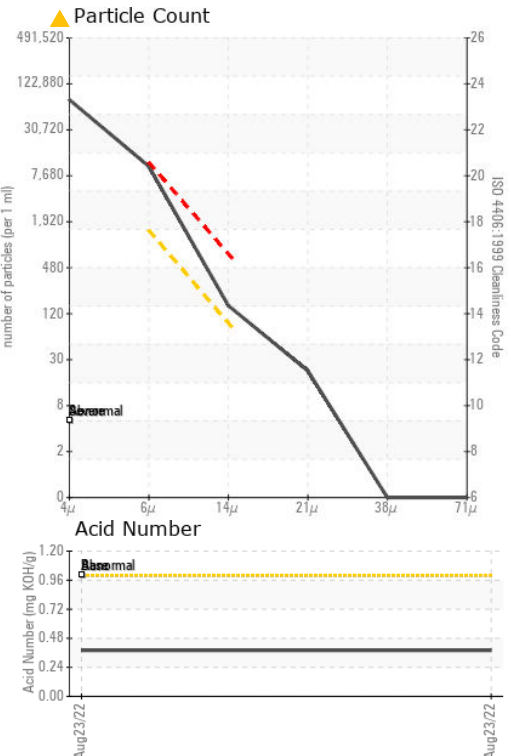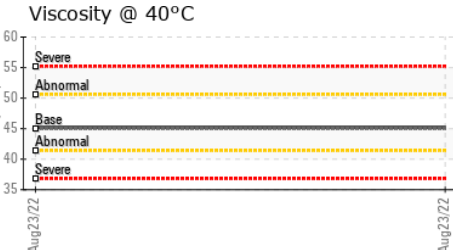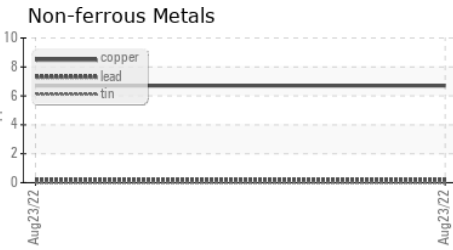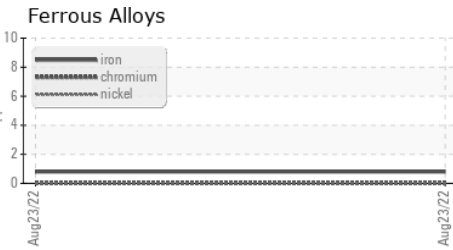

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP48263 **Received** : 06 Sep 2022  
**Lab Number** : 05635021 **Diagnosed** : 08 Sep 2022  
**Unique Number** : 10124551 **Diagnostician** : Don Baldrige

**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**HILMAR CHEESE**  
 9001 N LANDER AVE  
 HILMAR, CA  
 US 95324  
 Contact: J. GUTIERREZ  
 jgutierrez@hilmarcheese.com

T:  
F: