




# OIL ANALYSIS REPORT

Sample Rating Trend

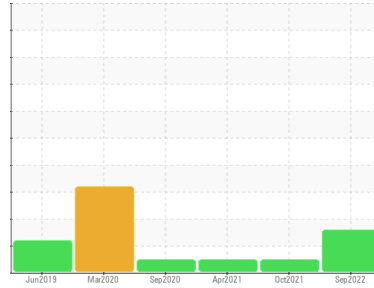

ISO



Machine Id  
**KAESER BSD 50 6341460 (S/N 1869)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCP50325</b>	KCP36119	KCP32617
Sample Date	Client Info			<b>02 Sep 2022</b>	31 Oct 2021	06 Apr 2021
Machine Age	hrs	Client Info		<b>18530</b>	13323	10585
Oil Age	hrs	Client Info		<b>5206</b>	5097	2359
Oil Changed	Client Info			<b>Changed</b>	Changed	Not Changed
Sample Status				<b>ATTENTION</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	<1
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	15	29	3
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m		---	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	10
Barium	ppm	ASTM D5185m	90	0	0	30
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	90	13	26	63
Calcium	ppm	ASTM D5185m	2	0	0	2
Phosphorus	ppm	ASTM D5185m		2	4	4
Zinc	ppm	ASTM D5185m		16	21	11
Sulfur	ppm	ASTM D5185m		17515	18285	13282

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	0
Sodium	ppm	ASTM D5185m		5	15	20
Potassium	ppm	ASTM D5185m	>20	2	7	4
Water	%	ASTM D6304	>0.05	0.018	0.018	0.021
ppm Water	ppm	ASTM D6304	>500	182.4	183.2	213.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6076	3547	2272
Particles >6µm		ASTM D7647	>1300	▲ 2023	954	814
Particles >14µm		ASTM D7647	>80	▲ 158	70	95
Particles >21µm		ASTM D7647	>20	▲ 29	20	28
Particles >38µm		ASTM D7647	>4	4	1	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/14	17/13	17/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36	0.407	0.371

# OIL ANALYSIS REPORT

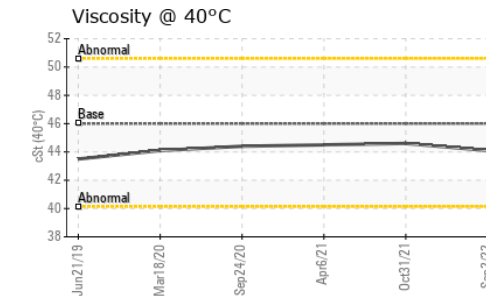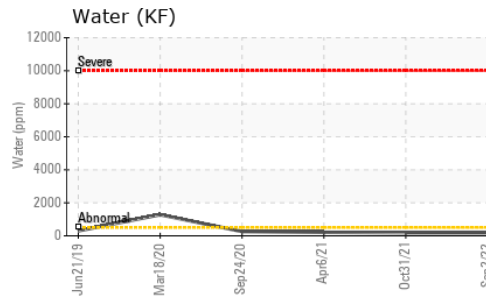
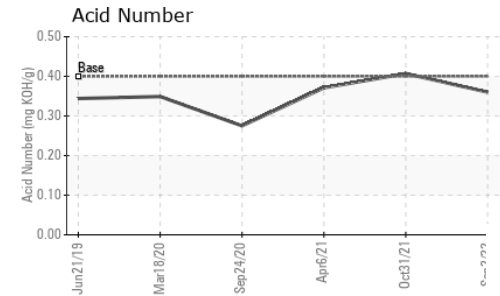
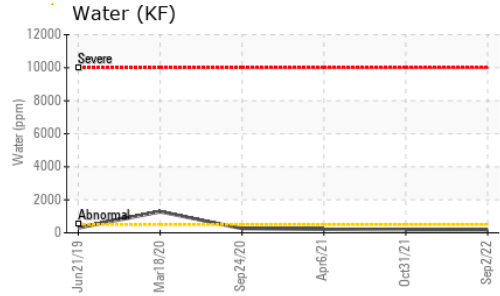
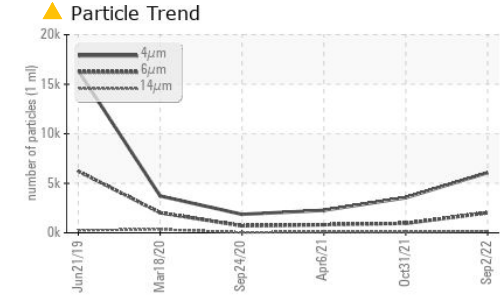


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.1	44.6	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

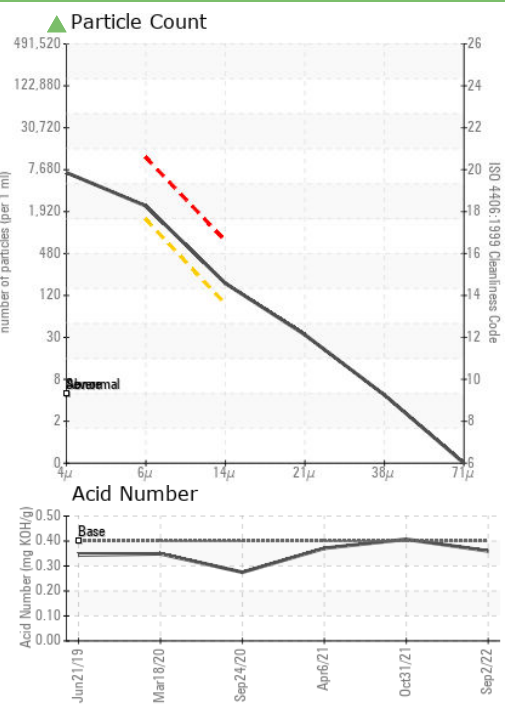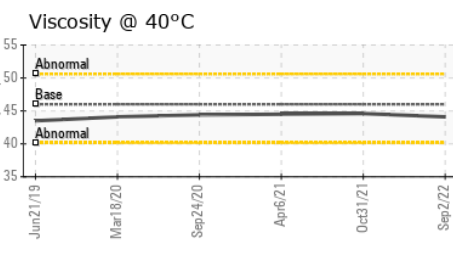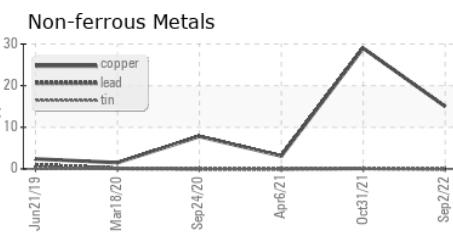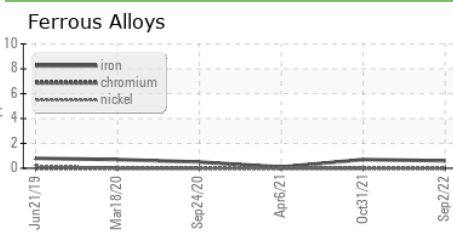

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP50325 **Received** : 06 Sep 2022  
**Lab Number** : 05635036 **Tested** : 07 Sep 2022  
**Unique Number** : 10124566 **Diagnosed** : 08 Sep 2022 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**MORRISTOWN MANUFACTURING - IATRIC**  
 328 HAMBLEN AVE  
 MORRISTOWN, TN  
 US 37813  
 Contact: D. DORSEY  
 ddorsey@iatricmtg.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)