




PROBLEM SUMMARY


Sample Rating Trend

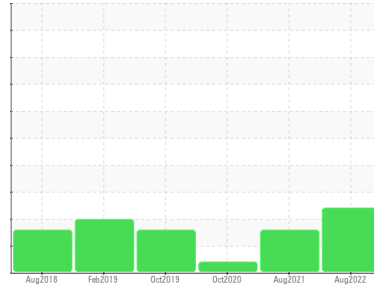

Machine Id
KAESER BSD 50 2984279 (S/N 1564)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

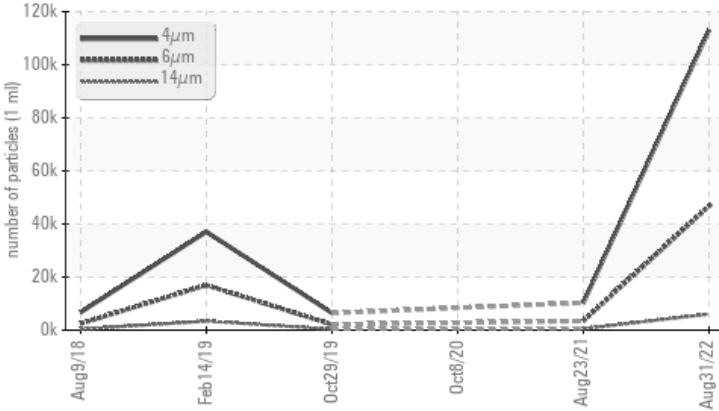

RECOMMENDATION

The oil change at the time of sampling has been noted. We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 46784	▲ 3444	---
Particles >14µm	ASTM D7647	>80	▲ 6020	▲ 501	---
Particles >21µm	ASTM D7647	>20	▲ 1867	▲ 185	---
Particles >38µm	ASTM D7647	>4	▲ 320	▲ 8	---
Particles >71µm	ASTM D7647	>3	▲ 19	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 24/23/20	▲ 19/16	---

Customer Id: AIRWAU
 Sample No.: KCP50520
 Lab Number: 05639119
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	MISSED	Sep 08 2023	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

23 Aug 2021 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 Oct 2020 Diag: Angela Borella

VIS DEBRIS



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



29 Oct 2019 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

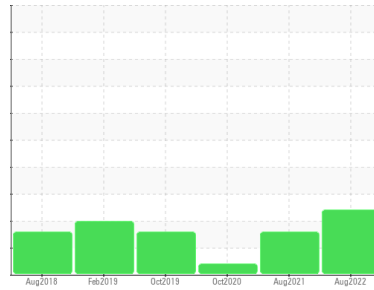

ISO



Machine Id
KAESER BSD 50 2984279 (S/N 1564)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The oil change at the time of sampling has been noted. We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP50520	KCP37795	KCP31626
Sample Date	Client Info			31 Aug 2022	23 Aug 2021	08 Oct 2020
Machine Age	hrs	Client Info		44610	41453	39421
Oil Age	hrs	Client Info		3000	3000	3000
Oil Changed	Client Info			Changed	Changed	Not Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	<1
Aluminum	ppm	ASTM D5185m	>10	<1	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	3	6	4
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	<1
Barium	ppm	ASTM D5185m	90	<1	0	3
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	37	12	38
Calcium	ppm	ASTM D5185m	2	<1	0	0
Phosphorus	ppm	ASTM D5185m		12	0	0
Zinc	ppm	ASTM D5185m		11	0	2
Sulfur	ppm	ASTM D5185m		18752	16635	17047

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		8	0	3
Potassium	ppm	ASTM D5185m	>20	1	0	1
Water	%	ASTM D6304	>0.05	0.016	0.010	0.012
ppm Water	ppm	ASTM D6304	>500	168.9	101.2	122.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		113071	10295	---
Particles >6µm		ASTM D7647	>1300	▲ 46784	▲ 3444	---
Particles >14µm		ASTM D7647	>80	▲ 6020	▲ 501	---
Particles >21µm		ASTM D7647	>20	▲ 1867	▲ 185	---
Particles >38µm		ASTM D7647	>4	▲ 320	▲ 8	---
Particles >71µm		ASTM D7647	>3	▲ 19	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 24/23/20	▲ 19/16	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.37	0.374	0.399


OIL ANALYSIS REPORT

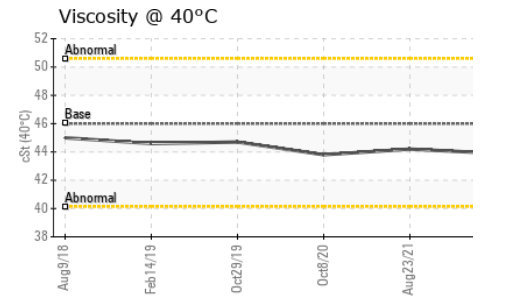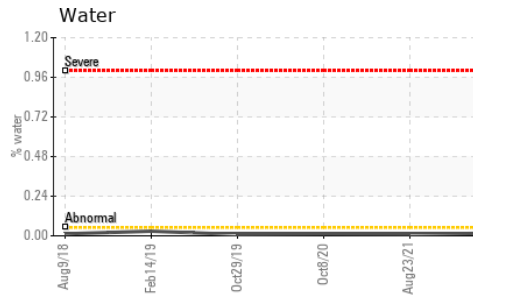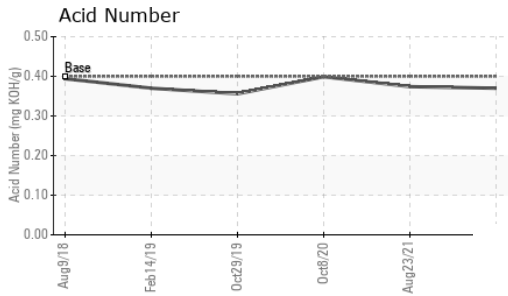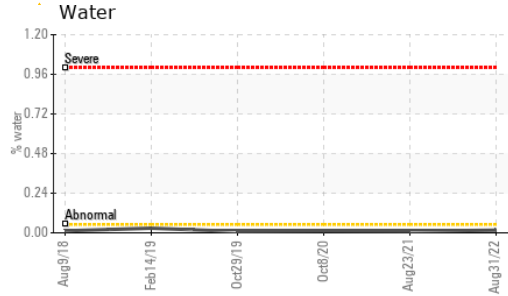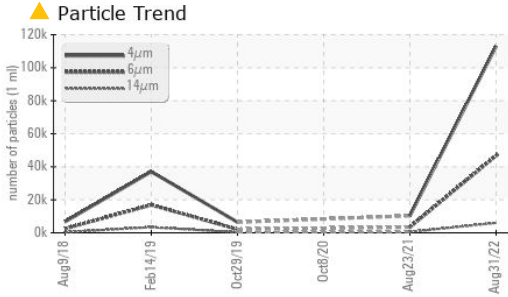





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	LIGHT	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.9	44.2	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

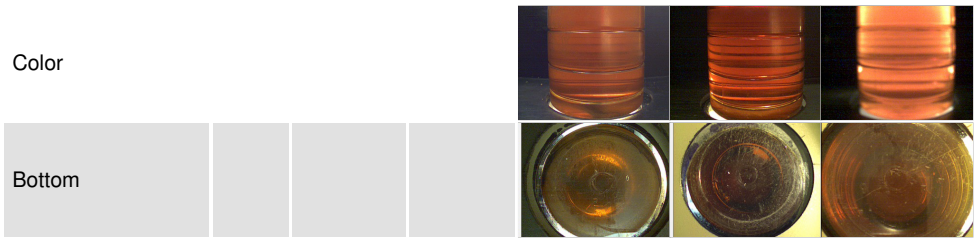

GRAPHS

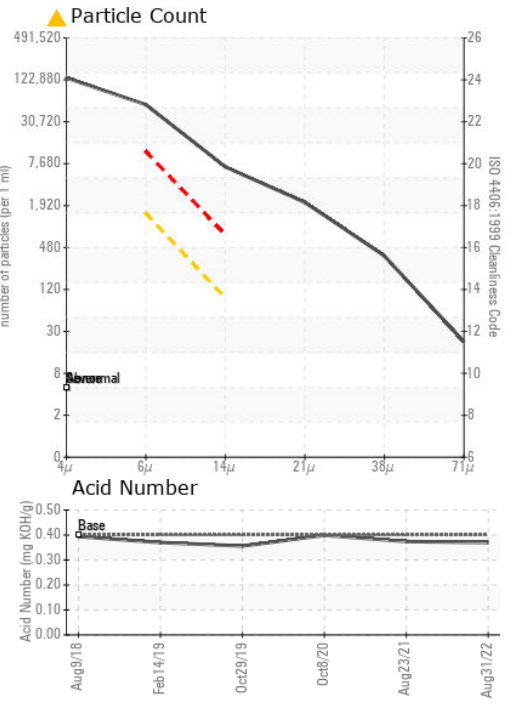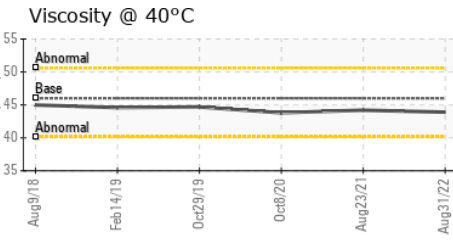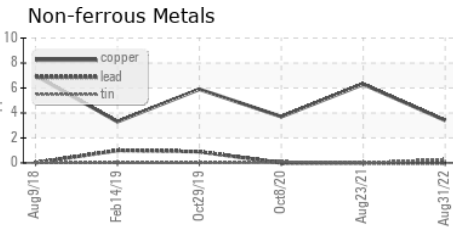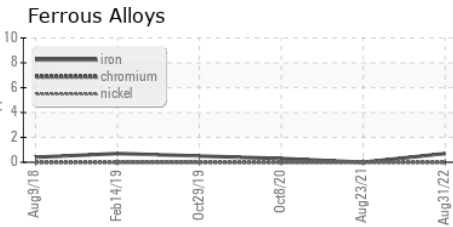

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP50520 **Received** : 12 Sep 2022
Lab Number : 05639119 **Diagnosed** : 14 Sep 2022
Unique Number : 10128649 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AIRGAS INC
 401 SENTRY DR
 WAUKESHA, WI
 US 53186
 Contact: KEITH FREDERICK
 keith.frederick@airgas.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: