




PROBLEM SUMMARY

Sample Rating Trend

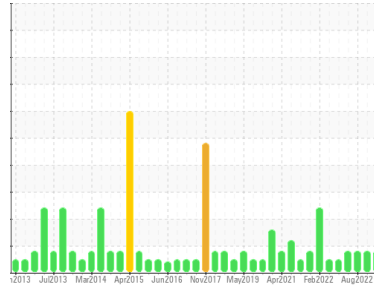


WEAR



Area
BLEACH O2
Machine Id
METSO BX025 PRE02 PRESS NE (S/N 0661-03-02-040-040-090)
Component
Bearing
Fluid
NOT GIVEN (4 GAL)

COMPONENT CONDITION SUMMARY

▲ Ferrous Alloys

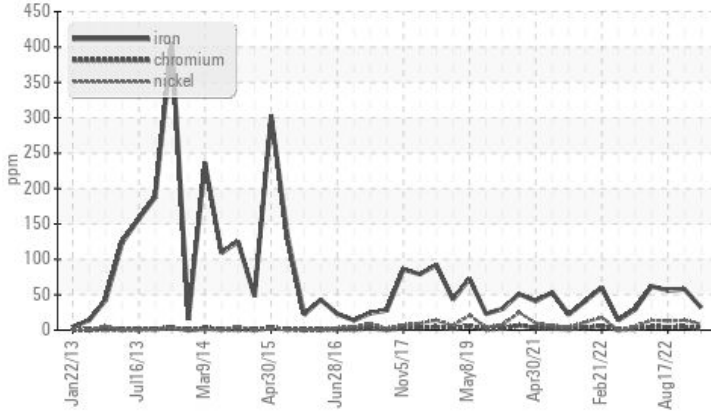

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				MARGINAL	MARGINAL	MARGINAL
Iron	ppm	ASTM D5185m	>20	▲ 32	▲ 58	▲ 56

Customer Id: INTRIERP
Sample No.: WC0676832
Lab Number: 05645557
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

06 Sep 2022 Diag: Jonathan Hester

WEAR



No corrective action is recommended at this time. Resample at the next service interval to monitor. The iron level is abnormal. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



17 Aug 2022 Diag: Doug Bogart

WEAR



No corrective action is recommended at this time. Resample at the next service interval to monitor. The iron level is abnormal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



29 Jul 2022 Diag: Doug Bogart

WEAR



No corrective action is recommended at this time. Resample at the next service interval to monitor. The iron level is abnormal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

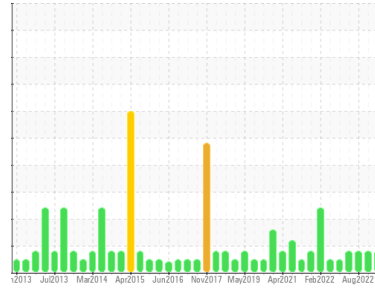

WEAR



Area
BLEACH O2
 Machine Id
METSO BX025 PRE02 PRESS NE (S/N 0661-03-02-040-040-090)
 Component
Bearing
 Fluid
NOT GIVEN (4 GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The iron level is abnormal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0676832	WC0676830	WC0676828
Sample Date	Client Info		13 Sep 2022	06 Sep 2022	17 Aug 2022
Machine Age	mls	Client Info	0	0	0
Oil Age	mls	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			MARGINAL	MARGINAL	MARGINAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	▲ 32	▲ 58	▲ 56
Chromium	ppm	ASTM D5185m >20	2	4	4
Nickel	ppm	ASTM D5185m >20	8	14	13
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	4	<1	<1
Aluminum	ppm	ASTM D5185m >20	<1	<1	2
Lead	ppm	ASTM D5185m >20	0	0	<1
Copper	ppm	ASTM D5185m >20	<1	<1	<1
Tin	ppm	ASTM D5185m >20	0	0	<1
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<1	<1	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	<1	<1	<1
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	0	0	<1
Calcium	ppm	ASTM D5185m	12	23	20
Phosphorus	ppm	ASTM D5185m	38	61	59
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	8597	14050	13971

CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	4	7	6
Sodium	ppm	ASTM D5185m	<1	2	3
Potassium	ppm	ASTM D5185m >20	0	0	<1
Water	%	ASTM D6304 >2	0.409	---	0.244
ppm Water	ppm	ASTM D6304	4090	---	2440

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.19	0.34	0.25




OIL ANALYSIS REPORT

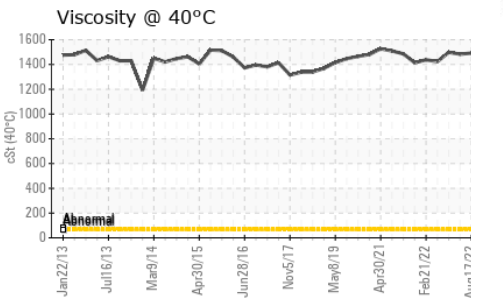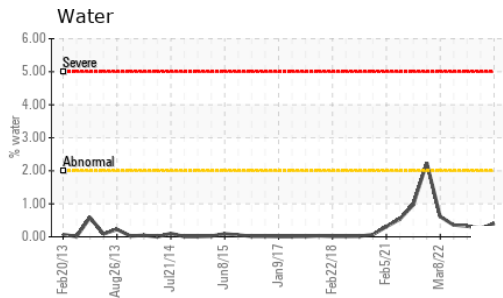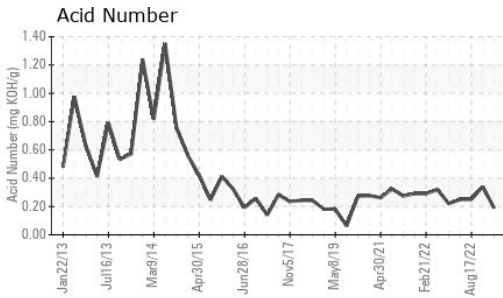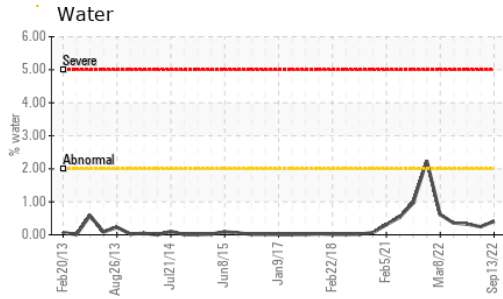





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	1484	1485	1492

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

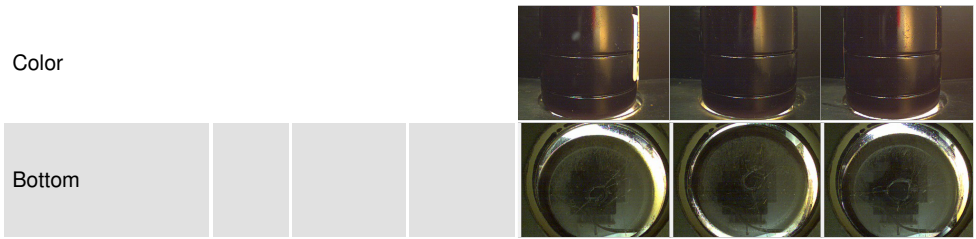

GRAPHS

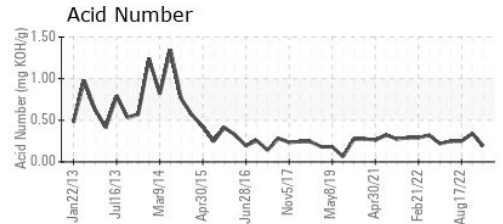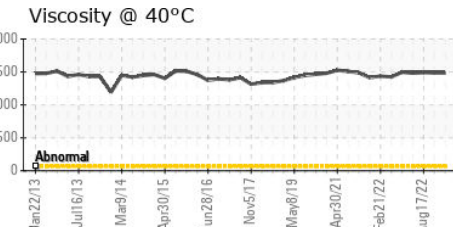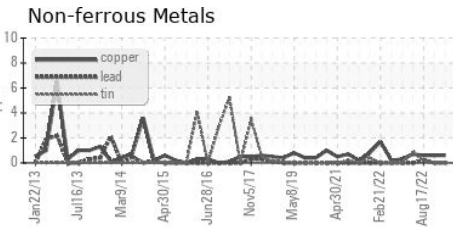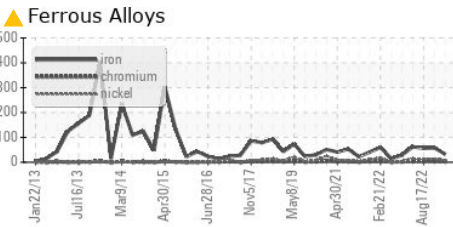

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0676832 Received : 19 Sep 2022
 Lab Number : 05645557 Diagnosed : 21 Sep 2022
 Unique Number : 10140096 Diagnostician : Don Baldrige
 Test Package : IND 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

INTERNATIONAL PAPER
 865 JOHN L REGEL RD
 RIEGELWOOD, NC
 US 28456

Contact: Zach Lizana
 zachary.lizana@ipaper.com

T: (910)362-4775

F: