PROBLEM SUMMARY

Sample Rating Trend

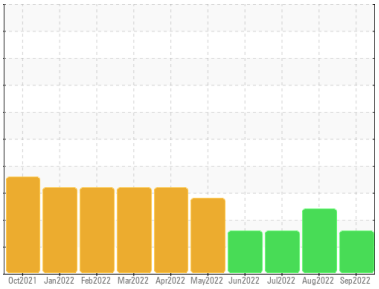

WATER

Machine Id
FRICK FRICK B
Component
Screw Compressor
Fluid
NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

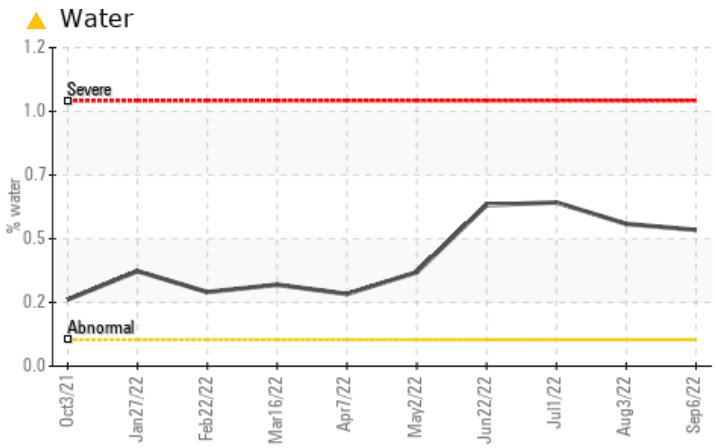

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.1	▲ **0.513**	▲ 0.536	▲ 0.617
ppm Water	ppm	ASTM D6304	>1000	▲ **5139.4**	▲ 5368.9	▲ 6172.1

Customer Id: GARROW
Sample No.: TO60000188
Lab Number: 05648896
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	MISSED	Nov 12 2022	?	We recommend you service the filters on this component.
Information Required	MISSED	Nov 12 2022	?	Please specify the brand, type, and viscosity of the oil on your next sample.

HISTORICAL DIAGNOSIS

03 Aug 2022 Diag: Jonathan Hester

WATER

No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of silt (particulates < 6 microns in size) present in the oil. There is a moderate concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

01 Jul 2022 Diag: Angela Borella

WATER

We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

22 Jun 2022 Diag: Angela Borella

WATER

We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

OIL ANALYSIS REPORT

Sample Rating Trend

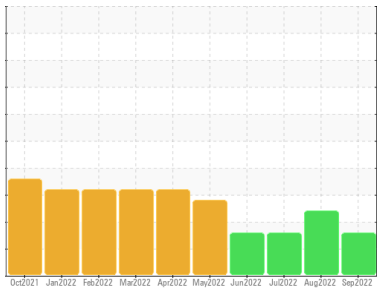

WATER

Machine Id
FRICK FRICK B
Component
Screw Compressor
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**TO60000188**	TO60000184	TO60000181
Sample Date		Client Info		**06 Sep 2022**	03 Aug 2022	01 Jul 2022
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>60	**1**	0	<1
Chromium	ppm	ASTM D5185m	>4	**0**	0	0
Nickel	ppm	ASTM D5185m		**0**	<1	<1
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**<1**	<1	<1
Aluminum	ppm	ASTM D5185m	>5	**1**	<1	<1
Lead	ppm	ASTM D5185m	>10	**<1**	<1	<1
Copper	ppm	ASTM D5185m	>30	**<1**	0	<1
Tin	ppm	ASTM D5185m	>15	**<1**	1	2
Vanadium	ppm	ASTM D5185m		**<1**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**8**	3	7
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	0	0
Magnesium	ppm	ASTM D5185m		**1**	<1	<1
Calcium	ppm	ASTM D5185m		**<1**	<1	0
Phosphorus	ppm	ASTM D5185m		**42**	18	17
Zinc	ppm	ASTM D5185m		**0**	0	0
Sulfur	ppm	ASTM D5185m		**2874**	2050	1818

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	**21**	19	20
Sodium	ppm	ASTM D5185m		**0**	0	0
Potassium	ppm	ASTM D5185m	>20	**3**	0	2
Water	%	ASTM D6304	>0.1	▲ **0.513**	▲ 0.536	▲ 0.617
ppm Water	ppm	ASTM D6304	>1000	▲ **5139.4**	▲ 5368.9	▲ 6172.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	**9114**	▲ 70373	7684
Particles >6µm		ASTM D7647	>2500	**856**	2168	1246
Particles >14µm		ASTM D7647	>320	**22**	31	68
Particles >21µm		ASTM D7647	>80	**4**	5	18
Particles >38µm		ASTM D7647	>20	**0**	1	0
Particles >71µm		ASTM D7647	>4	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	**20/17/12**	▲ 23/18/12	20/17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.223**	0.225	0.604

OIL ANALYSIS REPORT

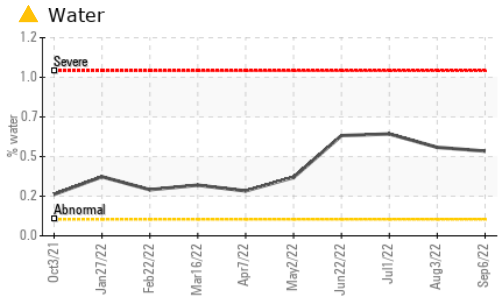

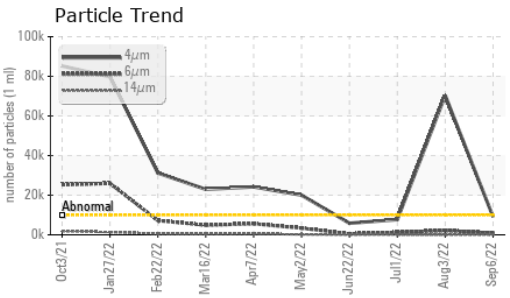

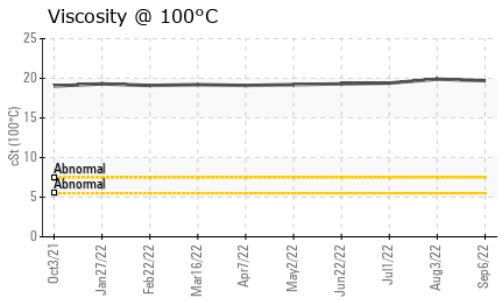

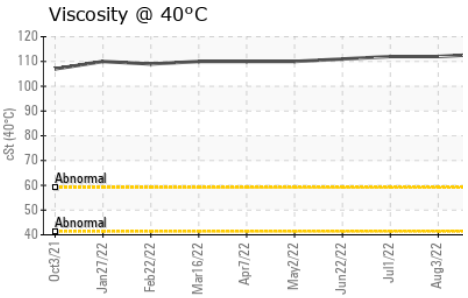

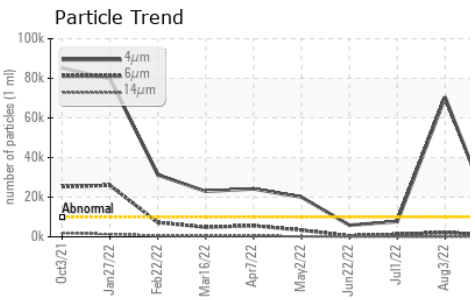

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**LIGHT**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		**113**	112	112
Visc @ 100°C	cSt	ASTM D445		**19.7**	19.9	19.4
Viscosity Index (VI)	Scale	ASTM D2270		**197**	201	195

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

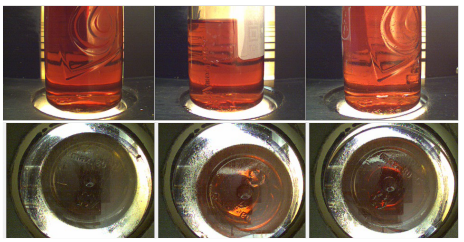

GRAPHS

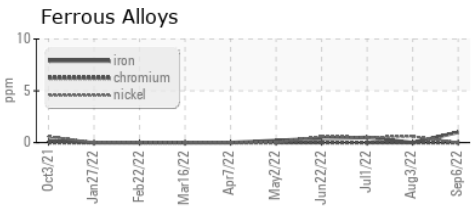

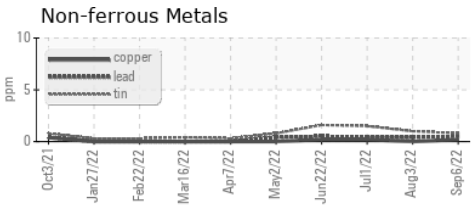

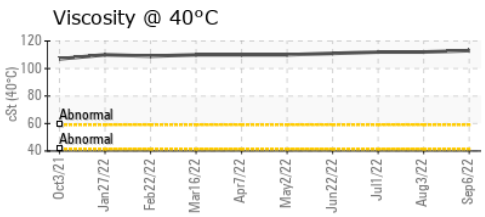

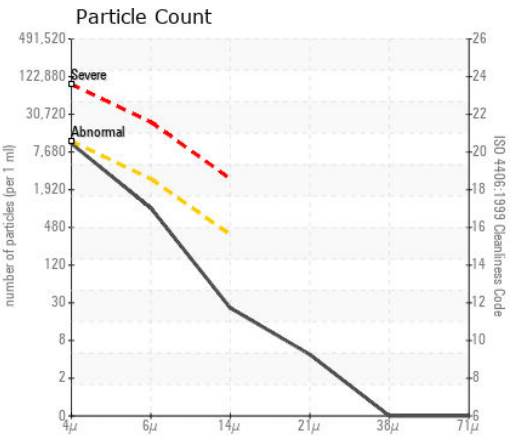

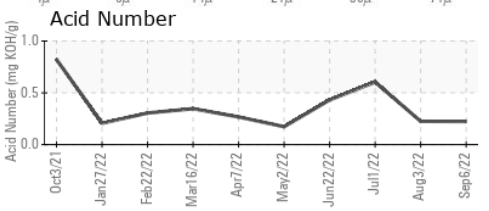

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60000188 **Received** : 22 Sep 2022
Lab Number : 05648896 **Diagnosed** : 25 Sep 2022
Unique Number : 10143435 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

GARLAND RENEWABLES
3175 ELM GROVE RD
ROWLETT, TX
US 75089
Contact: DUSTIN FRY
dustin@morrowrenew.com
T:
F: