



PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
KAESER BSD 60 7194147 (S/N 1595)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

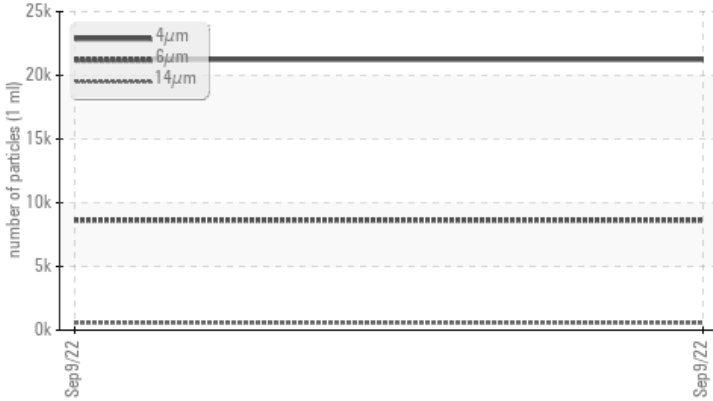

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Particles >6µm	ASTM D7647	>1300	▲ 8631	---	---	---
Particles >14µm	ASTM D7647	>80	▲ 567	---	---	---
Particles >21µm	ASTM D7647	>20	▲ 63	---	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/16	---	---	---

Customer Id: AMELOC
 Sample No.: KCP49328
 Lab Number: 05648924
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com


RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

OIL ANALYSIS REPORT

Sample Rating Trend

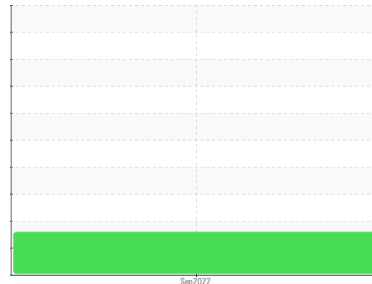

ISO



Machine Id
KAESER BSD 60 7194147 (S/N 1595)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCP49328	---	---
Sample Date	Client Info	09 Sep 2022	---	---
Machine Age	hrs Client Info	9178	---	---
Oil Age	hrs Client Info	2340	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	<1	---	---
Chromium ppm ASTM D5185m	>10	0	---	---
Nickel ppm ASTM D5185m	>3	0	---	---
Titanium ppm ASTM D5185m	>3	0	---	---
Silver ppm ASTM D5185m	>2	0	---	---
Aluminum ppm ASTM D5185m	>10	0	---	---
Lead ppm ASTM D5185m	>10	0	---	---
Copper ppm ASTM D5185m	>50	2	---	---
Tin ppm ASTM D5185m	>10	<1	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m	0	0	---	---
Barium ppm ASTM D5185m	90	9	---	---
Molybdenum ppm ASTM D5185m	0	0	---	---
Manganese ppm ASTM D5185m		<1	---	---
Magnesium ppm ASTM D5185m	100	65	---	---
Calcium ppm ASTM D5185m	0	<1	---	---
Phosphorus ppm ASTM D5185m	0	12	---	---
Zinc ppm ASTM D5185m	0	4	---	---
Sulfur ppm ASTM D5185m	23500	21685	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	2	---	---
Sodium ppm ASTM D5185m		11	---	---
Potassium ppm ASTM D5185m	>20	9	---	---
Water % ASTM D6304	>0.05	0.028	---	---
ppm Water ppm ASTM D6304	>500	288.2	---	---

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		21239	---	---
Particles >6µm ASTM D7647	>1300	▲ 8631	---	---
Particles >14µm ASTM D7647	>80	▲ 567	---	---
Particles >21µm ASTM D7647	>20	▲ 63	---	---
Particles >38µm ASTM D7647	>4	2	---	---
Particles >71µm ASTM D7647	>3	0	---	---
Oil Cleanliness ISO 4406 (c)	>--/17/13	▲ 22/20/16	---	---

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	1.0	0.43	---	---

OIL ANALYSIS REPORT

▲ Particle Trend

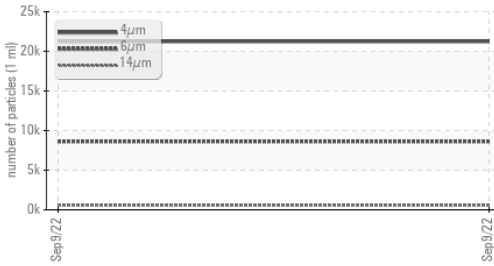


Water (KF)

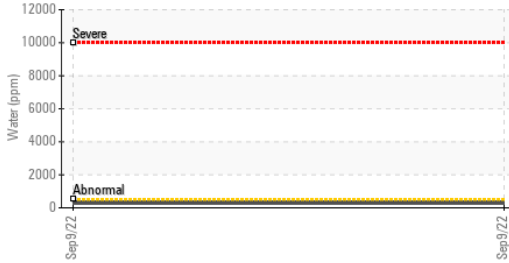


Acid Number



Water (KF)

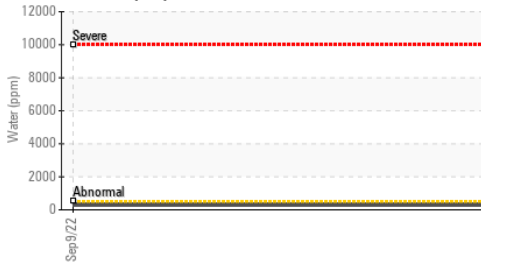

Viscosity @ 40°C

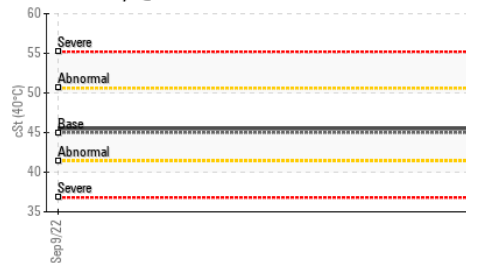

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color		no image	no image
Bottom		no image	no image

GRAPHS

Ferrous Alloys




Non-ferrous Metals

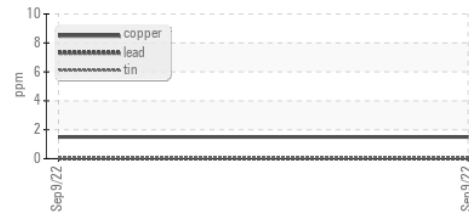


Viscosity @ 40°C



▲ Particle Count

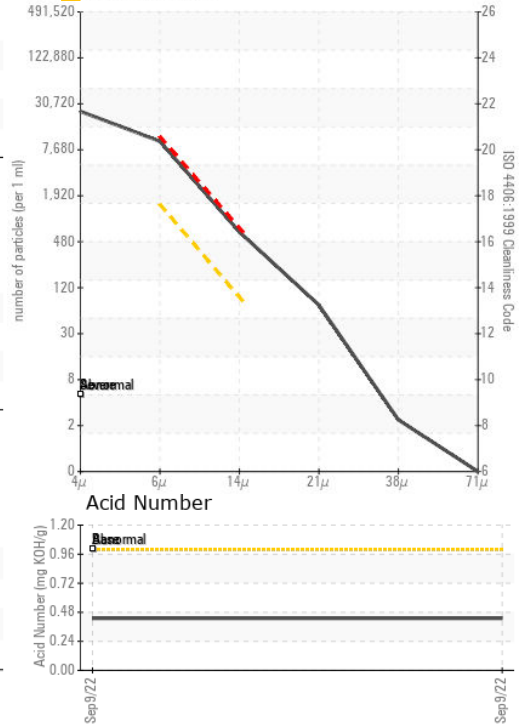

Acid Number

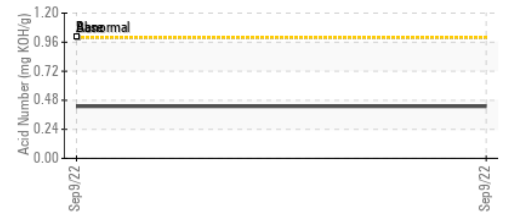

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP49328 **Received** : 22 Sep 2022
Lab Number : 05648924 **Diagnosed** : 26 Sep 2022
Unique Number : 10143463 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMERISOURCE BERGEN
 6301 LA SALLE DR
 LOCKBOURNE, OH
 US 43137
 Contact: M. BAUGHN
 mbaughn@amerisourcebergen.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: