




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

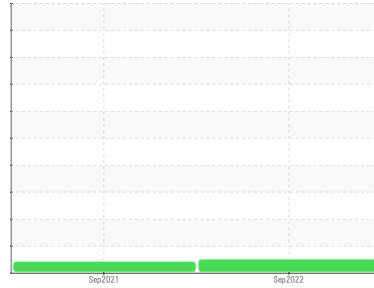

Area
[72886479]
 Machine Id
7264847 (S/N 1460)

Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP30902	KCP41770	---
Sample Date	Client Info			07 Sep 2022	06 Sep 2021	---
Machine Age	hrs	Client Info		9152	4939	---
Oil Age	hrs	Client Info		6000	2000	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				NORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	1	<1	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	3	3	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	13	---
Barium	ppm	ASTM D5185m	90	27	45	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m	100	40	75	---
Calcium	ppm	ASTM D5185m	0	0	<1	---
Phosphorus	ppm	ASTM D5185m	0	0	3	---
Zinc	ppm	ASTM D5185m	0	2	4	---
Sulfur	ppm	ASTM D5185m	23500	22983	16361	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	---
Sodium	ppm	ASTM D5185m		16	14	---
Potassium	ppm	ASTM D5185m	>20	3	5	---
Water	%	ASTM D6304	>0.05	0.014	0.020	---
ppm Water	ppm	ASTM D6304	>500	141.5	208.0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2695	---	---
Particles >6µm		ASTM D7647	>1300	656	---	---
Particles >14µm		ASTM D7647	>80	33	---	---
Particles >21µm		ASTM D7647	>20	5	---	---
Particles >38µm		ASTM D7647	>4	0	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	19/17/12	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.38	0.380	---


OIL ANALYSIS REPORT

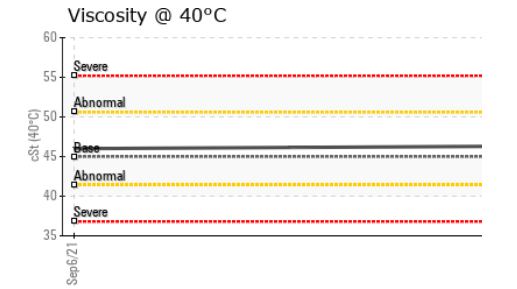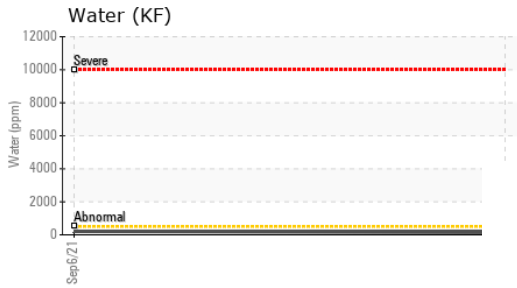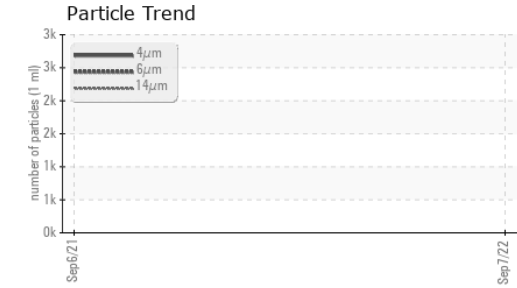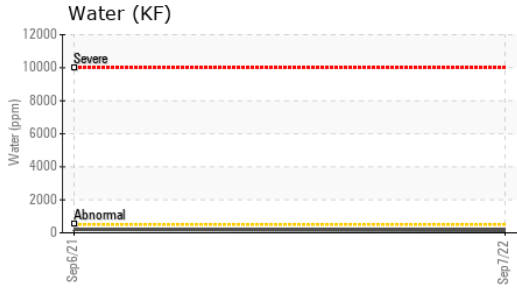






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.3	46.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

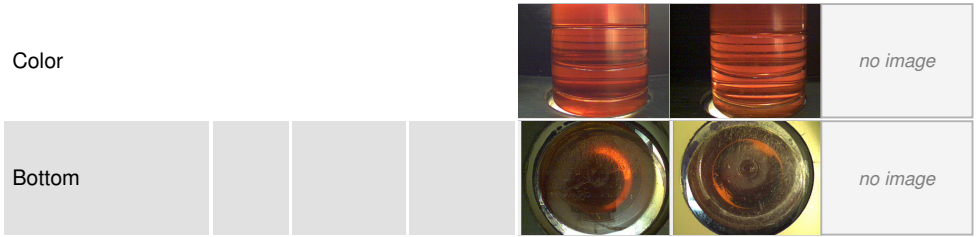

GRAPHS

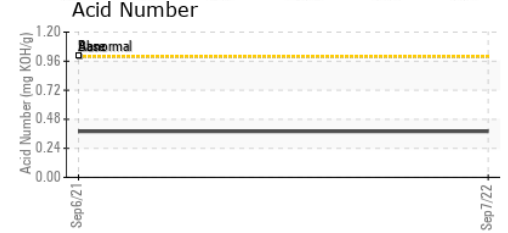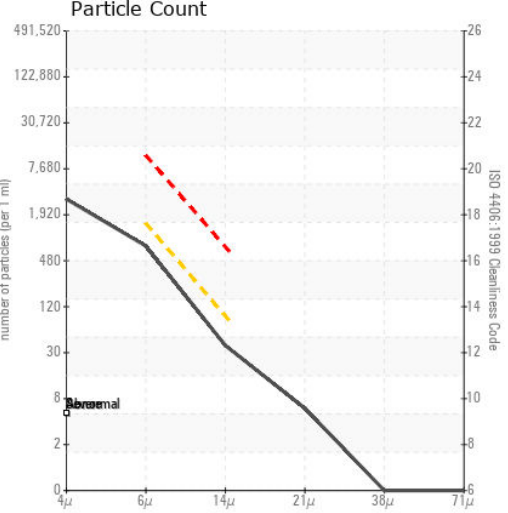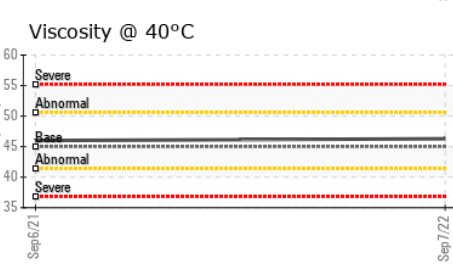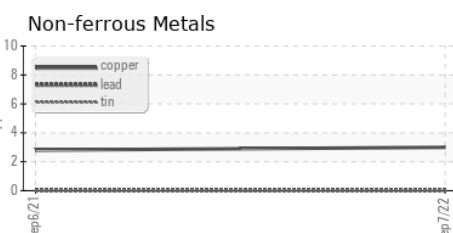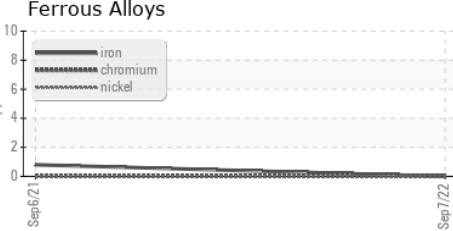

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP30902 **Received** : 23 Sep 2022
Lab Number : 05649790 **Diagnosed** : 27 Sep 2022
Unique Number : 10149342 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SILICON VALLEY MFG
 6520 CENTROL AVE
 NEWARK, CA
 US 94560
 Contact: CAITLIN N.
 caitlin_n@svmfg.com
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)