




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

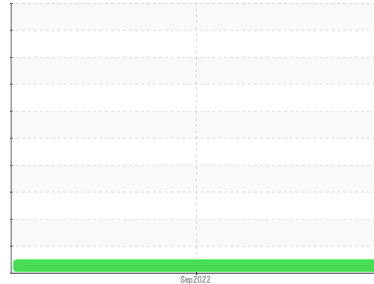

Machine Id
48192684 (S/N R-02565)

Component
Hydraulic System

Fluid
MOBIL DTE 24 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0731032	---	---
Sample Date	Client Info	26 Sep 2022	---	---
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		NORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >20	8	---	---
Chromium ppm	ASTM D5185m >20	0	---	---
Nickel ppm	ASTM D5185m >20	0	---	---
Titanium ppm	ASTM D5185m	0	---	---
Silver ppm	ASTM D5185m	0	---	---
Aluminum ppm	ASTM D5185m >20	<1	---	---
Lead ppm	ASTM D5185m >20	2	---	---
Copper ppm	ASTM D5185m >20	17	---	---
Tin ppm	ASTM D5185m >20	<1	---	---
Vanadium ppm	ASTM D5185m	0	---	---
Cadmium ppm	ASTM D5185m	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	0	---	---
Barium ppm	ASTM D5185m	3	---	---
Molybdenum ppm	ASTM D5185m	2	---	---
Manganese ppm	ASTM D5185m	<1	---	---
Magnesium ppm	ASTM D5185m	9	---	---
Calcium ppm	ASTM D5185m	162	---	---
Phosphorus ppm	ASTM D5185m	470	---	---
Zinc ppm	ASTM D5185m	699	---	---
Sulfur ppm	ASTM D5185m	5681	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >15	2	---	---
Sodium ppm	ASTM D5185m	0	---	---
Potassium ppm	ASTM D5185m >20	1	---	---

FLUID CLEANLINESS





method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	681	---	---
Particles >6µm	ASTM D7647 >1300	108	---	---
Particles >14µm	ASTM D7647 >160	6	---	---
Particles >21µm	ASTM D7647 >40	1	---	---
Particles >38µm	ASTM D7647 >10	0	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >19/17/14	17/14/10	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045	0.92	---	---



OIL ANALYSIS REPORT

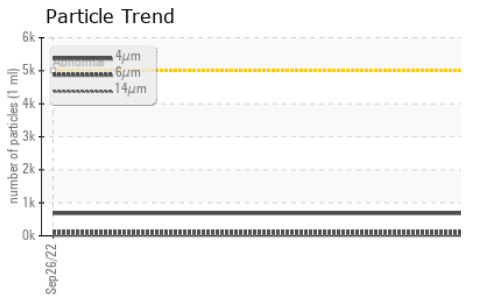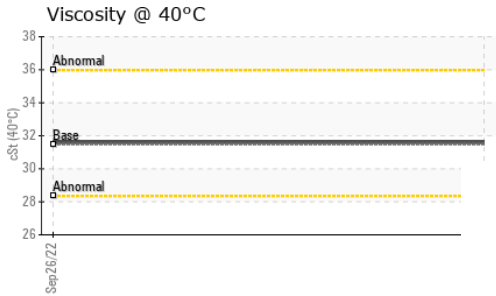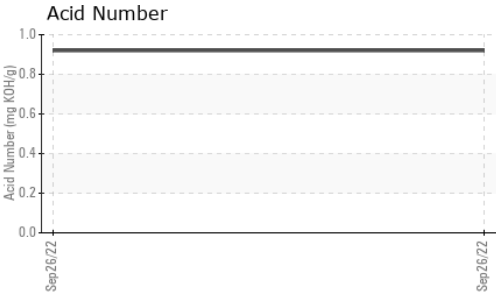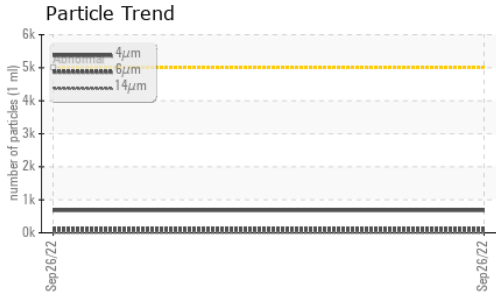





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	31.5	31.6	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

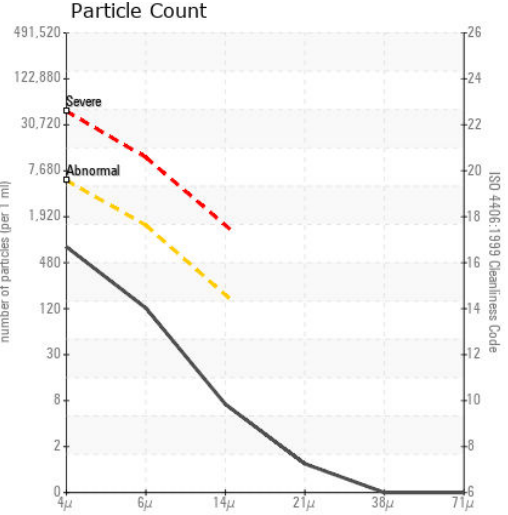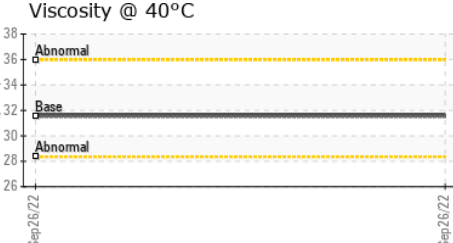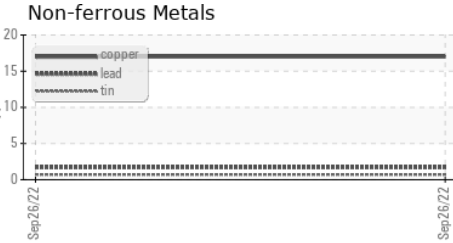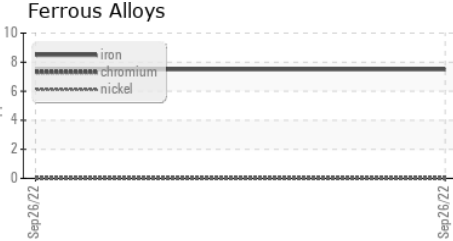

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0731032 **Received** : 27 Sep 2022
Lab Number : 05651497 **Diagnosed** : 28 Sep 2022
Unique Number : 10151049 **Diagnostician** : Angela Borella
Test Package : PLANT

TE CONNECTIVITY
 719 PEGG RD
 GREENSBORO, NC
 US 27409
 Contact: BILLIE WALLACE
 billie.wallace@te.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: