




# KAESER 6325768

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- QTS)

# COMPONENT CONDITION SUMMARY

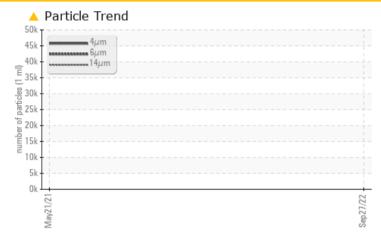

# RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### **PROBLEMATIC TEST RESULTS** Sample Status ABNORMAL ABNORMAL Particles >6µm ASTM D7647 >1300 21890 Particles >14µm ASTM D7647 >80 **1780** Particles >21µm ASTM D7647 >20 330 **Oil Cleanliness** ISO 4406 (c) >17/13 **22/18**


Customer Id: RICHUB Sample No.: KCP30932 Lab Number: 05653308 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

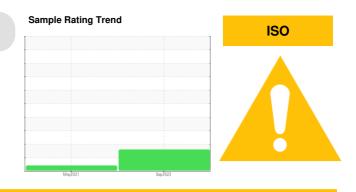

RECOMMENDED ACTIONS									
Action	Status	Date	Done By	Description					
Change Fluid			?	Oil and filter change at the time of sampling has been noted.					
Change Filter			?	Oil and filter change at the time of sampling has been noted.					

# HISTORICAL DIAGNOSIS



# 21 May 2021 Diag: Don Baldridge

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

# Sample Rating Trend

ISO



#### Component Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- QTS)

# DIAGNOSIS

Machine Id

## Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

# Wear

All component wear rates are normal.

# Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			May2021	Sep2022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP30932	KCP33395	
Sample Date		Client Info		27 Sep 2022	21 May 2021	
Machine Age	hrs	Client Info		9237	6325	
Oil Age	hrs	Client Info		3000	3000	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	7	7	
Tin	ppm	ASTM D5185m	>10	0	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	<1	
	ppiii		11 11 11	-		
ADDITIVES		method	limit/base		history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	
Barium	ppm	ASTM D5185m	90	0	4	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	35	48	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	2	0	
Zinc	ppm	ASTM D5185m	0	14	0	
Sulfur	ppm	ASTM D5185m	23500	21091	15834	
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		9	18	
Potassium	ppm	ASTM D5185m	>20	<1	2	
Water	%	ASTM D6304	>0.05	0.014	0.019	
ppm Water	ppm	ASTM D6304	>500	149.6	192.8	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		49096		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	3		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>17/13	<b>A</b> 22/18		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.33	0.339	
				O a mta at/l	lan. Camilaa Mar	

Report Id: RICHUB [WUSCAR] 05653308 (Generated: 10/03/2023 09:50:57) Rev: 1

Contact/Location: Service Manager - RICHUB

Page 3 of 4



0.00

12000

10000

4000

200

60

55

() 50 50

-73 45 ę,

40

35

muu 600 Water (

10/10/101

Water (KF)

Abnorma nL May21

Abnorma

Se

Viscosity @ 40°C

Built for a lifetime

# **OIL ANALYSIS REPORT**

method

limit/base

current

history1

history2

Particle Trend	VISUAL
4μm	White Metal
<sup>2</sup> 8 201	Yellow Metal
TO 30K	Precipitate
<sup>μ</sup>	Silt
E 10k -	Debris
0k	Sand/Dirt
May21/21 8ap21/22	Appearance
M av	Odor
Water (KF)	Emulsified Water
12000	Free Water
10000 + Severe	FLUID PROPE
Ē <sup>8000</sup>	
a 4000 6000 6000	Visc @ 40°C
<sup>№</sup> 4000	SAMPLE IMAG
2000 -	
0 Abnormal	
May21/21 Sep21/22	Color
Ma	
Acid Number	
1.20	Bottom
₽0.96 Besemal	20110111
오 쭏0.72	
	GRAPHS
Building         Building           00.050         -           00.072         -           00.040         -           00.040         -           00.040         -           00.040         -           00.040         -           00.040         -	Ferrous Alloys
₹ 0.24	<sup>10</sup>

