




OIL ANALYSIS REPORT

Sample Rating Trend

DIRT



Machine Id
GZJ00403
 Component
Biogas Engine
 Fluid
PETRO CANADA SENTRON CG 40 (--- GAL)

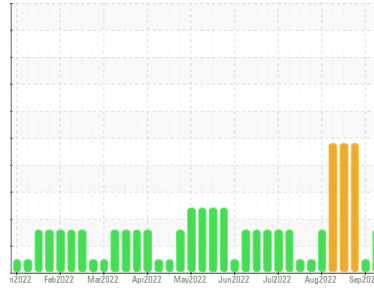

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

Fuel content negligible. Elemental level of silicon (Si) above normal.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0697924	WC0697927	WC0697922
Sample Date	Client Info		27 Sep 2022	19 Sep 2022	12 Sep 2022
Machine Age	hrs	Client Info	108932	108738	108572
Oil Age	hrs	Client Info	513	119	946
Oil Changed	Client Info		Not Chngd	N/A	N/A
Sample Status			ABNORMAL	NORMAL	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >45	4	2	9
Chromium	ppm	ASTM D5185m >2	<1	<1	1
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	<1	0
Aluminum	ppm	ASTM D5185m >10	3	2	5
Lead	ppm	ASTM D5185m >5	2	<1	2
Copper	ppm	ASTM D5185m >14	1	1	7
Tin	ppm	ASTM D5185m >13	3	2	8
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	2	0
Barium	ppm	ASTM D5185m 1	0	0	<1
Molybdenum	ppm	ASTM D5185m 2	1	1	2
Manganese	ppm	ASTM D5185m 1	<1	<1	<1
Magnesium	ppm	ASTM D5185m 9	15	12	12
Calcium	ppm	ASTM D5185m 2712	3098	2777	2928
Phosphorus	ppm	ASTM D5185m 292	321	261	284
Zinc	ppm	ASTM D5185m 342	358	332	348
Sulfur	ppm	ASTM D5185m 2575	4240	3850	3346

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >200	▲ 217	102	▲ 488
Sodium	ppm	ASTM D5185m	<1	0	1
Potassium	ppm	ASTM D5185m >20	0	1	0
Fuel	%	ASTM D3524 >4.0	0.4	0.4	0.3

INFRA-RED






	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	4.7	5.0	5.0
Sulfation	Abs/.1mm	*ASTM D7415 >30	17.9	17.5	21.0

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	8.7	9.4	9.3
Acid Number (AN)	mg KOH/g	ASTM D8045 0.98	0.87	0.76	1.20
Base Number (BN)	mg KOH/g	ASTM D2896 8.1	8.25	7.60	6.52











OIL ANALYSIS REPORT

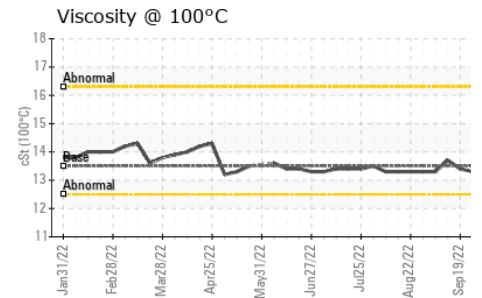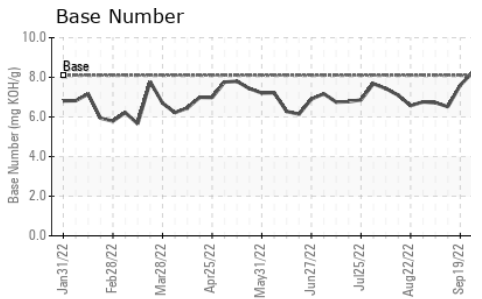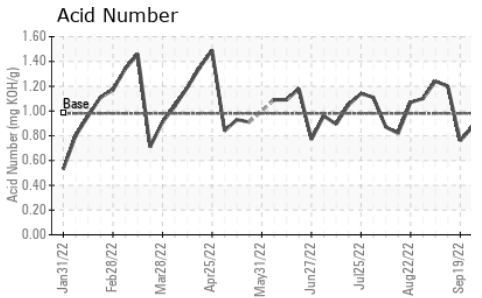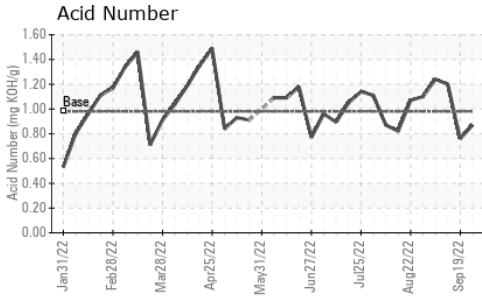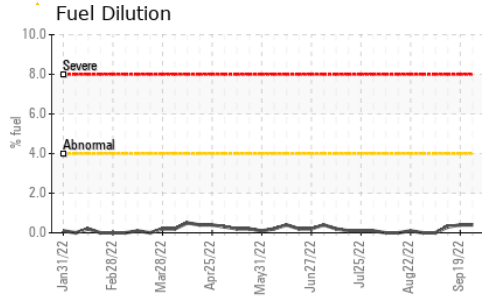

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.5	13.3	13.4

GRAPHS

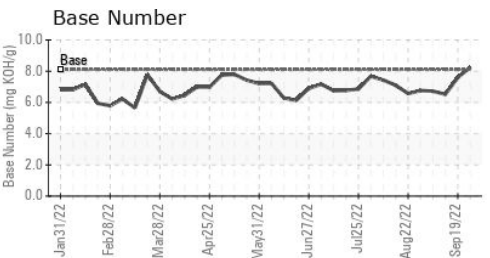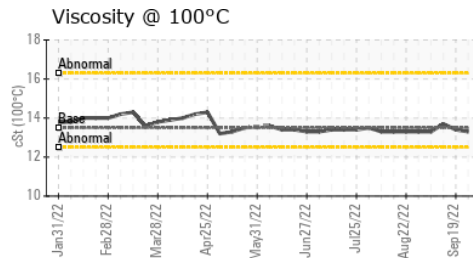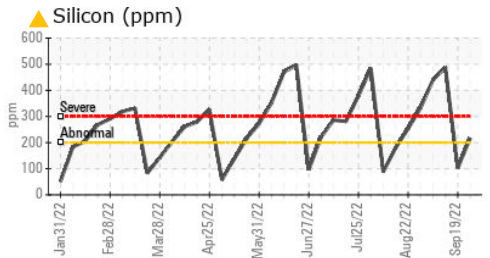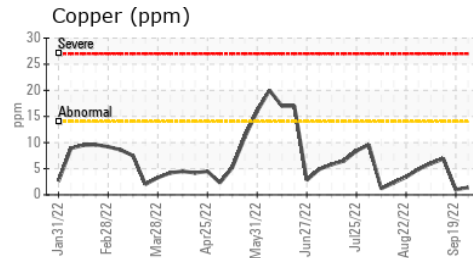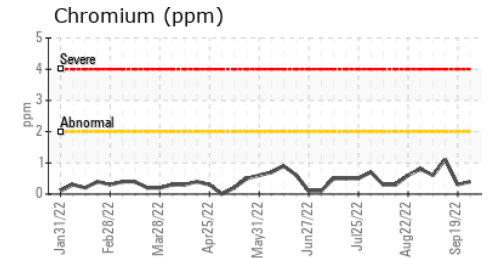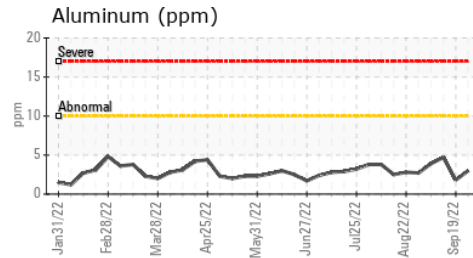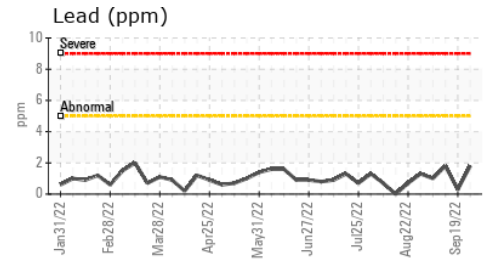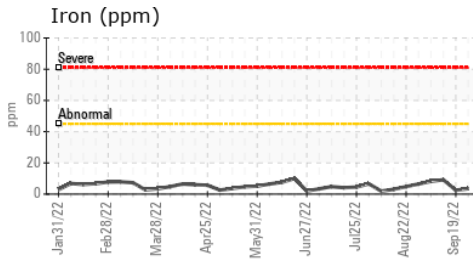

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0697924 **Received** : 30 Sep 2022
Lab Number : 05655810 **Tested** : 04 Oct 2022
Unique Number : 10155362 **Diagnosed** : 04 Oct 2022 - Doug Bogart
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

FINLEY BIOENERGY
 74265 Bombing Range Road
 Boardman, OR
 US 97818
 Contact: Blain Middleton
 bmiddleton@archaea.energy
 T: (541)481-3232

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: