




# PROBLEM SUMMARY

Sample Rating Trend

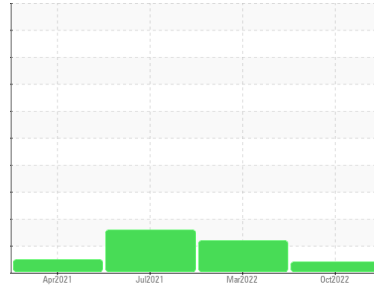


## VISCOSITY



Machine Id  
**KAESER AIRCENTER SK 20 6533823 (S/N 1227)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### COMPONENT CONDITION SUMMARY

▲ Viscosity @ 40°C

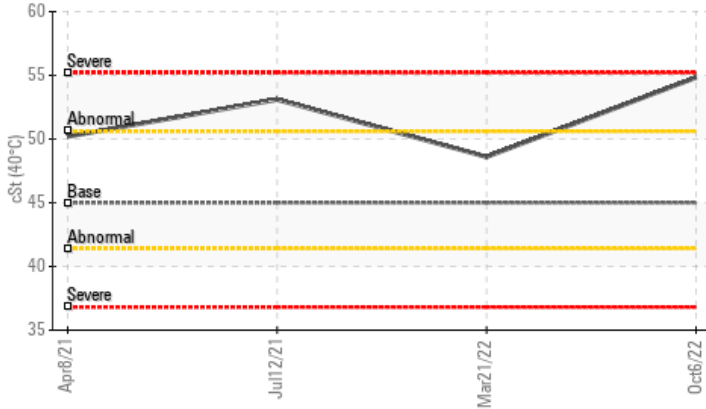

### RECOMMENDATION

No corrective action is recommended at this time.  
 Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	ATTENTION	ABNORMAL
Visc @ 40°C	cSt	ASTM D445	45	▲ 54.83	48.6	53.1

Customer Id: BUZMIL  
 Sample No.: KCP49951  
 Lab Number: 05664112  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 21 Mar 2022 Diag: Don Baldrige

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 12 Jul 2021 Diag: Doug Bogart

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 08 Apr 2021 Diag: Angela Borella

NORMAL




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

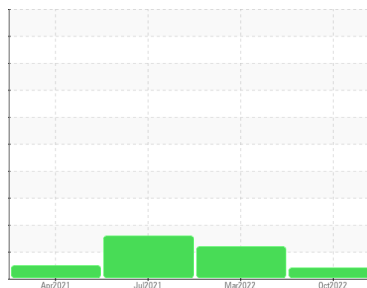

## VISCOSITY



Machine Id  
**KAESER AIRCENTER SK 20 6533823 (S/N 1227)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### ▲ Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCP49951</b>	KCP45291	KCP42344
Sample Date	Client Info			<b>06 Oct 2022</b>	21 Mar 2022	12 Jul 2021
Machine Age	hrs	Client Info		<b>24107</b>	20732	16487
Oil Age	hrs	Client Info		<b>3000</b>	2000	2300
Oil Changed	Client Info			<b>Not Chngd</b>	Not Chngd	Changed
Sample Status				<b>ABNORMAL</b>	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>23</b>	2	9
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	90	<b>2</b>	72	<1
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	100	<b>&lt;1</b>	87	24
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	1	<1
Phosphorus	ppm	ASTM D5185m	0	<b>8</b>	3	<1
Zinc	ppm	ASTM D5185m	0	<b>&lt;1</b>	<1	12
Sulfur	ppm	ASTM D5185m	23500	<b>24025</b>	18384	18809

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>0</b>	5	7
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304	>0.05	<b>0.008</b>	0.021	0.025
ppm Water	ppm	ASTM D6304	>500	<b>87.4</b>	218.2	257.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>5406</b>	9403	18687
Particles >6µm		ASTM D7647	>1300	<b>641</b>	▲ 2156	▲ 5468
Particles >14µm		ASTM D7647	>80	<b>20</b>	▲ 138	▲ 378
Particles >21µm		ASTM D7647	>20	<b>6</b>	▲ 40	▲ 125
Particles >38µm		ASTM D7647	>4	<b>0</b>	2	▲ 7
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/17/11</b>	▲ 18/14	▲ 20/16

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.47</b>	0.44	0.393


# OIL ANALYSIS REPORT

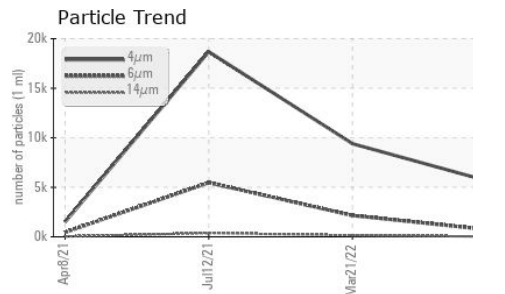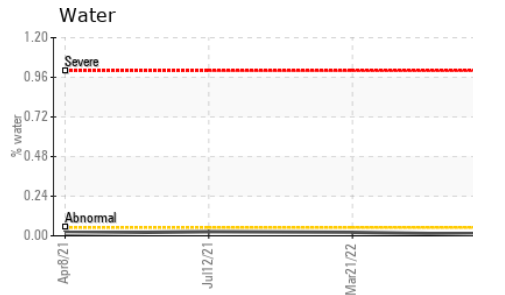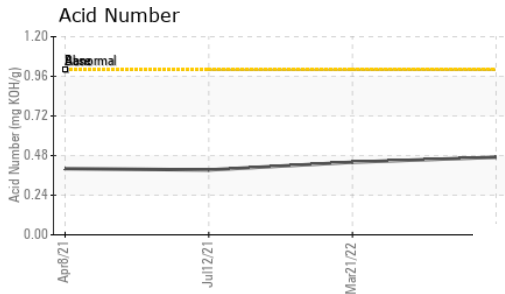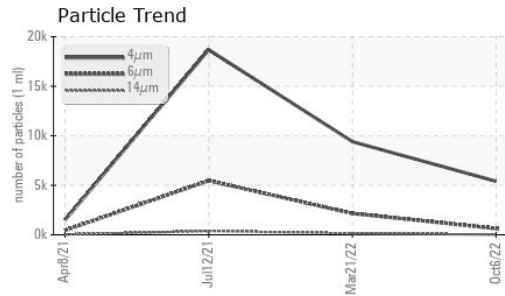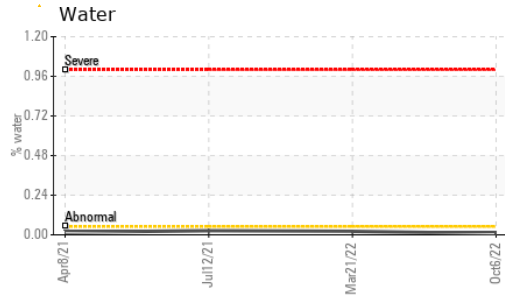






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	45	▲ 54.83	48.6	53.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

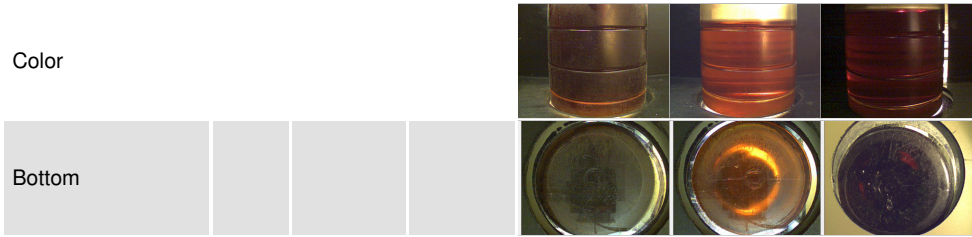

## GRAPHS

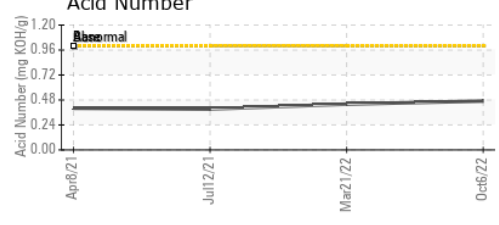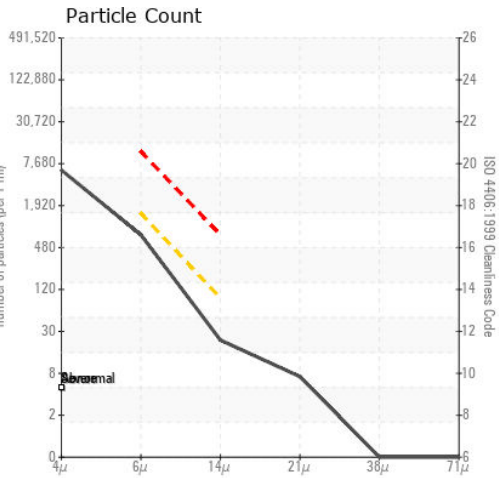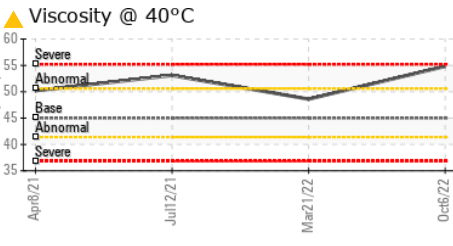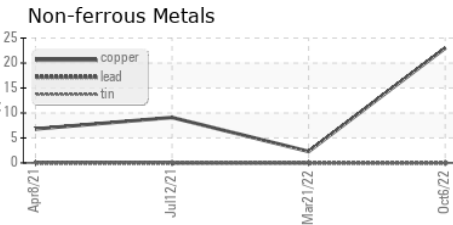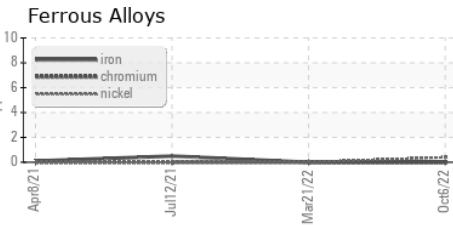

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP49951 **Received** : 11 Oct 2022  
**Lab Number** : 05664112 **Diagnosed** : 14 Oct 2022  
**Unique Number** : 10168681 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**BUZZI UNICEM USA/MILWAUKEE DIST TERMINAL**  
 643 W CANAL ST  
 MILWAUKEE, WI  
 US 53203  
 Contact: MATHEW STORK  
 mathew.stork@buzziunicemusa.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: