

# **PROBLEM SUMMARY**

Sample Rating Trend

ISO


# KAESER 8484385

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **COMPONENT CONDITION SUMMARY**

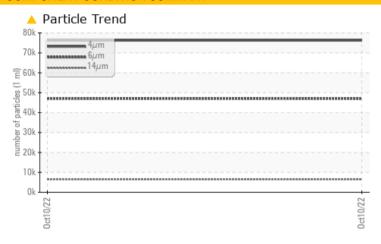

#### RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL					
Particles >6µm	ASTM D7647	>1300	<b>46996</b>					
Particles >14µm	ASTM D7647	>80	<b>△</b> 6515					
Particles >21µm	ASTM D7647	>20	<b>418</b>					
Particles >38µm	ASTM D7647	>4	<u> </u>					
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>23/23/20</b>					

Customer Id: ABSGRA Sample No.: KC106549 Lab Number: 05666992 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS							
Action	Status	Date	Done By	Description			
Change Filter	MISSED	Jan 23 2023	?	We recommend you service the filters on this component.			

# HISTORICAL DIAGNOSIS




**OIL ANALYSIS REPORT** 

# **KAESER 8484385**

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)



### **DIAGNOSIS**

#### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Oct2022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC106549		
Sample Date		Client Info		10 Oct 2022		
Machine Age	hrs	Client Info		332		
Oil Age	hrs	Client Info		332		
Oil Changed		Client Info		Not Changd		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	40		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	74		
Calcium	ppm	ASTM D5185m	0	2		
Phosphorus	ppm	ASTM D5185m	0	1		
Zinc	ppm	ASTM D5185m	0	2		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.035		
ppm Water	ppm	ASTM D6304	>500	357.3		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		76250		
Particles >6μm		ASTM D7647	>1300	<b>46996</b>		
Particles >14μm		ASTM D7647	>80	<u>▲</u> 6515		
Particles >21µm		ASTM D7647	>20	<b>418</b>		
Particles >38µm		ASTM D7647	>4	<u> </u>		
Particles >71µm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>23/23/20</b>		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.39		



## **OIL ANALYSIS REPORT**

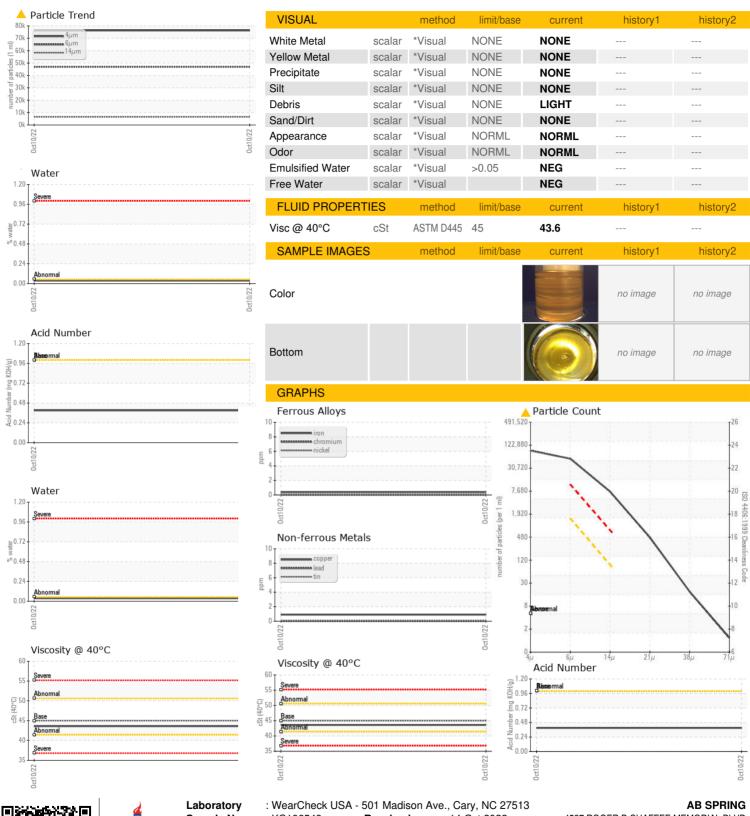



Certificate L2367

Sample No. Lab Number **Unique Number** 

Test Package

: 10176562

: KC106549 : 05666992

: 14 Oct 2022 Received Diagnosed : 19 Oct 2022 Diagnostician : Doug Bogart : IND 2

4537 ROGER B CHAFFEE MEMORIAL BLVD GRAND RAPIDS, MI US 49548

Contact: B. BIALAS bbialas@abspring.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: