



OIL ANALYSIS REPORT

Sample Rating Trend


ISO



Area
Separation
Machine Id
2401-B

Component
Agitator Gearbox
Fluid

MOBIL MOBILGEAR 600 XP ISO 150 (--- GAL)

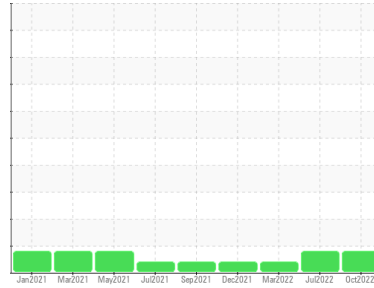

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0724723	WC0687523	WC0670725
Sample Date	Client Info		13 Oct 2022	18 Jul 2022	11 Mar 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ATTENTION	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >150	0	1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >10	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	2
Aluminum	ppm	ASTM D5185m >25	7	0	<1
Lead	ppm	ASTM D5185m >100	2	0	<1
Copper	ppm	ASTM D5185m >50	0	0	0
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	14	24	25
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m	5	<1	0
Calcium	ppm	ASTM D5185m	0	<1	0
Phosphorus	ppm	ASTM D5185m	340	306	342
Zinc	ppm	ASTM D5185m	5	6	4
Sulfur	ppm	ASTM D5185m	19261	17566	15219

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<1	<1	<1
Sodium	ppm	ASTM D5185m	1	<1	0
Potassium	ppm	ASTM D5185m >20	4	<1	0
Water	%	ASTM D6304 >0.1	0.007	0.009	0.005
ppm Water	ppm	ASTM D6304 >1000	76.5	97.3	54.4

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 28548	▲ 23961	▲ 25367
Particles >6µm	ASTM D7647	>5000	3171	3019	2979
Particles >14µm	ASTM D7647	>640	76	72	51
Particles >21µm	ASTM D7647	>160	14	12	10
Particles >38µm	ASTM D7647	>40	1	2	0
Particles >71µm	ASTM D7647	>10	0	1	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 22/19/13	▲ 22/19/13	▲ 22/19/13


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.76	0.76	0.78




OIL ANALYSIS REPORT


Particle Trend

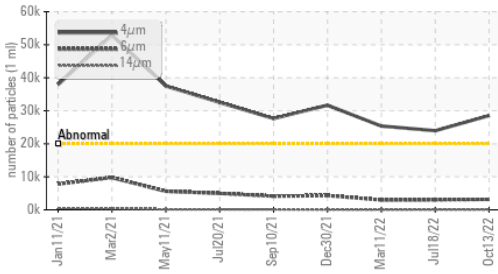


Water (KF)

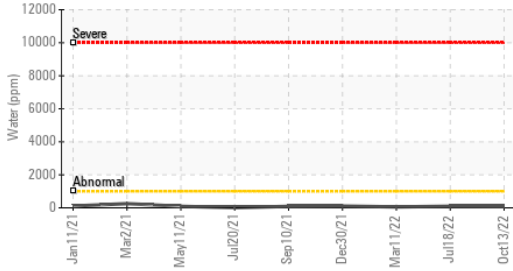


Acid Number

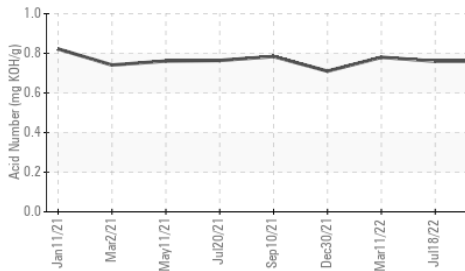

Water (KF)

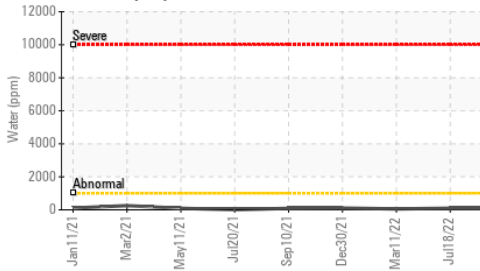


Viscosity @ 40°C

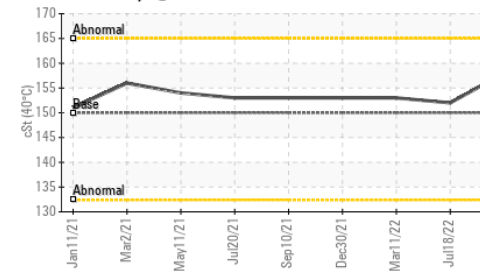

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	158	152

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

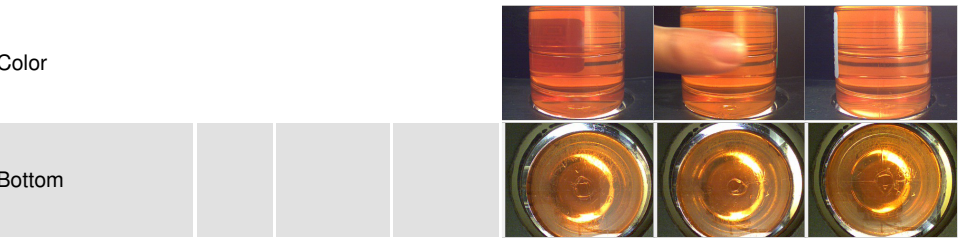


GRAPHS


Ferrous Alloys

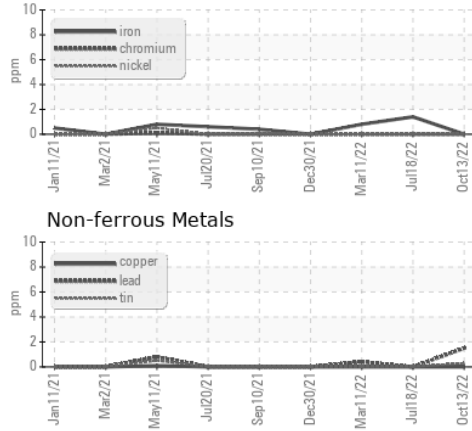


Non-ferrous Metals

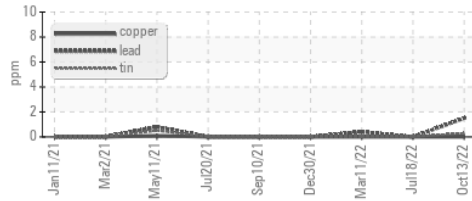


Viscosity @ 40°C

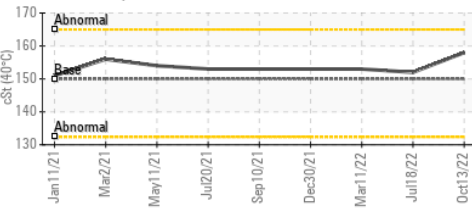

Particle Count

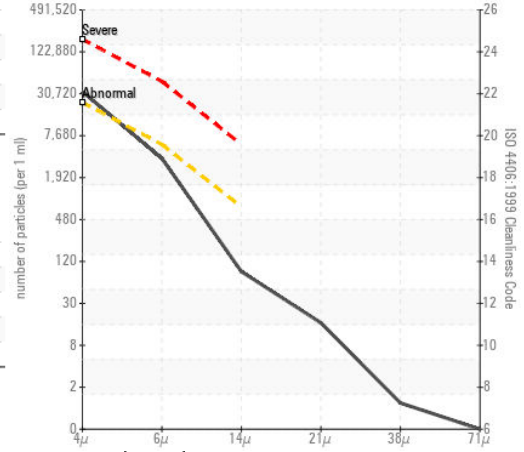

Acid Number

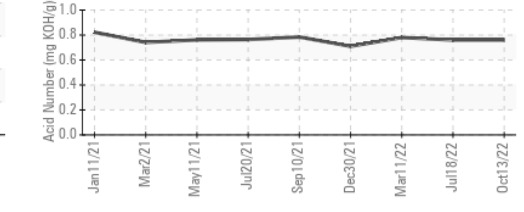

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0724723 **Received** : 18 Oct 2022
Lab Number : 05670003 **Diagnosed** : 20 Oct 2022
Unique Number : 10179573 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AJINOMOTO USA
 4020 AJINOMOTO DRIVE
 RALEIGH, NC
 US 27610
 Contact: Michael Thompson
 thompsonm@ajiusa.com
 T: (919)723-2142
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)