




# OIL ANALYSIS REPORT

Sample Rating Trend

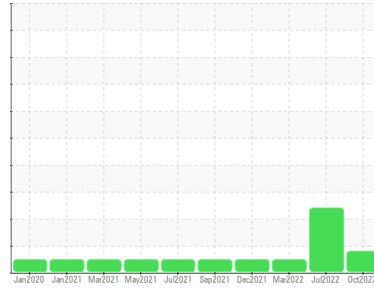

## CONTAMINANT



Area  
**P1**  
Machine Id  
**3104 - 3101 EVAPORATOR**  
Component  
**Gearbox**  
Fluid  
**MOBIL MOBILGEAR 600 XP ISO 150 (15 QTS)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

Appearance is hazy. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0724719</b>	WC0723566	WC0681504
Sample Date	Client Info		<b>20 Oct 2022</b>	28 Jul 2022	29 Mar 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ATTENTION</b>	ATTENTION	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	<b>67</b>	53	13
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>2</b>	1	2
Silver	ppm	ASTM D5185m		<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m	>100	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>200	<b>7</b>	8	0
Tin	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>39</b>	18	29
Barium	ppm	ASTM D5185m		<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>3</b>	2	0
Manganese	ppm	ASTM D5185m		<b>1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>4</b>	<1	0
Calcium	ppm	ASTM D5185m		<b>17</b>	8	2
Phosphorus	ppm	ASTM D5185m		<b>329</b>	327	373
Zinc	ppm	ASTM D5185m		<b>14</b>	7	0
Sulfur	ppm	ASTM D5185m		<b>16828</b>	16228	13013

### CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	<b>1</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	1	<1
Potassium	ppm	ASTM D5185m	>20	<b>9</b>	0	0
Water	%	ASTM D6304	>0.2	<b>0.110</b>	▲ 0.328	0.006
ppm Water	ppm	ASTM D6304	>2000	<b>1105.7</b>	▲ 3280	61.1

### FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>113951</b>	141870	46634
Particles >6µm	ASTM D7647	>40000	<b>18735</b>	24743	13228
Particles >14µm	ASTM D7647	>10000	<b>273</b>	341	555
Particles >21µm	ASTM D7647	>2500	<b>36</b>	49	185
Particles >38µm	ASTM D7647	>640	<b>2</b>	4	51
Particles >71µm	ASTM D7647	>160	<b>0</b>	0	19
Oil Cleanliness	ISO 4406 (c)	>22/20	<b>21/15</b>	22/16	23/21/16

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>1.13</b>	1.16	0.773




# OIL ANALYSIS REPORT

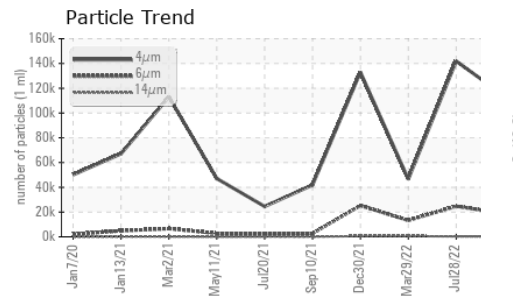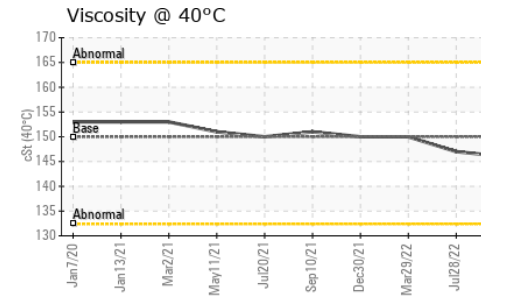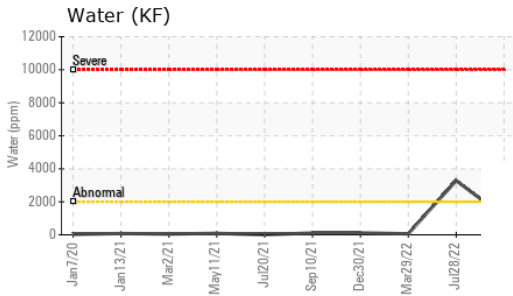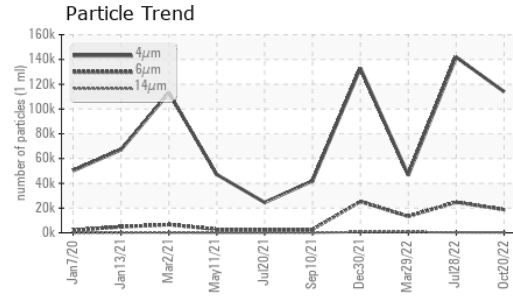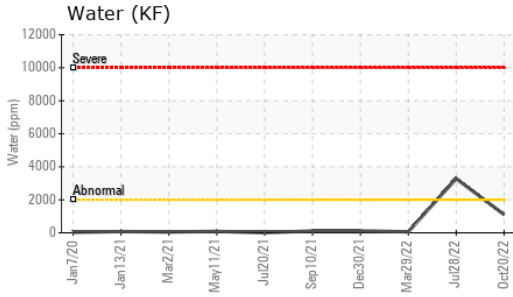






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	▲ HAZY	▲ HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	0.2%
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	146	147

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

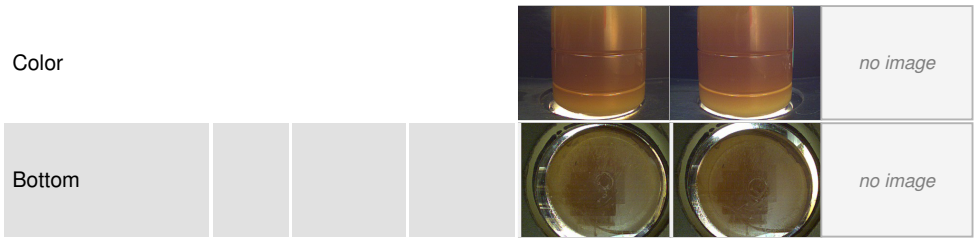

## GRAPHS

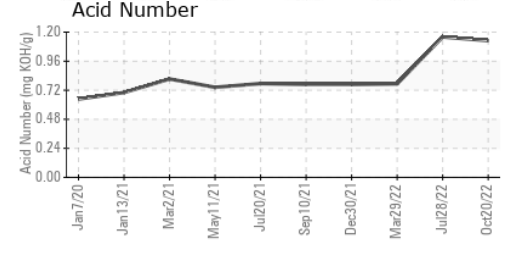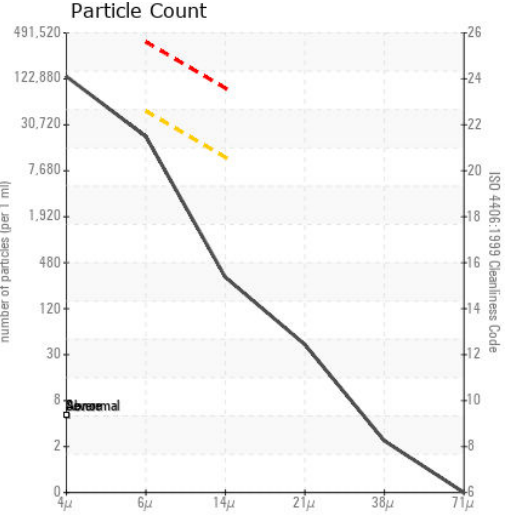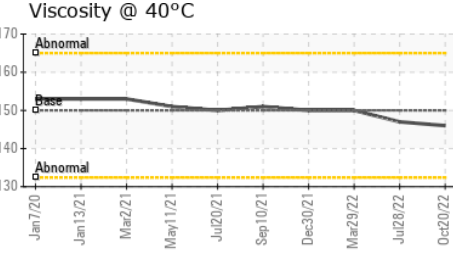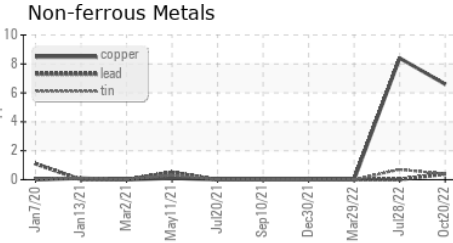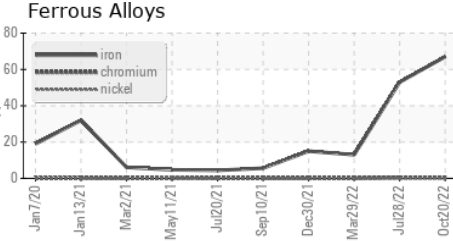

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0724719 **Received** : 21 Oct 2022  
**Lab Number** : 05673474 **Diagnosed** : 24 Oct 2022  
**Unique Number** : 10183044 **Diagnostician** : Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AJINOMOTO USA**  
 4020 AJINOMOTO DRIVE  
 RALEIGH, NC  
 US 27610  
 Contact: Michael Thompson  
 thompsonm@ajiusa.com  
 T: (919)723-2142  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)