


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



TURBINA 17 (S/N 101068)

Hydraulic System

SHELL TELLUS S2 VX 32 (320 LTR)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug2022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC05674242		
Sample Date		Client Info		05 Aug 2022		
Machine Age	mths	Client Info		0		
Oil Age	mths	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	4		
Chromium	ppm	ASTM D5185m	>20	<1		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		2		
Aluminum	ppm	ASTM D5185m	>20	0		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>20	6		
Tin	ppm	ASTM D5185m	>20	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m		10		
Calcium	ppm	ASTM D5185m		18		
Phosphorus	ppm	ASTM D5185m		292		
Zinc	ppm	ASTM D5185m		326		
Sulfur	ppm	ASTM D5185m		1619		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.004		
ppm Water	ppm	ASTM D6304	>500	41.1		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		313		
Particles >6µm		ASTM D7647	>5000	60		
Particles >14μm		ASTM D7647	>640	9		
Particles >21µm		ASTM D7647	>160	3		
Particles >38μm		ASTM D7647	>40	0		
Particles >71μm		ASTM D7647	>10	0		
Oil Cleanliness		ISO 4406 (c)	>/19/16	15/13/10		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A si al Niversala ser (ANI)	I/OII/-	ACTM DOOM		0.20		


Acid Number (AN)

mg KOH/g ASTM D8045

0.30



OIL ANALYSIS REPORT

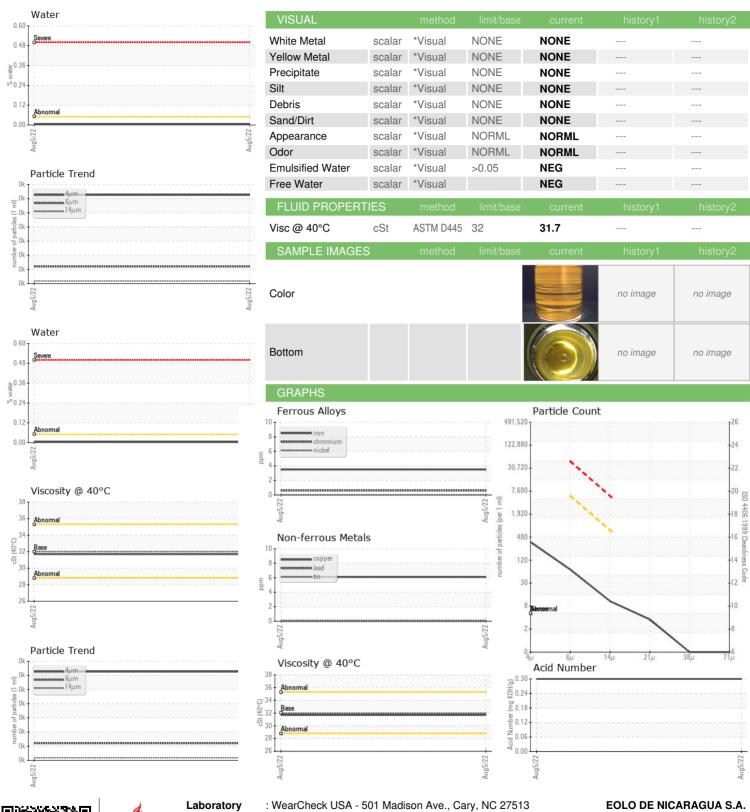





Certificate L2367

Sample No. Lab Number **Unique Number**

: WC05674242

: 05674242 : 10188813 Received : 24 Oct 2022

Diagnosed : 25 Oct 2022 Diagnostician : Don Baldridge Test Package : IND 2 (Additional Tests: KF)

DEL SEMAFORO DEL CLUB TERRAZA, 1 CUADRA AL SUR MANAGUA, ZZ

NΙ

Contact: Rafael Bermudez

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: