


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



TURBINA 18 (S/N 101292)

Hydraulic System

SHELL TELLUS S2 VX 32 (320 LTR)

 I A	\sim	10	0	10
ПΑ	(7	VС	5	5

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug2022		
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC05674252		
Sample Date		Client Info		08 Aug 2022		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	6		
Chromium	ppm	ASTM D5185m	>20	8		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		<1		
Aluminum	ppm	ASTM D5185m	>20	0		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>20	5		
Tin	ppm	ASTM D5185m	>20	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m		20		
Calcium	ppm	ASTM D5185m		16		
Phosphorus	ppm	ASTM D5185m		302		
Zinc	ppm	ASTM D5185m		303		
Sulfur	ppm	ASTM D5185m		6402		
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.004		
ppm Water	ppm	ASTM D6304	>500	41.4		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2713		
Particles >6µm		ASTM D7647	>5000	456		
Particles >14µm		ASTM D7647	>640	59		
Particles >21µm		ASTM D7647	>160	20		
Particles >38µm		ASTM D7647	>40	3		
Particles >71µm		ASTM D7647	>10	0		
Oil Cleanliness		ISO 4406 (c)	>/19/16	19/16/13		
FLUID DEGRADA	ATION _	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045

0.32



OIL ANALYSIS REPORT

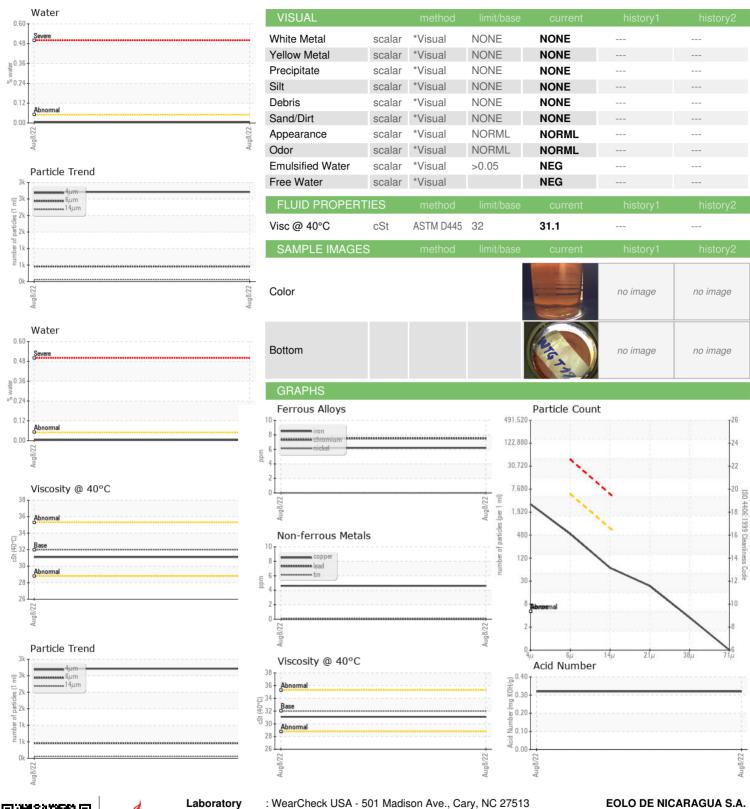





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: WC05674252

: 05674252 : 10188823 Test Package : IND 2 (Additional Tests: KF)

Received : 24 Oct 2022

Diagnosed Diagnostician : Don Baldridge

: 25 Oct 2022

EOLO DE NICARAGUA S.A.

DEL SEMAFORO DEL CLUB TERRAZA, 1 CUADRA AL SUR MANAGUA, ZZ

NΙ

Contact: Rafael Bermudez

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: