




PROBLEM SUMMARY

Sample Rating Trend

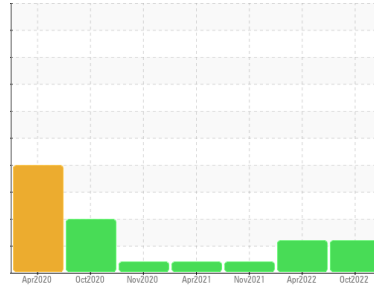


Machine Id
7027987 (S/N 1229)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

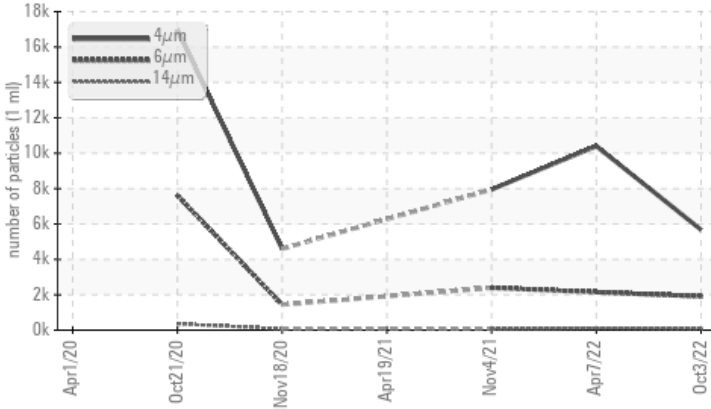

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ATTENTION	ATTENTION
Particles >6µm	ASTM D7647	>1300	▲ 1909	▲ 2146	▲ 2392
Particles >14µm	ASTM D7647	>80	▲ 87	▲ 111	60
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	▲ 18/14	▲ 18/13

Customer Id: AMABALMAR
Sample No.: KCP46938
Lab Number: 05675069
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

07 Apr 2022 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



04 Nov 2021 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



19 Apr 2021 Diag: Jonathan Hester

VIS DEBRIS




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



OIL ANALYSIS REPORT

Sample Rating Trend

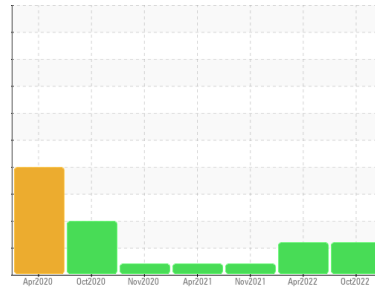

ISO



Machine Id
7027987 (S/N 1229)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCP46938	KCP44674	KCP39778
Sample Date	Client Info	03 Oct 2022	07 Apr 2022	04 Nov 2021
Machine Age	hrs	10437	8104	6142
Oil Age	hrs	2333	0	2780
Oil Changed	Client Info	Changed	Changed	Changed
Sample Status		ATTENTION	ATTENTION	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	0	<1	<1
Chromium	ppm ASTM D5185m >10	0	0	0
Nickel	ppm ASTM D5185m >3	0	0	0
Titanium	ppm ASTM D5185m >3	0	0	0
Silver	ppm ASTM D5185m >2	0	0	0
Aluminum	ppm ASTM D5185m >10	0	<1	<1
Lead	ppm ASTM D5185m >10	0	0	0
Copper	ppm ASTM D5185m >50	<1	1	1
Tin	ppm ASTM D5185m >10	0	0	0
Antimony	ppm ASTM D5185m	---	---	0
Vanadium	ppm ASTM D5185m	<1	0	<1
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 0	0	<1	19
Barium	ppm ASTM D5185m 90	0	22	8
Molybdenum	ppm ASTM D5185m 0	0	0	0
Manganese	ppm ASTM D5185m	<1	0	<1
Magnesium	ppm ASTM D5185m 100	57	78	75
Calcium	ppm ASTM D5185m 0	0	2	1
Phosphorus	ppm ASTM D5185m 0	16	15	2
Zinc	ppm ASTM D5185m 0	0	3	12
Sulfur	ppm ASTM D5185m 23500	23707	16644	23990

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	2	1	1
Sodium	ppm ASTM D5185m	12	14	21
Potassium	ppm ASTM D5185m >20	<1	<1	5
Water	% ASTM D6304 >0.05	0.025	0.020	0.020
ppm Water	ppm ASTM D6304 >500	253.5	206.7	206.5






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	5674	10402	7951
Particles >6µm	ASTM D7647 >1300	▲ 1909	▲ 2146	▲ 2392
Particles >14µm	ASTM D7647 >80	▲ 87	▲ 111	60
Particles >21µm	ASTM D7647 >20	19	▲ 21	11
Particles >38µm	ASTM D7647 >4	1	0	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/18/14	▲ 18/14	▲ 18/13

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 1.0	0.37	0.38	0.340

OIL ANALYSIS REPORT

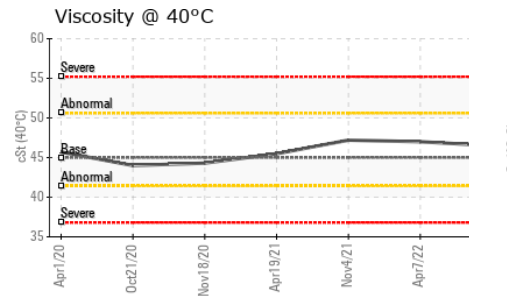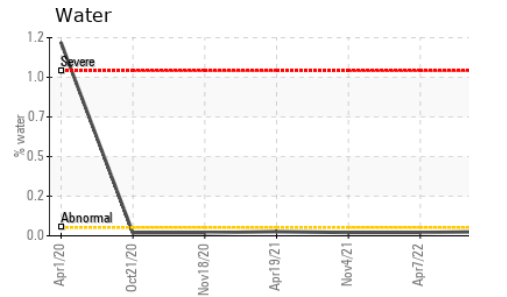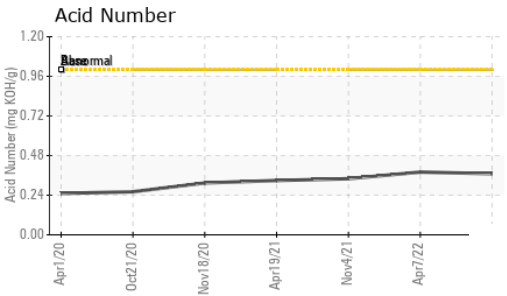
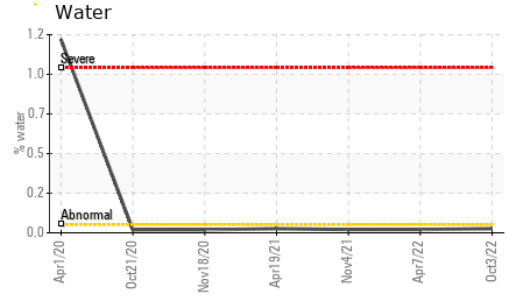
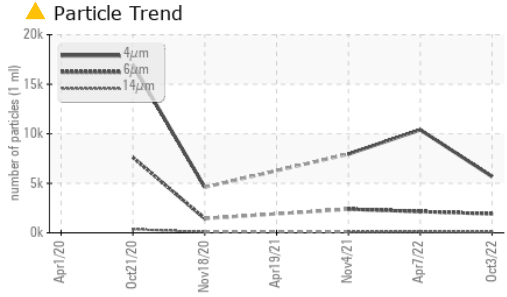


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	46.5	47.0	47.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

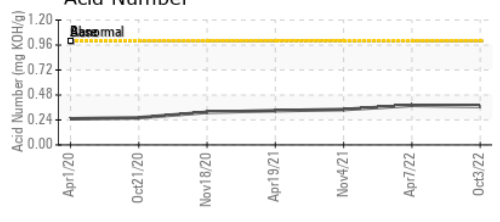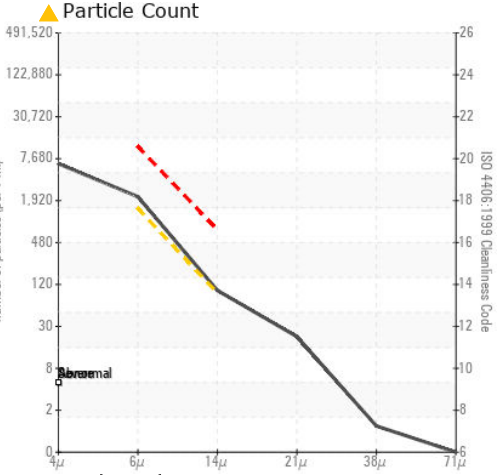

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP46938 **Received** : 24 Oct 2022
Lab Number : 05675069 **Diagnosed** : 27 Oct 2022
Unique Number : 10189640 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMAZON
 1351 MATHISON WAY
 BALTIMORE, MD
 US 21240
 Contact: SERVICE MANAGER
 tacolab@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)