




-

COMPRESSORS

Machine Id 6982353 (S/N 5286) Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

#### COMPONENT CONDITION SUMMARY

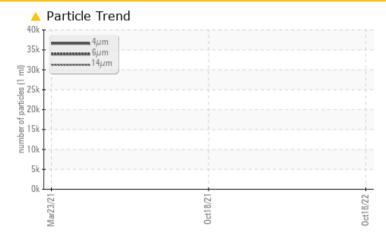

#### RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL		
Particles >6µm	ASTM D7647	>1300	<u> </u>				
Particles >14µm	ASTM D7647	>80	<b>427</b>				
Particles >21µm	ASTM D7647	>20	<u> </u>				
Particles >38µm	ASTM D7647	>4	<b>a</b> 8				
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> </u>				

Customer Id: OAMBRO Sample No.: KCP46628 Lab Number: 05675073 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com



RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Fluid			?	Oil and filter change at the time of sampling has been noted.		
Change Filter			?	Oil and filter change at the time of sampling has been noted.		

#### HISTORICAL DIAGNOSIS



### 18 Oct 2021 Diag: Don Baldridge

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil. Free water present. The AN level is acceptable for this fluid.



#### 23 Mar 2021 Diag: Don Baldridge



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.





## **OIL ANALYSIS REPORT**

SAMPLE INCODMATION

# Sample Rating Trend ISO

Machine Id 6982353 (S/N 5286) Component

Compressor

Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	<b>MATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP46628	KCP39156	KCP10869
Sample Date		Client Info		18 Oct 2022	18 Oct 2021	23 Mar 2021
Machine Age	hrs	Client Info		22707	13957	8944
Oil Age	hrs	Client Info		4500	3000	3000
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	1	<1
Lead	ppm	ASTM D5185m	>10	0	0	2
Copper	ppm	ASTM D5185m	>50	4	6	6
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	22
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	<1	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	16	<1	2
Zinc	ppm	ASTM D5185m	0	0	0	3
Sulfur	ppm	ASTM D5185m	23500	21508	16639	18451
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		1	<1	<1
Potassium	ppm	ASTM D5185m	>20	<1	0	2
Water	%	ASTM D6304	>0.05	0.014	▲ 0.322	0.009
ppm Water	ppm	ASTM D6304	>500	142.1	▲ 3220	94.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		36473		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	🔺 129		
Particles >38µm		ASTM D7647	>4	<mark>/</mark> 8		
Particles >71µm		ASTM D7647		1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>A</b> 22/20/16		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.56	0.509	0.450


Report Id: OAMBRO [WUSCAR] 05675073 (Generated: 09/18/2023 10:35:46) Rev: 1


Contact/Location: ADAM MACLEOD - OAMBRO

#### E C COMPRESSORS Built for a lifetime.

## **OIL ANALYSIS REPORT**






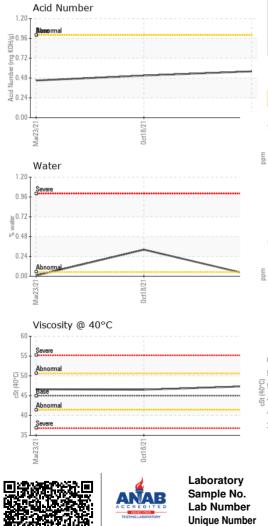

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	A MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	🔺 HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	<u>▲</u> 1.0	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.4	46.5	46.6
SAMPLE IMAGES	5	method	limit/base	current	history1	history2
Color						

Bottom

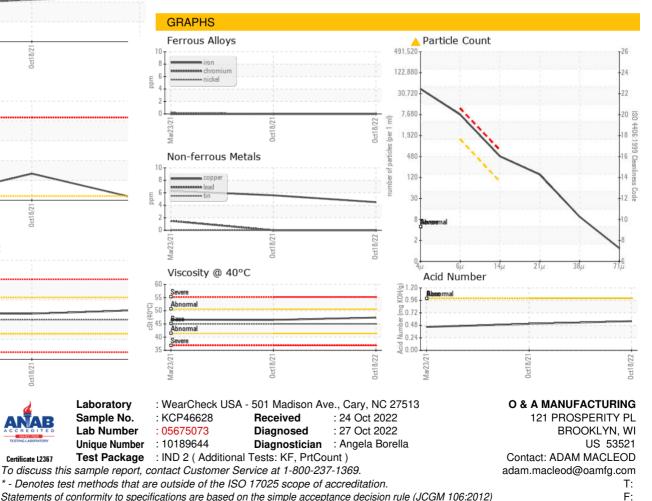

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Contact/Location: ADAM MACLEOD - OAMBRO