


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

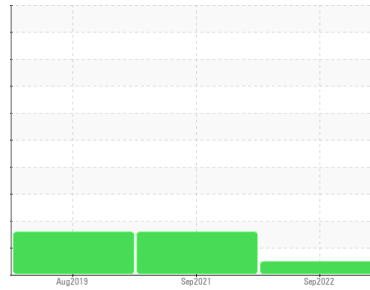

Machine Id
KAESER AS 25T 6697489 (S/N 1250)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCP46985D	KC05384264	KC79483
Sample Date	Client Info		28 Sep 2022	09 Sep 2021	14 Aug 2019
Machine Age	hrs	Client Info	19068	12893	2269
Oil Age	hrs	Client Info	2937	0	0
Oil Changed	Client Info		Changed	Not Changd	Changed
Sample Status			NORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	2	<1	2
Copper	ppm	ASTM D5185m >50	6	9	3
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	<1	0
Vanadium	ppm	ASTM D5185m	<1	0	2
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	27	13	38
Molybdenum	ppm	ASTM D5185m	0	0	<1
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 90	66	51	74
Calcium	ppm	ASTM D5185m 2	0	0	4
Phosphorus	ppm	ASTM D5185m	17	5	2
Zinc	ppm	ASTM D5185m	8	11	9
Sulfur	ppm	ASTM D5185m	22908	16230	17219

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	1	<1	1
Sodium	ppm	ASTM D5185m	50	15	28
Potassium	ppm	ASTM D5185m >20	8	<1	28
Water	%	ASTM D6304 >0.05	0.017	0.025	0.032
ppm Water	ppm	ASTM D6304 >500	170.6	257.5	328.0






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		3138	10924	9125
Particles >6µm	ASTM D7647 >1300		562	▲ 3581	▲ 3765
Particles >14µm	ASTM D7647 >80		31	▲ 462	▲ 386
Particles >21µm	ASTM D7647 >20		8	▲ 143	▲ 111
Particles >38µm	ASTM D7647 >4		0	▲ 7	▲ 8
Particles >71µm	ASTM D7647 >3		0	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13		19/16/12	▲ 19/16	▲ 19/16

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.29	0.348	0.383


OIL ANALYSIS REPORT

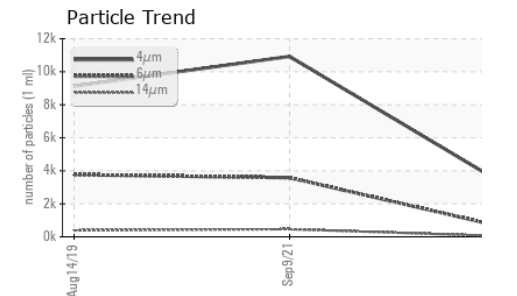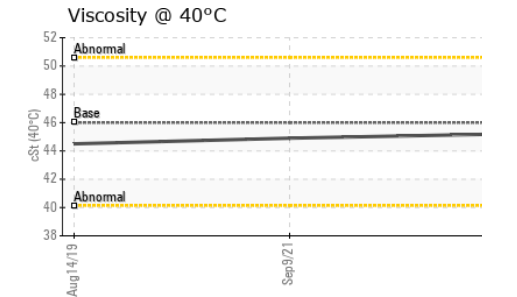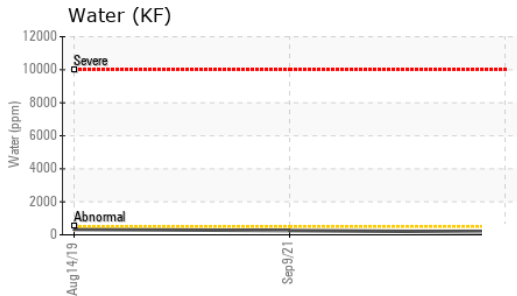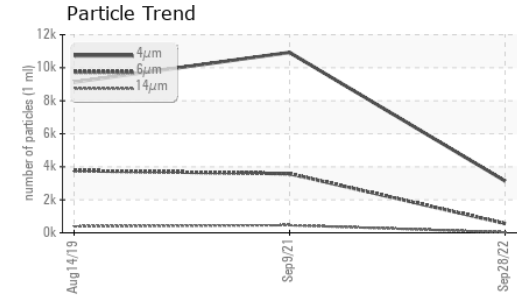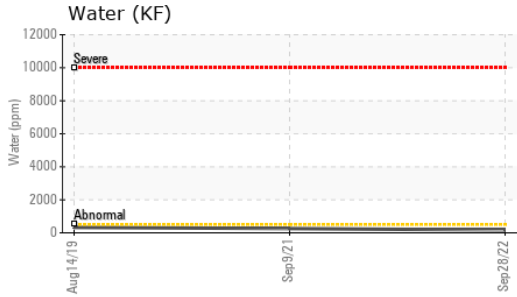






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.2	44.9	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

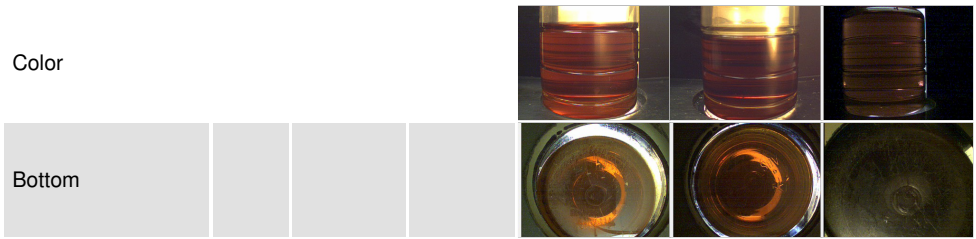

GRAPHS

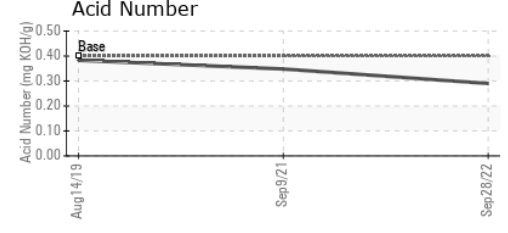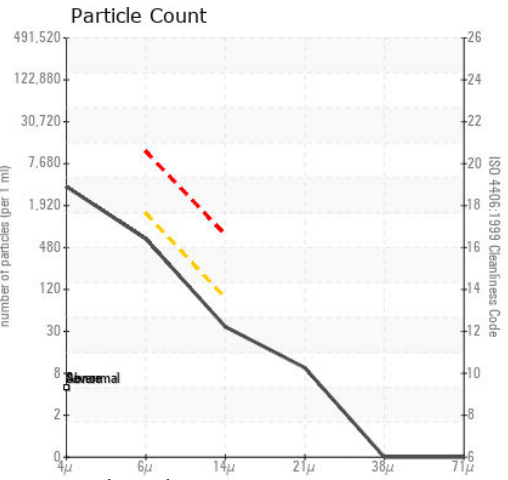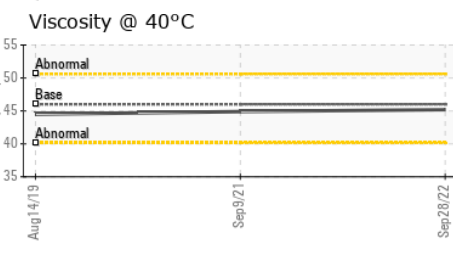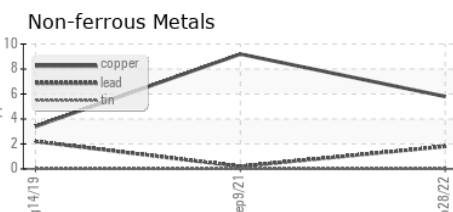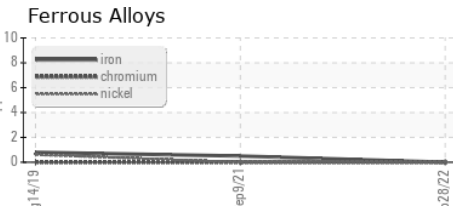

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP46985D **Received** : 24 Oct 2022
Lab Number : 05675098 **Diagnosed** : 27 Oct 2022
Unique Number : 10189669 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ASSOCIATED PRODUCT SERVICES - PROVIDENT MARKETING - JILLAMY PKG
 100 LOUISE DR
 WARMINGTON, PA
 US 18974
 Contact: M. HIGGINS
 mhiggins@apspackage.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: