

OIL ANALYSIS REPORT

Sample Rating Trend

VISCOSITY

MCQUAY 4321 COLLINGTON RD CH 1 (S/N STM1060200229)

Refrigeration Compressor

REFRIG COMP OIL ISO 46 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition


The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.

			Aug2021	Sep2022		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0597105	WC0597107	
Sample Date		Client Info		28 Sep 2022	23 Aug 2021	
Machine Age	hrs	Client Info		695	45830	
Oil Age	hrs	Client Info		695	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				ATTENTION	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	0	4	
Chromium	ppm	ASTM D5185m		0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	<1	
Aluminum	ppm	ASTM D5185m	>50	0	<1	
Lead	ppm	ASTM D5185m		4	<1	
Copper	ppm	ASTM D5185m	>100	1	25	
Tin	ppm	ASTM D5185m		<1	<1	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0	<1	
Barium	ppm	ASTM D5185m	5	0	0	
Molybdenum	ppm	ASTM D5185m	5	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	5	<1	0	
Calcium	ppm	ASTM D5185m	12	0	0	
Phosphorus	ppm	ASTM D5185m	12	19	2	
Zinc	ppm	ASTM D5185m	12	0	25	
Sulfur	ppm	ASTM D5185m	1000	0	28	
CONTAMINANTS	;	method	limit/base	current	history1	history2
0:11:		AOTA DEADE	F0		_	

Silicon	ppm	ASTM D5185m	>50	38	5	
Sodium	ppm	ASTM D5185m		<1	<1	
Potassium	ppm	ASTM D5185m	>20	<1	0	
Water	%	ASTM D6304	>0.02	0.005	0.004	
ppm Water	ppm	ASTM D6304	>250	58.6	40.3	
FLUID DEGRADA	TION					
Acid Number (AN)	mg KOH/g	ASTM D974	0.10	0.028	0.029	



OIL ANALYSIS REPORT

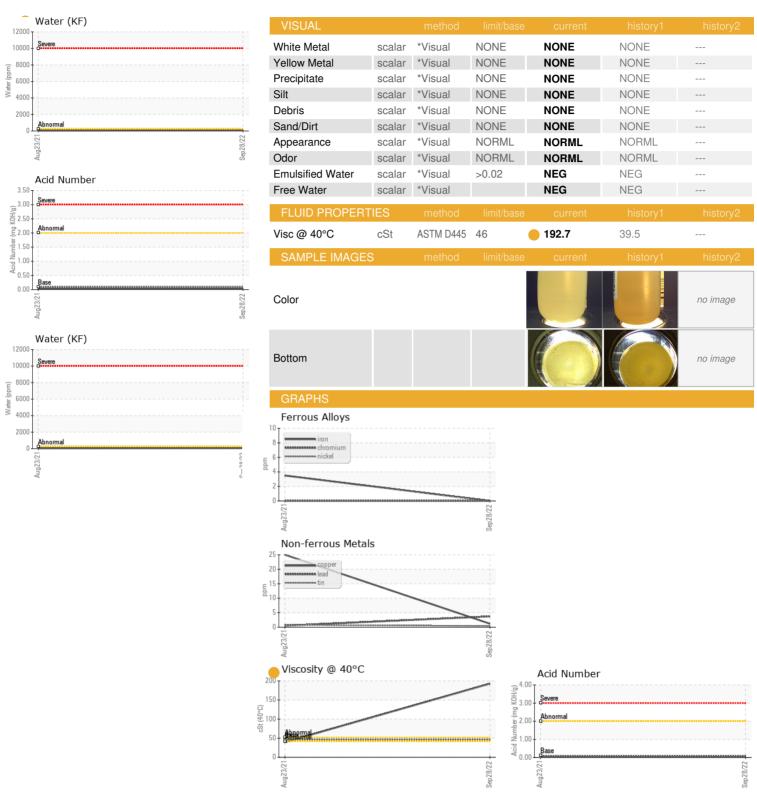





Certificate L2367

Laboratory Sample No.

Lab Number : 05675117 **Unique Number** : 10189688 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0597105 Received : 24 Oct 2022 **Tested** : 28 Oct 2022

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

: 29 Oct 2022 - Doug Bogart

CDS MECHANICAL SERVICES INC

1654 CROFTON BLVD, SUITE 9

CROFTON, MD US 21114

Contact: DAVID BEALE

To discuss this sample report, contact Customer Service at 1-800-237-1369.

DBEALE@CDSMECHANICAL.NET * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Submitted By: ZACH JENSEN

T:

F: