




OIL ANALYSIS REPORT

Sample Rating Trend

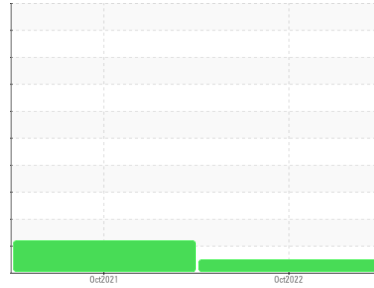

NORMAL



Machine Id
5178179 (S/N 1044)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCP46738D	KCP38948	---
Sample Date	Client Info		12 Oct 2022	22 Oct 2021	---
Machine Age	hrs	Client Info	48845	41169	---
Oil Age	hrs	Client Info	7676	7147	---
Oil Changed	Client Info		Changed	Changed	---
Sample Status			NORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	13	▲ 52	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	1	2	---
Lead	ppm	ASTM D5185m >10	0	0	---
Copper	ppm	ASTM D5185m >50	4	6	---
Tin	ppm	ASTM D5185m >10	<1	0	---
Antimony	ppm	ASTM D5185m	---	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	12	---
Barium	ppm	ASTM D5185m 90	0	16	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	<1	<1	---
Magnesium	ppm	ASTM D5185m 100	35	41	---
Calcium	ppm	ASTM D5185m 0	0	0	---
Phosphorus	ppm	ASTM D5185m 0	0	<1	---
Zinc	ppm	ASTM D5185m 0	79	73	---
Sulfur	ppm	ASTM D5185m 23500	22306	17449	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	8	3	---
Sodium	ppm	ASTM D5185m	7	10	---
Potassium	ppm	ASTM D5185m >20	3	<1	---
Water	%	ASTM D6304 >0.05	0.023	0.018	---
ppm Water	ppm	ASTM D6304 >500	230.9	182.9	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		1615	---	---
Particles >6µm	ASTM D7647	>1300	577	---	---
Particles >14µm	ASTM D7647	>80	37	---	---
Particles >21µm	ASTM D7647	>20	7	---	---
Particles >38µm	ASTM D7647	>4	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	18/16/12	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.39	0.474	---


OIL ANALYSIS REPORT

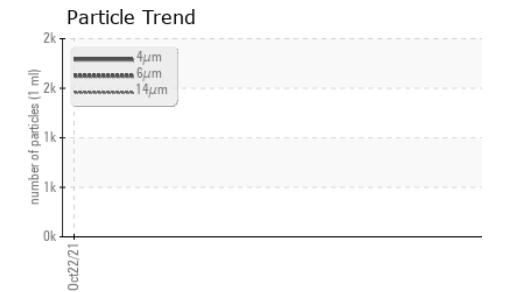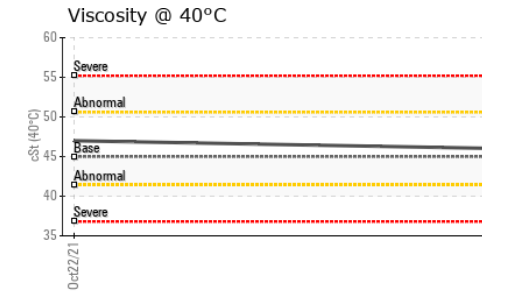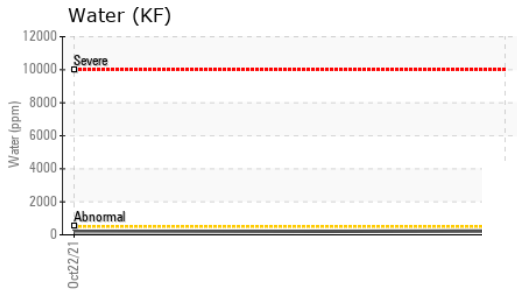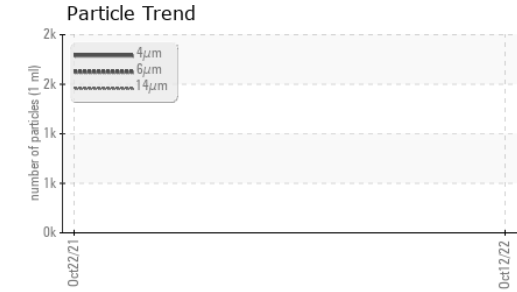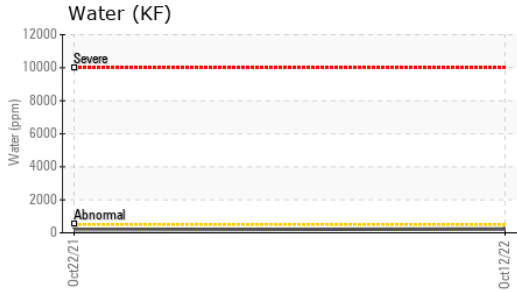






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.0	47.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

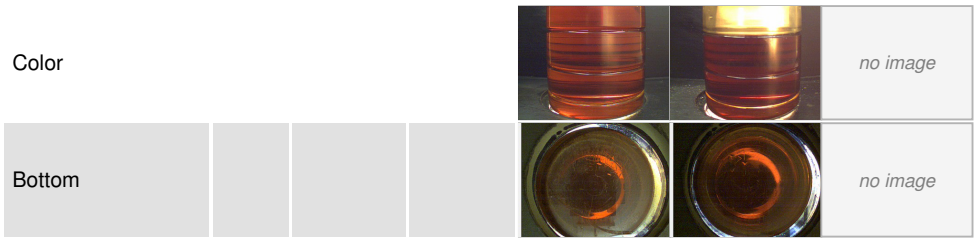

GRAPHS

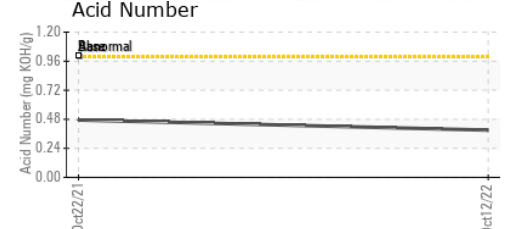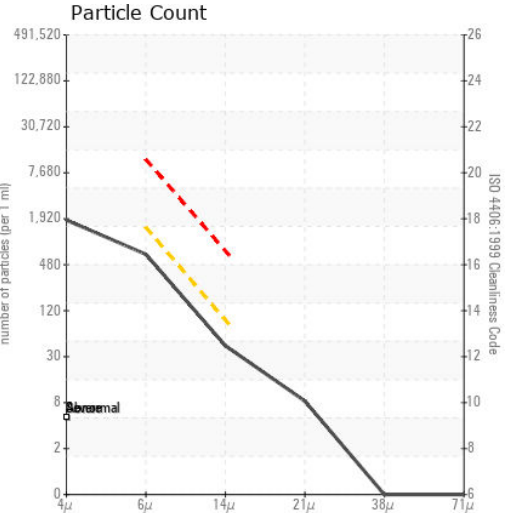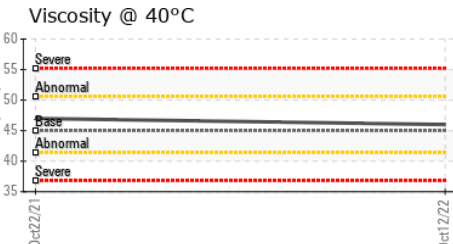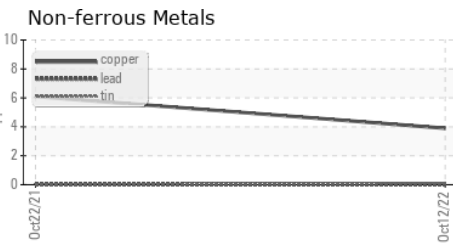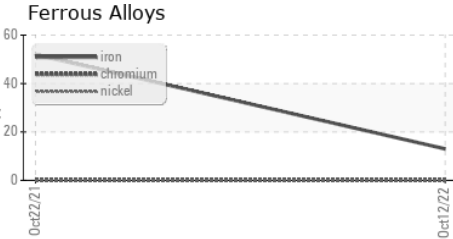

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP46738D **Received** : 25 Oct 2022
Lab Number : 05675667 **Diagnosed** : 27 Oct 2022
Unique Number : 10190238 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MICRO-VU CORP
 7909 CONDE LN
 WINDSOR, CA
 US 95492
 Contact: IAN DAVISON
 iandavison@microvu.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)