




# OIL ANALYSIS REPORT

Sample Rating Trend

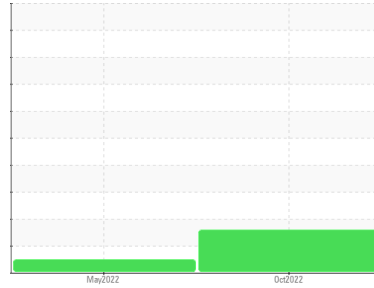

Machine Id  
**KAESER 7119781**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of particulates present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC85899</b>	KC103663	---
Sample Date	Client Info			<b>19 Oct 2022</b>	11 May 2022	---
Machine Age	hrs	Client Info		<b>13911</b>	10060	---
Oil Age	hrs	Client Info		<b>3500</b>	7300	---
Oil Changed	Client Info			<b>Not Changed</b>	Changed	---
Sample Status				<b>ABNORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>2</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>9</b>	<1	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>4</b>	6	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	2	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	90	<b>&lt;1</b>	0	---
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m		<b>6</b>	4	---
Zinc	ppm	ASTM D5185m		<b>2</b>	0	---


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>0</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	---
Water	%	ASTM D6304	>0.05	<b>0.014</b>	0.011	---
ppm Water	ppm	ASTM D6304	>500	<b>140.3</b>	117.6	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>33147</b>	696	---
Particles >6µm		ASTM D7647	>1300	<b>▲ 8893</b>	233	---
Particles >14µm		ASTM D7647	>80	<b>▲ 706</b>	26	---
Particles >21µm		ASTM D7647	>20	<b>▲ 165</b>	9	---
Particles >38µm		ASTM D7647	>4	<b>1</b>	2	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 22/20/17</b>	17/15/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.45</b>	0.48	---

# OIL ANALYSIS REPORT


## ▲ Particle Trend

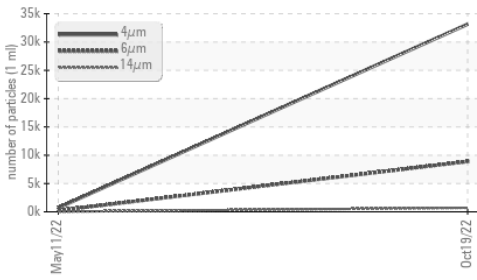

## Water (KF)




## Acid Number

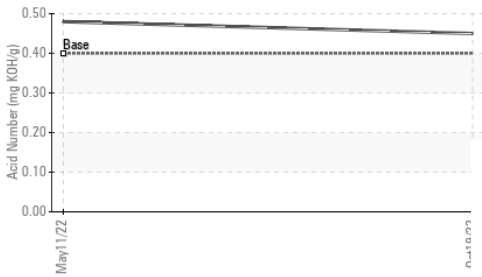

## Water (KF)



## Viscosity @ 40°C

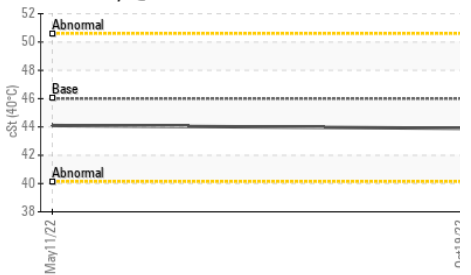


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.9	44.1


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

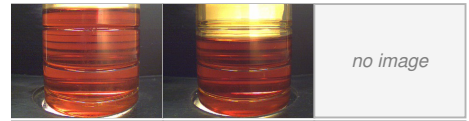

no image

Bottom




no image

## GRAPHS


### Ferrous Alloys




### Non-ferrous Metals

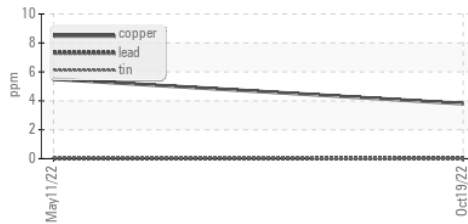

### Viscosity @ 40°C

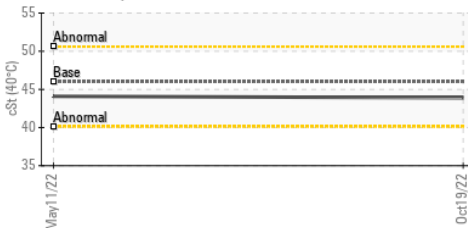

### ▲ Particle Count

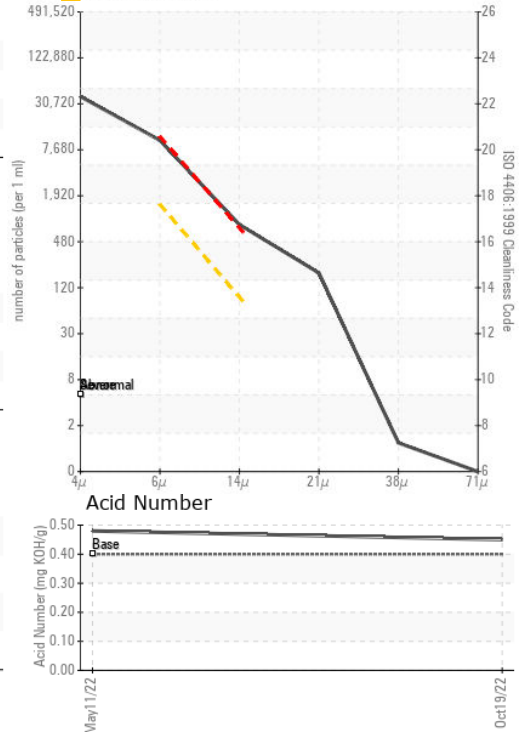

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC85899  
**Lab Number** : 05675683  
**Unique Number** : 10190254  
**Test Package** : IND 2  
**Received** : 25 Oct 2022  
**Tested** : 26 Oct 2022  
**Diagnosed** : 27 Oct 2022 - Don Baldrige

**INEOS**  
 200 NEVILLE RD  
 PITTSBURGH, PA  
 US 15225  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: