




PROBLEM SUMMARY

Sample Rating Trend

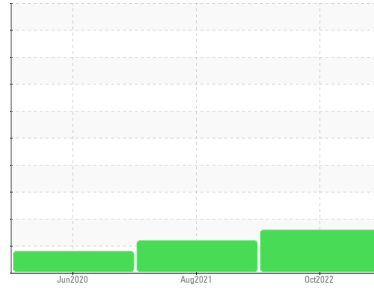

ISO




Machine Id
6539993 (S/N 1105)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

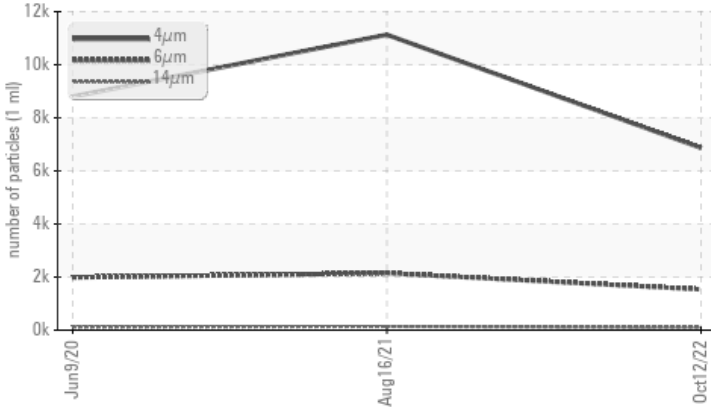

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ATTENTION	ATTENTION
Particles >6µm	ASTM D7647	>1300	▲ 1536	▲ 2146	▲ 1989
Particles >14µm	ASTM D7647	>80	▲ 94	▲ 137	▲ 115
Particles >21µm	ASTM D7647	>20	▲ 29	▲ 38	▲ 28
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	▲ 18/14	▲ 18/14

Customer Id: EIFCLE
Sample No.: KCP46715
Lab Number: 05677376
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

16 Aug 2021 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



09 Jun 2020 Diag: Angela Borella

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



OIL ANALYSIS REPORT

Sample Rating Trend

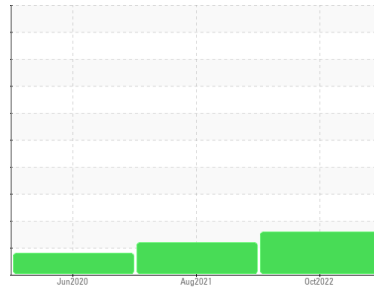

ISO



Machine Id
6539993 (S/N 1105)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCP46715	KCP42575	KCP23145
Sample Date	Client Info	12 Oct 2022	16 Aug 2021	09 Jun 2020
Machine Age	hrs	2731	1697	999
Oil Age	hrs	1034	697	999
Oil Changed	Client Info	Changed	Changed	Changed
Sample Status		ATTENTION	ATTENTION	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	1	2
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	<1	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	13	6	3
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	4	0
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	20	0
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	<1	1
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 100	17	38	54
Calcium	ppm	ASTM D5185m 0	4	0	1
Phosphorus	ppm	ASTM D5185m 0	6	9	71
Zinc	ppm	ASTM D5185m 0	62	26	22
Sulfur	ppm	ASTM D5185m 23500	25474	19484	14820

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	1	2	<1
Sodium	ppm	ASTM D5185m	1	10	13
Potassium	ppm	ASTM D5185m >20	0	8	3
Water	%	ASTM D6304 >0.05	0.020	0.030	0.029
ppm Water	ppm	ASTM D6304 >500	205.0	306.2	292.6






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	6866	11131	8800
Particles >6µm	ASTM D7647 >1300	▲ 1536	▲ 2146	▲ 1989
Particles >14µm	ASTM D7647 >80	▲ 94	▲ 137	▲ 115
Particles >21µm	ASTM D7647 >20	▲ 29	▲ 38	28
Particles >38µm	ASTM D7647 >4	2	3	1
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/18/14	▲ 18/14	▲ 18/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.38	0.314	0.312


OIL ANALYSIS REPORT

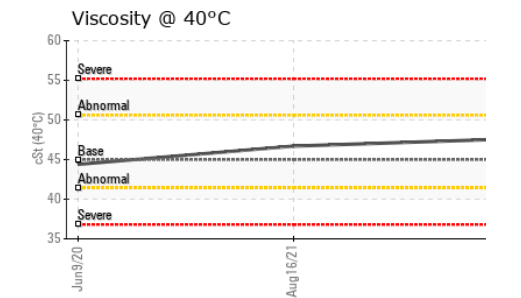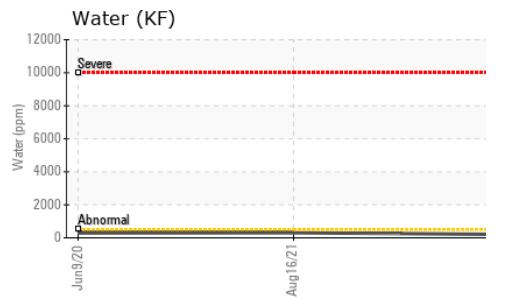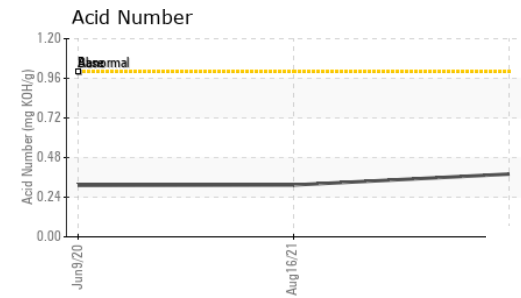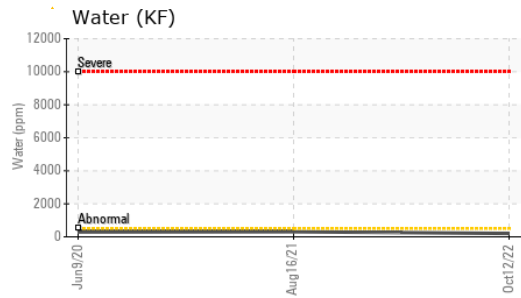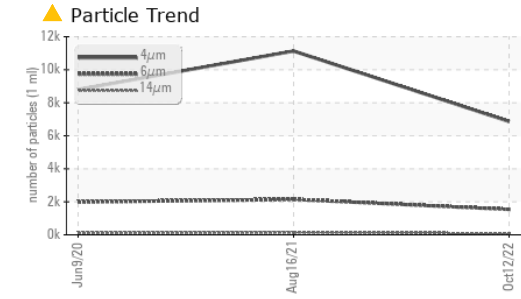






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	47.6	46.7	44.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

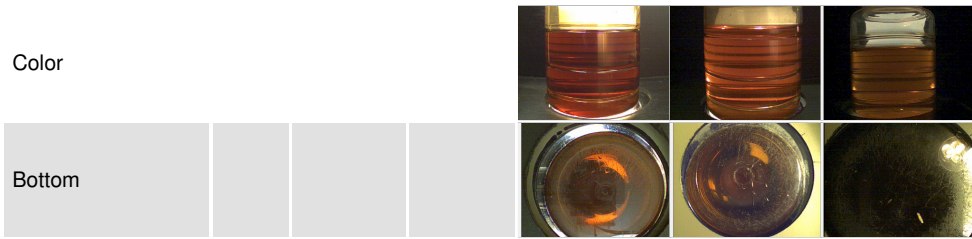

GRAPHS

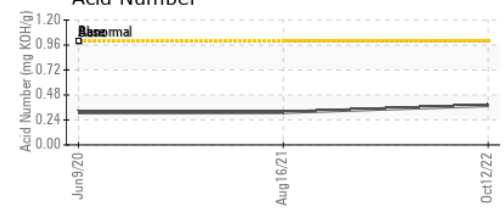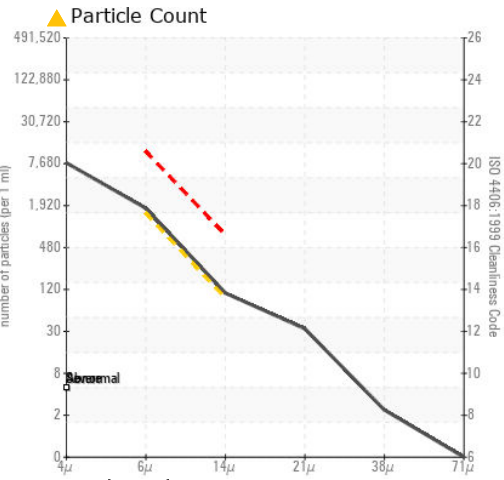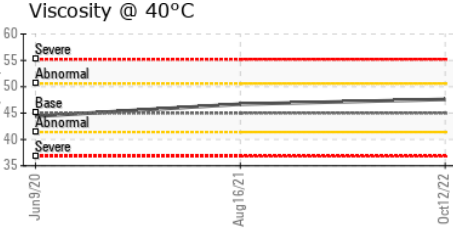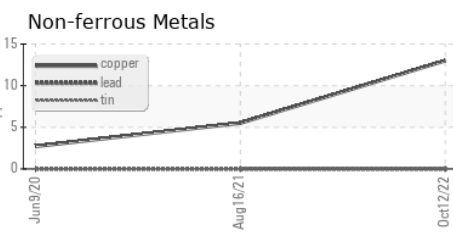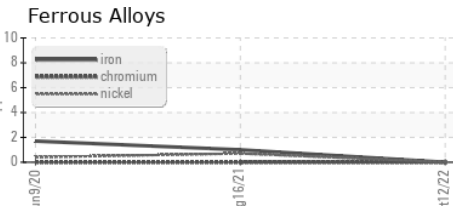

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP46715 **Received** : 26 Oct 2022
Lab Number : 05677376 **Diagnosed** : 31 Oct 2022
Unique Number : 10191947 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

EIFELER COATING TECHNOLOGY
 3450 OLD TASSO RD NE
 CLEVELAND, TN
 US 37312
 Contact: ALLEN STEWART
 allen.stewart@eifeler.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)