




PROBLEM SUMMARY

Sample Rating Trend


ISO

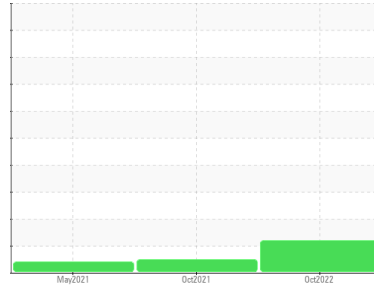

Area
FRONTIER II [200006776]
 Machine Id
61WEA86944
 Component
Wind Turbine Gearbox
 Fluid
FUCHS RENOLIN CLP ISO 320 (--- LTR)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

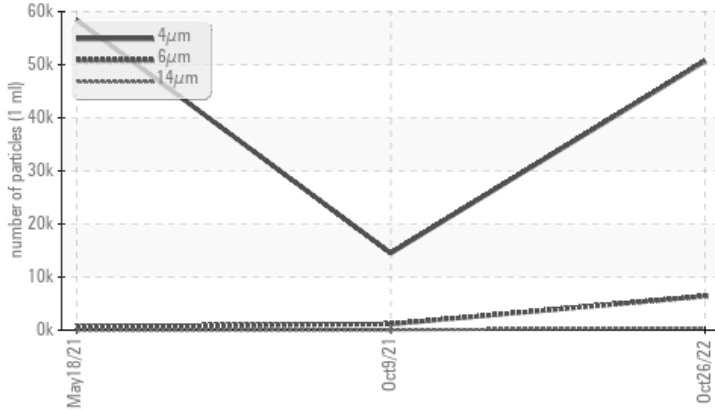

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>2500	▲ 6399	1153	▲ 659
Particles >14µm	ASTM D7647	>320	▲ 371	43	0
Oil Cleanliness	ISO 4406 (c)	>--/18/15	▲ 23/20/16	21/17/13	▲ 23/17/7

Customer Id: NORDEX
 Sample No.: NX05678592
 Lab Number: 05678592
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

09 Oct 2021 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



18 May 2021 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service. Color is L6.0.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

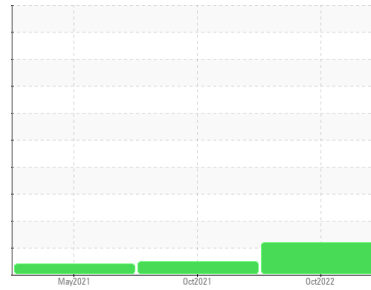

ISO



Area
FRONTIER II [200006776]
 Machine Id
61WEA86944
 Component
Wind Turbine Gearbox
 Fluid
FUCHS RENOLIN CLP ISO 320 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		NX05678592	NX008451	NX008436
Sample Date	Client Info		26 Oct 2022	09 Oct 2021	18 May 2021
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	ABNORMAL

WEAR METALS	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>80	7	20	17	
Iron	ppm	ASTM D5185m	>150	16	8	6
Chromium	ppm	ASTM D5185m	>5	0	0	<1
Nickel	ppm	ASTM D5185m	>10	0	<1	1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>20	0	<1	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m		0	<1	0
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	13	13
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	1
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		9	13	11
Phosphorus	ppm	ASTM D5185m		180	87	173
Zinc	ppm	ASTM D5185m		2	0	1
Sulfur	ppm	ASTM D5185m		5563	4526	3457

CONTAMINANTS	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	4	4	3
Sodium	ppm	ASTM D5185m	>20	1	1	<1
Potassium	ppm	ASTM D5185m	>20	0	<1	8
Water	%	ASTM D6304	>0.05	0.007	0.007	0.010
ppm Water	ppm	ASTM D6304	>500	73.9	74.5	100.7

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		50671	14509	58400
Particles >6µm	ASTM D7647	>2500	▲ 6399	1153	▲ 659
Particles >14µm	ASTM D7647	>320	▲ 371	43	0
Particles >21µm	ASTM D7647	>80	80	6	0
Particles >38µm	ASTM D7647	>20	2	0	0
Particles >71µm	ASTM D7647	>4	1	0	0
Oil Cleanliness	ISO 4406 (c)	---/18/15	▲ 23/20/16	21/17/13	▲ 23/17/7



OIL ANALYSIS REPORT

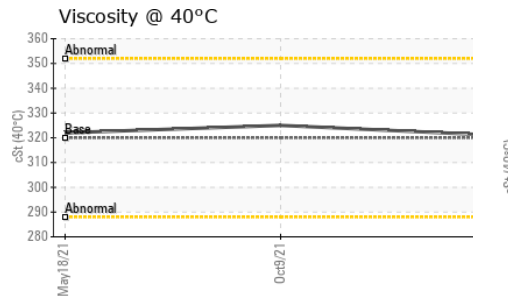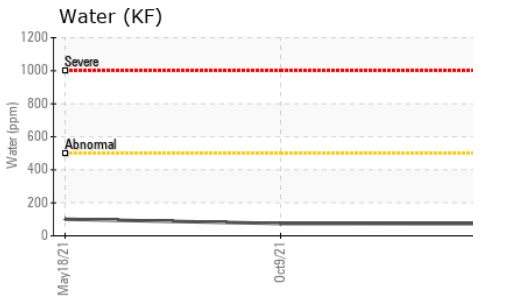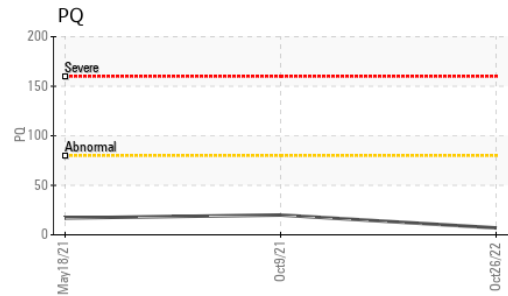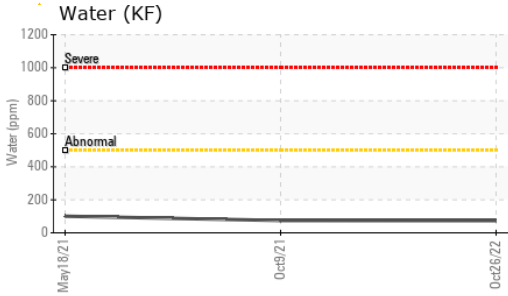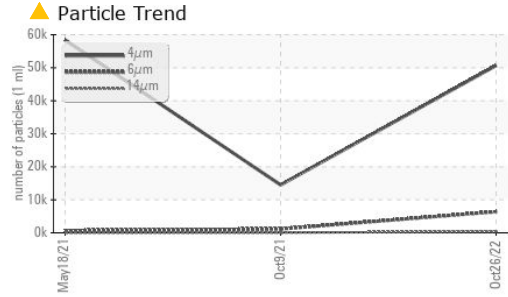






FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.56	0.546	0.513

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	320	321	325	322

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

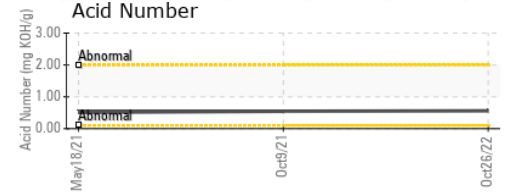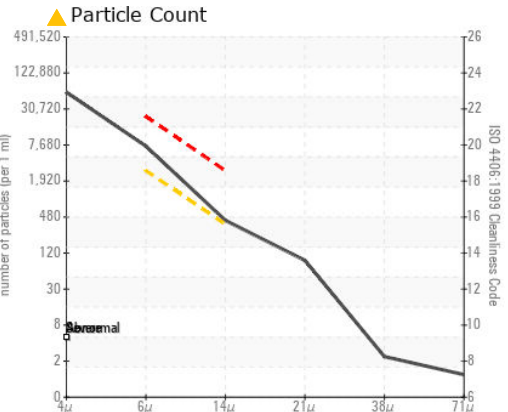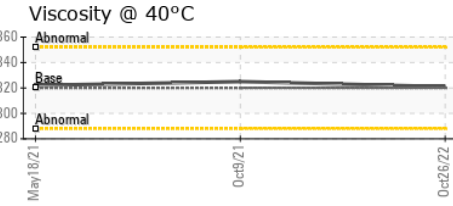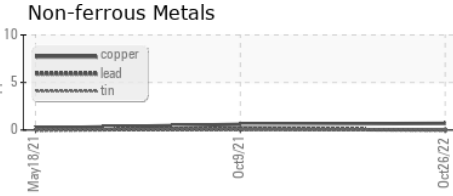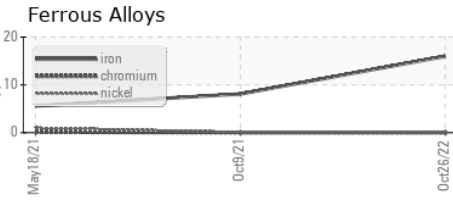

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX05678592 **Received** : 27 Oct 2022
Lab Number : **05678592** **Diagnosed** : 31 Oct 2022
Unique Number : 10193163 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com
 T: (312)386-4124
 F: (312)386-7102

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)