




# PROBLEM SUMMARY

Sample Rating Trend

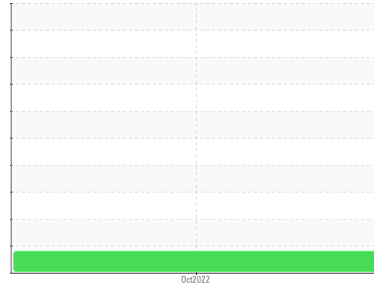

WEAR




Machine Id  
**MILTON ROY P108A**

Component  
**Gearbox**

Fluid  
**HIGH PERFORMANCE LUBRICANTS HYDRAULIC LIFE 220 (1 GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Ferrous Alloys

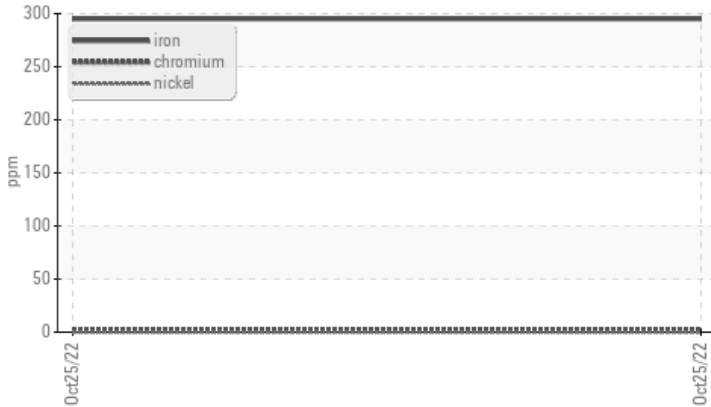

## RECOMMENDATION

No corrective action is recommended at this time.  
Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Iron	ppm	ASTM D5185m	>200	▲ 295	---	---

Customer Id: RAVBAY  
Sample No.: RP0026975  
Lab Number: 05681768  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS


*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

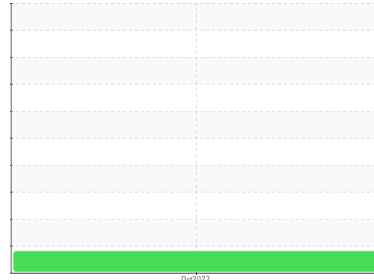

**WEAR**



Machine Id  
**MILTON ROY P108A**

Component

**Gearbox**

Fluid

**HIGH PERFORMANCE LUBRICANTS HYDRAULIC LIFE 220 (1 GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### ▲ Wear

Gear wear is indicated. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>RP0026975</b>	---	---
Sample Date	Client Info	<b>25 Oct 2022</b>	---	---
Machine Age	yrs Client Info	<b>2</b>	---	---
Oil Age	yrs Client Info	<b>1</b>	---	---
Oil Changed	Client Info	<b>Not Chngd</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>200	<b>▲ 295</b>	---	---
Chromium ppm ASTM D5185m	>10	<b>2</b>	---	---
Nickel ppm ASTM D5185m		<b>0</b>	---	---
Titanium ppm ASTM D5185m		<b>0</b>	---	---
Silver ppm ASTM D5185m		<b>&lt;1</b>	---	---
Aluminum ppm ASTM D5185m	>25	<b>2</b>	---	---
Lead ppm ASTM D5185m	>50	<b>0</b>	---	---
Copper ppm ASTM D5185m	>200	<b>12</b>	---	---
Tin ppm ASTM D5185m	>10	<b>&lt;1</b>	---	---
Vanadium ppm ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium ppm ASTM D5185m		<b>&lt;1</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>1</b>	---	---
Barium ppm ASTM D5185m		<b>0</b>	---	---
Molybdenum ppm ASTM D5185m		<b>&lt;1</b>	---	---
Manganese ppm ASTM D5185m		<b>3</b>	---	---
Magnesium ppm ASTM D5185m		<b>3</b>	---	---
Calcium ppm ASTM D5185m		<b>48</b>	---	---
Phosphorus ppm ASTM D5185m		<b>136</b>	---	---
Zinc ppm ASTM D5185m		<b>9</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>50	<b>5</b>	---	---
Sodium ppm ASTM D5185m		<b>2</b>	---	---
Potassium ppm ASTM D5185m	>20	<b>2</b>	---	---
Water % ASTM D6304	>0.2	<b>0.006</b>	---	---
ppm Water ppm ASTM D6304	>2000	<b>62.1</b>	---	---





## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		<b>0.13</b>	---	---

## VISUAL

method	limit/base	current	history1	history2
White Metal scalar *Visual	NONE	<b>NONE</b>	---	---
Yellow Metal scalar *Visual	NONE	<b>NONE</b>	---	---
Precipitate scalar *Visual	NONE	<b>NONE</b>	---	---
Silt scalar *Visual	NONE	<b>NONE</b>	---	---
Debris scalar *Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt scalar *Visual	NONE	<b>NONE</b>	---	---
Appearance scalar *Visual	NORML	<b>NORML</b>	---	---
Odor scalar *Visual	NORML	<b>NORML</b>	---	---
Emulsified Water scalar *Visual	>0.2	<b>NEG</b>	---	---
Free Water scalar *Visual		<b>NEG</b>	---	---

# OIL ANALYSIS REPORT

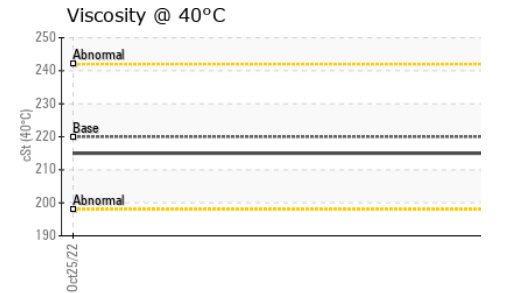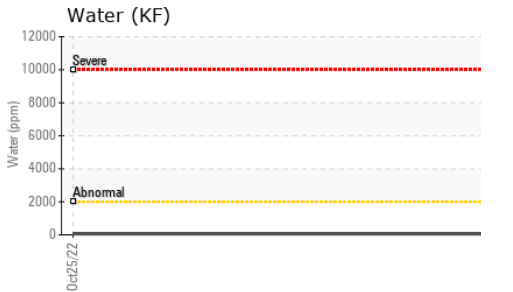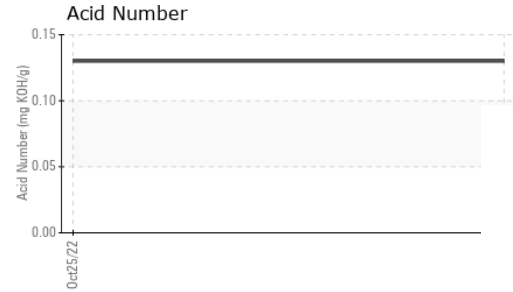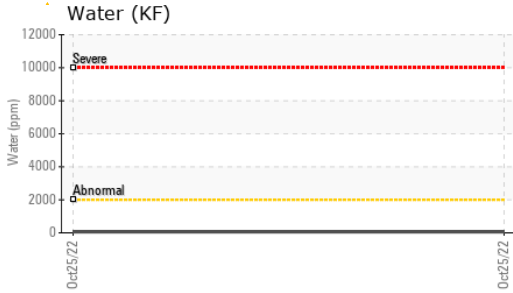





**FLUID PROPERTIES**

method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445 220	215	---	---

**SAMPLE IMAGES**

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

**GRAPHS**

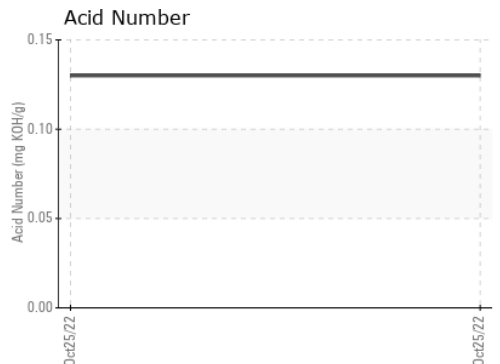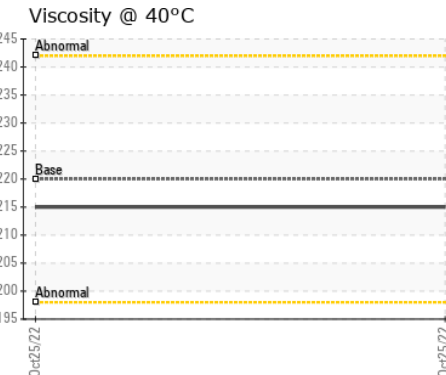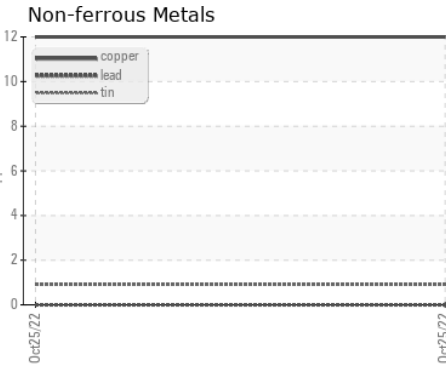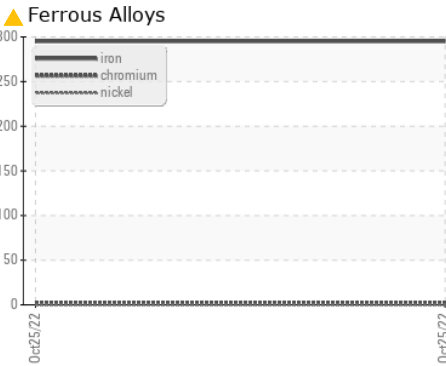

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0026975 **Received** : 01 Nov 2022  
**Lab Number** : 05681768 **Diagnosed** : 03 Nov 2022  
**Unique Number** : 10201340 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**RAVEN CHEM**  
 9520 E FREEWAY  
 BAYTOWN, TX  
 US 77522

Contact: RANDALL COOK  
 randall.cook@revenchem.com

T: (832)969-6691

F: