




# KAESER SX 6 1842013 (S/N 1914)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## COMPONENT CONDITION SUMMARY

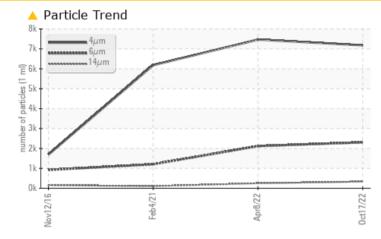

#### RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status		ABNORMAL	ABNORMAL	ATTENTION					
Particles >6µm	ASTM D7647 >1300	<u> </u>	<u> </u>	1205					
Particles >14µm	ASTM D7647 >80	<b>A</b> 334	<b>a</b> 251	<b>1</b> 08					
Particles >21µm	ASTM D7647 >20	<u> </u>	<u> </u>	<u> </u>					
Oil Cleanliness	ISO 4406 (c) >/17/	'13 🔺 <b>20/18/16</b>	🔺 18/15	🔺 17/14					


Customer Id: DIRDEN Sample No.: KCP50496 Lab Number: 05682837 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

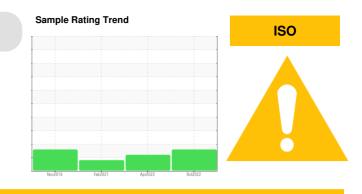

#### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

#### **HISTORICAL DIAGNOSIS**

# 08 Apr 2022 Diag: Doug Bogart



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

#### 04 Feb 2021 Diag: Jonathan Hester



No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view repor



12 Nov 2016 Diag: Jonathan Hester

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.







# **OIL ANALYSIS REPORT**

#### Machine Id KAESER SX 6 1842013 (S/N 1914) Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

### DIAGNOSIS

#### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## Wear


All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

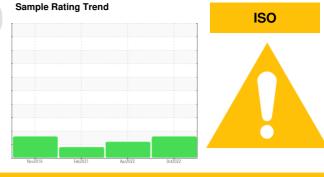

SAMPLE INFORM	<b>MATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP50496	KCP40944	KCP34502
Sample Date		Client Info		17 Oct 2022	08 Apr 2022	04 Feb 2021
Machine Age	hrs	Client Info		28945	28366	26267
Oil Age	hrs	Client Info		578	2099	661
Oil Changed		Client Info		Not Changd	Changed	N/A
Sample Status				ABNORMAL	ABNORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	1	<1	<1
Tin	ppm		>10	0	0	0
Antimony	ppm	ASTM D5185m	210			0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
	ppiii		11 11 11	-	-	-
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	73	62	47
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	79	92	81
Calcium	ppm	ASTM D5185m		3	1	3
Phosphorus	ppm	ASTM D5185m	0	2	4	4
Zinc	ppm	ASTM D5185m	0	4	0	0
Sulfur	ppm	ASTM D5185m	23500	21858	17632	17024
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		7	8	8
Potassium	ppm	ASTM D5185m	>20	0	<1	1
Water	%	ASTM D6304	>0.05	0.004	0.009	0.013
ppm Water	ppm	ASTM D6304	>500	43.8	91.3	139.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7179	7467	6183
Particles >6µm		ASTM D7647	>1300	<u> </u>	<b>A</b> 2119	1205
Particles >14µm		ASTM D7647	>80	<b>A</b> 334	🔺 251	<u> </u>
Particles >21µm		ASTM D7647	>20	<u> </u>	<b>1</b> 79	<b>5</b> 1
Particles >38µm		ASTM D7647	>4	3	4	4
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>A</b> 20/18/16	▲ 18/15	▲ 17/14
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.47	0.36	0.317
105 (10) David	- 0			-		


Report Id: DIRDEN [WUSCAR] 05682837 (Generated: 08/10/2023 07:05:48) Rev: 1

Contact/Location: LS ? - DIRDEN



1.20

# **OIL ANALYSIS REPORT**

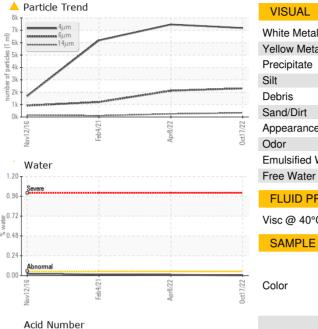



Bottom

