


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

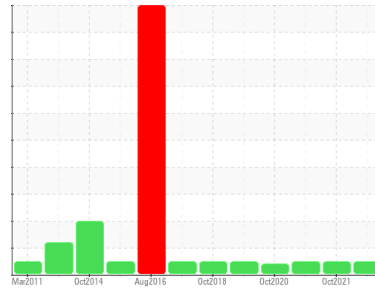

Machine Id  
**A504 (S/N 6410-04)**

Component  
**Wind Turbine Gearbox**

Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (74 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>MHI025115</b>	MHI017703	MHI017466
Sample Date	Client Info		<b>11 Oct 2022</b>	19 Oct 2021	10 Dec 2020
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>88259</b>	82366	76818
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>200	<b>12</b>	18	16	
Iron	ppm	ASTM D5185m	>200	<b>7</b>	9	10
Chromium	ppm	ASTM D5185m		<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m		<b>0</b>	0	0
Lead	ppm	ASTM D5185m		<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>75	<b>18</b>	12	3
Tin	ppm	ASTM D5185m		<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	<b>2</b>	4	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	485	<b>403</b>	383	424
Zinc	ppm	ASTM D5185m	0	<b>0</b>	11	4
Sulfur	ppm	ASTM D5185m		<b>4284</b>	3503	3656






## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>+30	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Water	%	ASTM D6304	>0.1	<b>0.014</b>	0.005	0.003
ppm Water	ppm	ASTM D6304	>1000	<b>148.7</b>	50.9	29.2

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>224</b>	340	144
Particles >6µm	ASTM D7647	>5000	<b>58</b>	95	70
Particles >14µm	ASTM D7647	>640	<b>9</b>	13	14
Particles >21µm	ASTM D7647	>160	<b>4</b>	4	5
Particles >38µm	ASTM D7647	>40	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/19/16	<b>15/13/10</b>	16/14/11	14/13/11

# OIL ANALYSIS REPORT

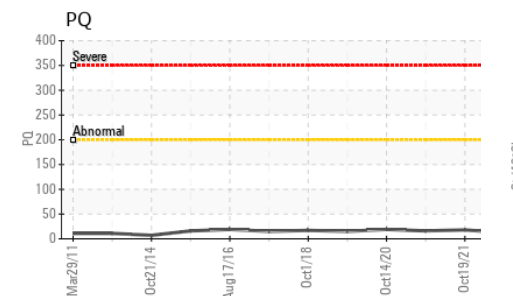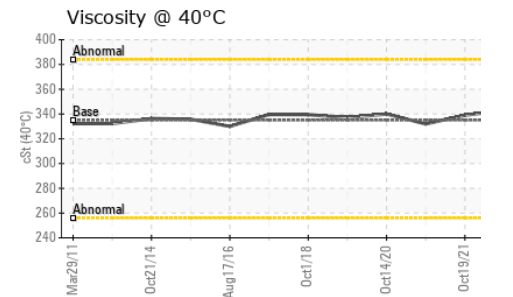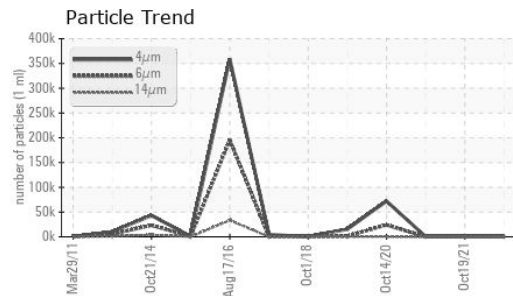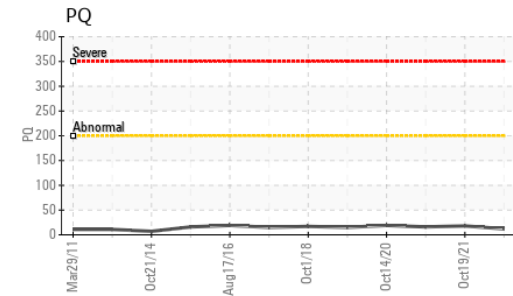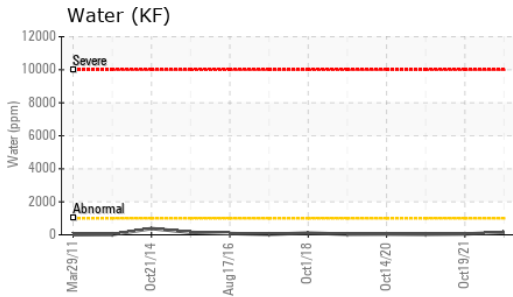


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	<b>1.29</b>	1.295	1.212

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	<b>343</b>	339	332

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------






Color



Bottom

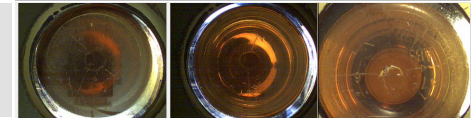

## GRAPHS

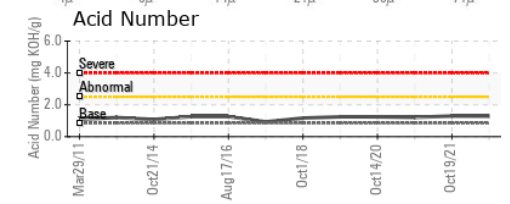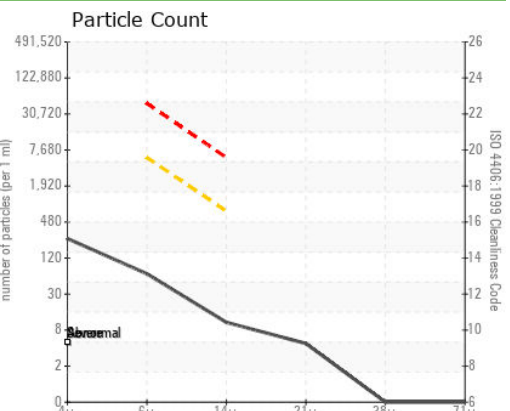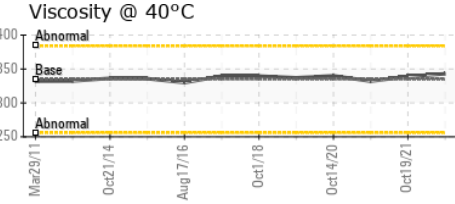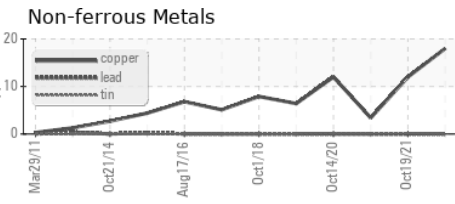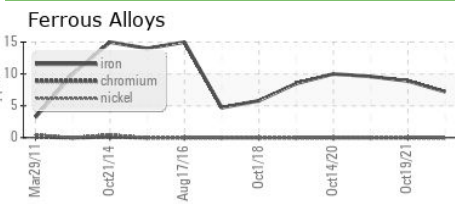

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MH1025115 **Received** : 07 Nov 2022  
**Lab Number** : 05687139 **Diagnosed** : 09 Nov 2022  
**Unique Number** : 10206711 **Diagnostician** : Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**DIAMOND WTG - DILLON**  
P.O. BOX 880  
DESERT HOT SPRINGS, CA  
US 92240  
Contact: DANIEL BOYD  
daniel.boyd@diamondwtg.com  
T: (760)329-7171  
F: (760)329-7122

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)