




# FUEL REPORT

Sample Rating Trend

ISO

Area  
**HOSPITAL**  
 Machine Id  
**15000 ABOVE GROUND DUKE DMP TANK 1**  
 Component  
**Diesel Fuel**  
 Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (15000 GAL)**

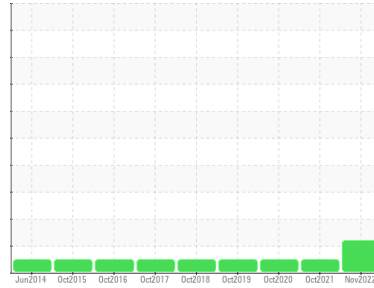

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component if applicable. All other laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

There is a high amount of particulates present in the fuel. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible.

### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC05687548</b>	WC05367392	WC05088150
Sample Date	Client Info			<b>07 Nov 2022</b>	05 Oct 2021	11 Oct 2020
Machine Age	hrs	Client Info		<b>0</b>	0	0
Sample Status				<b>ABNORMAL</b>	NORMAL	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	0.839	<b>0.842</b>	0.842	0.842
Fuel Color	text	*Visual Screen	Yellow	<b>Red</b>	Red	Red
ASTM Color	scalar	*ASTM D1500		<b>L4.5</b>	L4.0	L5.5
Visc @ 40°C	cSt	ASTM D445	3.0	<b>2.51</b>	2.53	2.32
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	<b>61</b>	63	65

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	<b>0</b>	0	5
Sulfur (UVF)	ppm	ASTM D5453		<b>10</b>	10	8






DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	<b>166</b>	163	164
5% Distillation Point	°C	ASTM D86		<b>190</b>	191	189
10% Distill Point	°C	ASTM D86	201	<b>202</b>	202	200
15% Distillation Point	°C	ASTM D86		<b>210</b>	211	210
20% Distill Point	°C	ASTM D86	216	<b>217</b>	219	218
30% Distill Point	°C	ASTM D86	230	<b>233</b>	233	233
40% Distill Point	°C	ASTM D86	243	<b>246</b>	247	246
50% Distill Point	°C	ASTM D86	255	<b>261</b>	261	261
60% Distill Point	°C	ASTM D86	267	<b>276</b>	275	275
70% Distill Point	°C	ASTM D86	280	<b>291</b>	291	291
80% Distill Point	°C	ASTM D86	295	<b>308</b>	307	307
85% Distillation Point	°C	ASTM D86		<b>318</b>	316	316
90% Distill Point	°C	ASTM D86	310	<b>329</b>	328	327
95% Distillation Point	°C	ASTM D86		<b>345</b>	344	344
Final Boiling Point	°C	ASTM D86	341	<b>352</b>	351	350
Distillation Residue	%	ASTM D86	3.0	<b>1.4</b>	1.4	1.4
Distillation Loss	%	ASTM D86	3.0	<b>0.6</b>	0.6	0.8

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	<b>36.6</b>	36.6	36.6
Cetane Index		ASTM D4737	<40.0	<b>48.0</b>	48.1	47.7

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Water	%	ASTM D6304	<0.05	<b>0.005</b>	0.004	0.005
ppm Water	ppm	ASTM D6304	<500	<b>57.7</b>	41.3	53.7
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	0.0	0.0
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	3.0	1.5




# FUEL REPORT

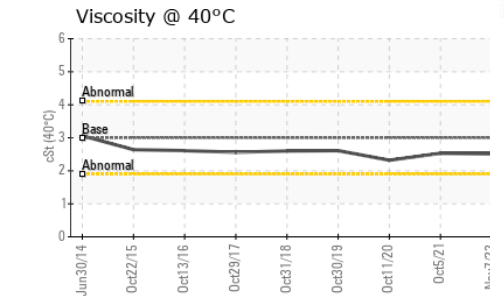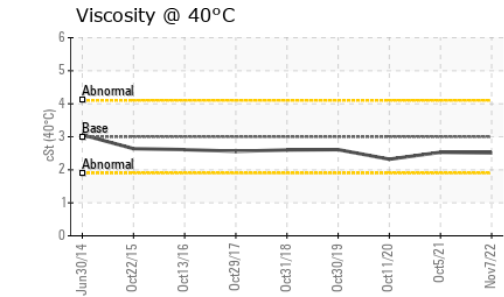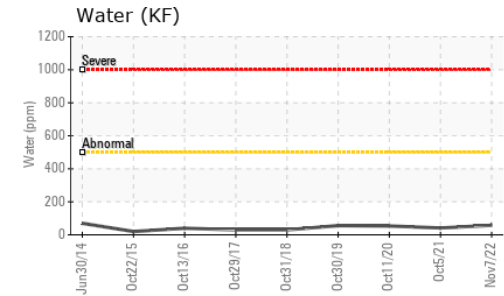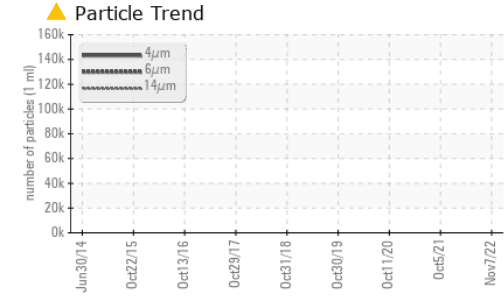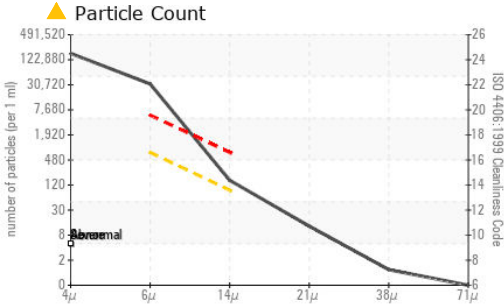



FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>150888</b>	---	---
Particles >6µm	ASTM D7647	>640	<b>▲ 27883</b>	---	---
Particles >14µm	ASTM D7647	>80	<b>▲ 138</b>	---	---
Particles >21µm	ASTM D7647	>20	<b>11</b>	---	---
Particles >38µm	ASTM D7647	>4	<b>1</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/16/13	<b>▲ 24/22/14</b>	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Lead	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Iron	ppm	ASTM D5185m <0.1	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m <0.1	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m <0.1	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m <0.1	<b>&lt;1</b>	16	2
Zinc	ppm	ASTM D5185m <0.1	<b>0</b>	0	0

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

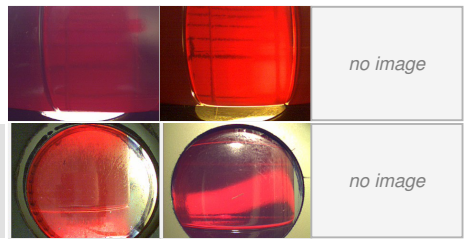

## GRAPHS

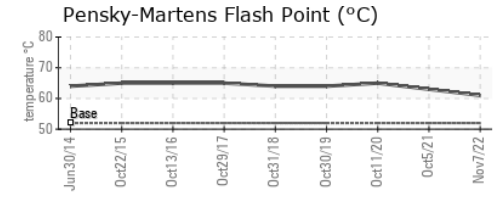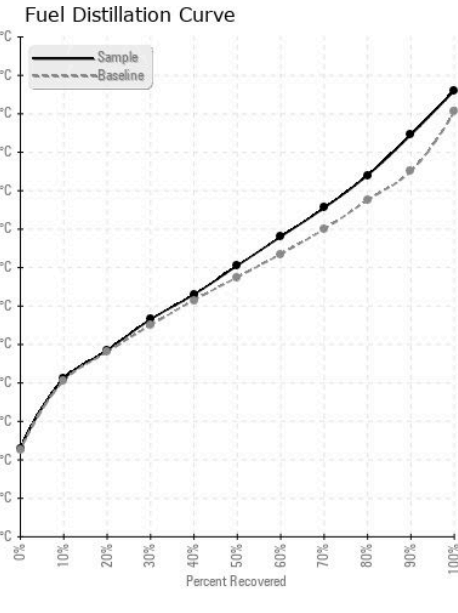

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC05687548 **Received** : 07 Nov 2022  
**Lab Number** : **05687548** **Tested** : 18 Nov 2022  
**Unique Number** : 10207120 **Diagnosed** : 18 Nov 2022 - Doug Bogart  
**Test Package** : DF-2 ( Additional Tests: Screen )

**COUCH OIL COMPANY**  
 2907 HILLSBOROUGH RD  
 DURHAM, NC  
 US 27705  
 Contact: JESSE BROWN  
 jesse@couchoilcompany.com  
 T: (919)285-5408  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)