




# FUEL REPORT

Sample Rating Trend

ISO

Area  
**HOSPITAL**  
 Machine Id  
**100 gallon DUKE HUDSON BLDG DAY TANK**  
 Component  
**Diesel Fuel**  
 Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (100 GAL)**

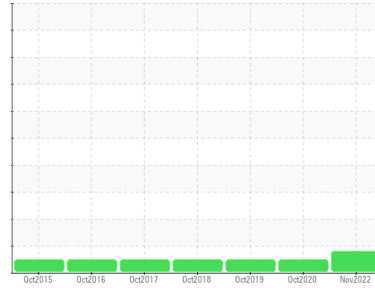

## DIAGNOSIS

### Recommendation

All other laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

There is a high amount of silt (particulates < 14 microns in size) present in the fuel. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible.

### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC05687549</b>	WC05088160	WC04835595
Sample Date	Client Info		<b>07 Nov 2022</b>	11 Oct 2020	30 Oct 2019
Machine Age	hrs	Client Info	<b>0</b>	0	0
Sample Status			<b>ATTENTION</b>	NORMAL	NORMAL

## PHYSICAL PROPERTIES

	method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298	0.839	<b>0.842</b>	0.843	0.844
Fuel Color	text	*Visual Screen	<b>Yellow</b>	Red	Red
ASTM Color	scalar	*ASTM D1500	<b>L4.0</b>	L5.5	L5.0
Visc @ 40°C	cSt	ASTM D445	<b>3.0</b>	2.58	2.42
Pensky-Martens Flash Point	°C	*PMCC Calculated	<b>52</b>	50	52

## SULFUR CONTENT

	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	<b>10</b>	9	18
Sulfur (UVF)	ppm	ASTM D5453	<b>8</b>	10	12

## DISTILLATION

	method	limit/base	current	history1	history2	
Initial Boiling Point	°C	ASTM D86	165	<b>173</b>	152	156
5% Distillation Point	°C	ASTM D86		<b>194</b>	190	190
10% Distill Point	°C	ASTM D86	201	<b>206</b>	204	204
15% Distillation Point	°C	ASTM D86		<b>216</b>	213	213
20% Distill Point	°C	ASTM D86	216	<b>223</b>	221	221
30% Distill Point	°C	ASTM D86	230	<b>239</b>	236	236
40% Distill Point	°C	ASTM D86	243	<b>254</b>	250	250
50% Distill Point	°C	ASTM D86	255	<b>268</b>	263	264
60% Distill Point	°C	ASTM D86	267	<b>283</b>	278	278
70% Distill Point	°C	ASTM D86	280	<b>298</b>	292	292
80% Distill Point	°C	ASTM D86	295	<b>316</b>	308	308
85% Distillation Point	°C	ASTM D86		<b>327</b>	317	317
90% Distill Point	°C	ASTM D86	310	<b>341</b>	328	328
95% Distillation Point	°C	ASTM D86		<b>344</b>	343	344
Final Boiling Point	°C	ASTM D86	341	<b>354</b>	351	351
Distillation Residue	%	ASTM D86	3.0	<b>1.5</b>	1.4	1.4
Distillation Loss	%	ASTM D86	3.0	<b>4.3</b>	0.6	0.7

## IGNITION QUALITY






	method	limit/base	current	history1	history2
API Gravity	ASTM D7777	37.7	<b>36.6</b>	36.4	36.2
Cetane Index	ASTM D4737	<40.0	<b>49.4</b>	47.9	47.9

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	<1
Sodium	ppm	ASTM D5185m	<0.1	<b>0</b>	0
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	1
Water	%	ASTM D6304	<0.05	<b>0.004</b>	0.005
ppm Water	ppm	ASTM D6304	<500	<b>40.4</b>	54.3
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	0.0
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	1.5



# FUEL REPORT

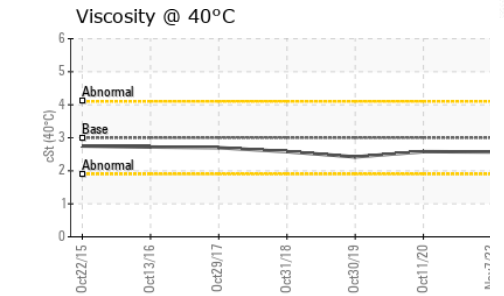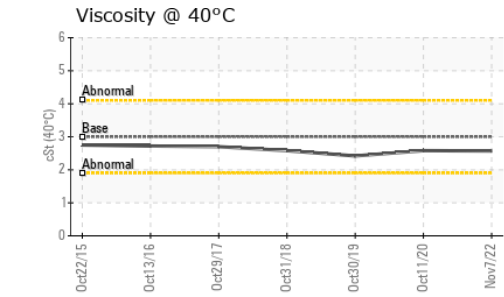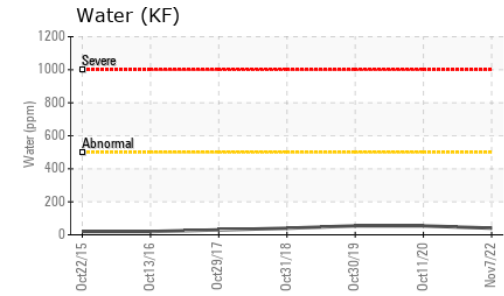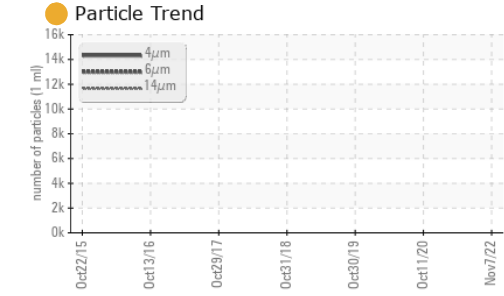
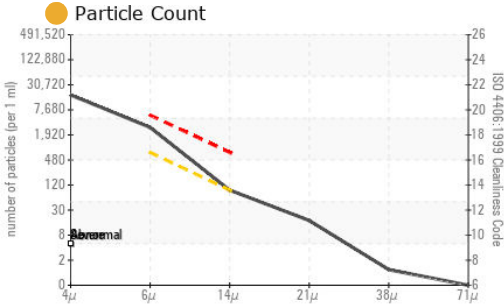


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>15197</b>	---	---
Particles >6µm	ASTM D7647	>640	<b>2537</b>	---	---
Particles >14µm	ASTM D7647	>80	<b>80</b>	---	---
Particles >21µm	ASTM D7647	>20	<b>15</b>	---	---
Particles >38µm	ASTM D7647	>4	<b>1</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/16/13	<b>21/19/13</b>	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Lead	ppm	ASTM D5185m <0.1	<b>0</b>	1	0
Vanadium	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Iron	ppm	ASTM D5185m <0.1	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m <0.1	<b>0</b>	2	2
Magnesium	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m <0.1	<b>&lt;1</b>	0	1
Zinc	ppm	ASTM D5185m <0.1	<b>0</b>	0	3

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS

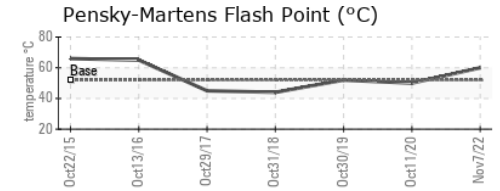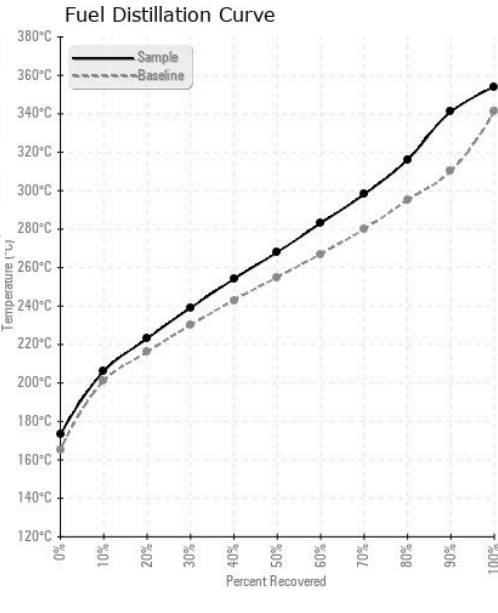

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC05687549 **Received** : 07 Nov 2022  
**Lab Number** : **05687549** **Tested** : 14 Nov 2022  
**Unique Number** : 10207121 **Diagnosed** : 17 Nov 2022 - Doug Bogart  
**Test Package** : DF-2 ( Additional Tests: Screen )

**COUCH OIL COMPANY**  
 2907 HILLSBOROUGH RD  
 DURHAM, NC  
 US 27705  
 Contact: JESSE BROWN  
 jesse@couchoilcompany.com  
 T: (919)285-5408  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)